




OIL ANALYSIS REPORT

Sample Rating Trend

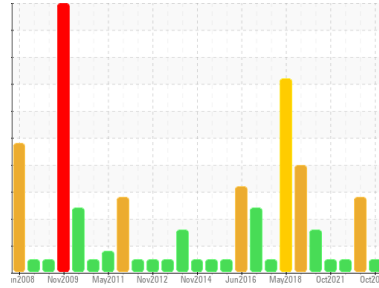

NORMAL



Area
LFC-1030-CM-01-CM030
 Machine Id
DT03PP01-1030 - Pump
 Component
Gearbox
 Fluid
LE 4220 (--- GAL)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.
 NOTE: Please provide information regarding reservoir capacity, filter type and micron rating with next sample.

Wear

All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

| SAMPLE INFORMATION | | method | limit/base | current | history1 | history2 |
|--------------------|-------------|-------------|------------|--------------------|-------------|-------------|
| Sample Number | Client Info | | | WC0851591 | WC0793914 | WC0694312 |
| Sample Date | Client Info | | | 23 Oct 2023 | 24 Apr 2023 | 25 Apr 2022 |
| Machine Age | hrs | Client Info | | 0 | 0 | 0 |
| Oil Age | hrs | Client Info | | 0 | 0 | 0 |
| Oil Changed | Client Info | | | N/A | N/A | N/A |
| Sample Status | | | | NORMAL | ABNORMAL | NORMAL |

| WEAR METALS | | method | limit/base | current | history1 | history2 |
|-------------|-----|-------------|------------|------------|----------|----------|
| Iron | ppm | ASTM D5185m | >200 | 10 | 23 | 27 |
| Chromium | ppm | ASTM D5185m | >15 | 0 | <1 | <1 |
| Nickel | ppm | ASTM D5185m | >15 | 0 | 0 | 0 |
| Titanium | ppm | ASTM D5185m | | 0 | 0 | 0 |
| Silver | ppm | ASTM D5185m | | 0 | 0 | <1 |
| Aluminum | ppm | ASTM D5185m | >25 | 0 | 0 | <1 |
| Lead | ppm | ASTM D5185m | >100 | 0 | 0 | 0 |
| Copper | ppm | ASTM D5185m | >200 | 0 | <1 | 2 |
| Tin | ppm | ASTM D5185m | >25 | 0 | 0 | <1 |
| Antimony | ppm | ASTM D5185m | >5 | --- | --- | --- |
| Vanadium | ppm | ASTM D5185m | | 0 | 0 | 0 |
| Cadmium | ppm | ASTM D5185m | | 0 | 0 | 0 |

| ADDITIVES | | method | limit/base | current | history1 | history2 |
|------------|-----|-------------|------------|-------------|----------|----------|
| Boron | ppm | ASTM D5185m | | 0 | 0 | 0 |
| Barium | ppm | ASTM D5185m | | 0 | 0 | 0 |
| Molybdenum | ppm | ASTM D5185m | | 0 | 0 | 0 |
| Manganese | ppm | ASTM D5185m | | 0 | 0 | <1 |
| Magnesium | ppm | ASTM D5185m | | 0 | <1 | 0 |
| Calcium | ppm | ASTM D5185m | | 0 | <1 | 2 |
| Phosphorus | ppm | ASTM D5185m | | 179 | 161 | 288 |
| Zinc | ppm | ASTM D5185m | | 5 | 7 | 32 |
| Sulfur | ppm | ASTM D5185m | | 1851 | 1584 | 1444 |



| CONTAMINANTS | | method | limit/base | current | history1 | history2 |
|--------------|-----|-------------|------------|--------------|----------|----------|
| Silicon | ppm | ASTM D5185m | >50 | 1 | 2 | 3 |
| Sodium | ppm | ASTM D5185m | | <1 | 8 | 0 |
| Potassium | ppm | ASTM D5185m | >20 | <1 | 0 | 0 |

| FLUID DEGRADATION | | method | limit/base | current | history1 | history2 |
|-------------------|----------|------------|------------|-------------|----------|----------|
| Acid Number (AN) | mg KOH/g | ASTM D8045 | | 0.51 | 0.42 | 0.59 |

| VISUAL | | method | limit/base | current | history1 | history2 |
|------------------|--------|---------|------------|--------------|----------|----------|
| White Metal | scalar | *Visual | NONE | NONE | NONE | NONE |
| Yellow Metal | scalar | *Visual | NONE | NONE | NONE | NONE |
| Precipitate | scalar | *Visual | NONE | NONE | NONE | NONE |
| Silt | scalar | *Visual | NONE | NONE | NONE | NONE |
| Debris | scalar | *Visual | NONE | LIGHT | ▲ MODER | NONE |
| Sand/Dirt | scalar | *Visual | NONE | NONE | NONE | NONE |
| Appearance | scalar | *Visual | NORML | NORML | ▲ HAZY | NORML |
| Odor | scalar | *Visual | NORML | NORML | NORML | NORML |
| Emulsified Water | scalar | *Visual | >0.2 | NEG | 0.2% | NEG |
| Free Water | scalar | *Visual | | NEG | 0.1% | NEG |



OIL ANALYSIS REPORT



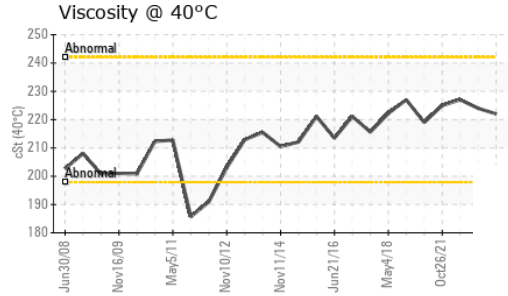
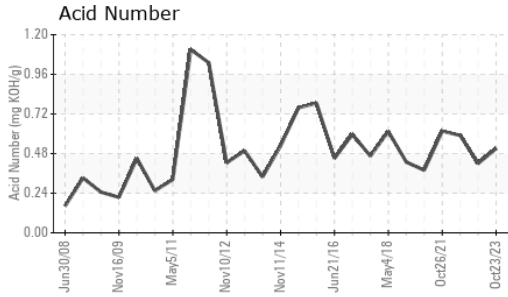


| FLUID PROPERTIES | | method | limit/base | current | history1 | history2 |
|------------------|-----|-----------|------------|------------|----------|----------|
| Visc @ 40°C | cSt | ASTM D445 | | 222 | 224 | 227 |

| SAMPLE IMAGES | | method | limit/base | current | history1 | history2 |
|---------------|--|--------|------------|---------|----------|----------|
|---------------|--|--------|------------|---------|----------|----------|



GRAPHS

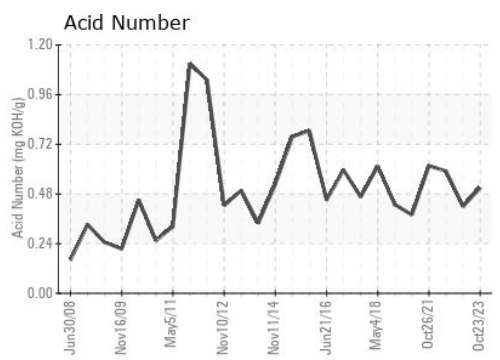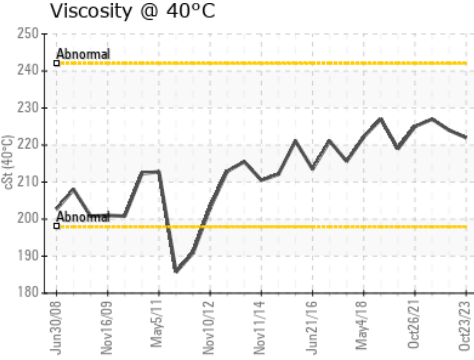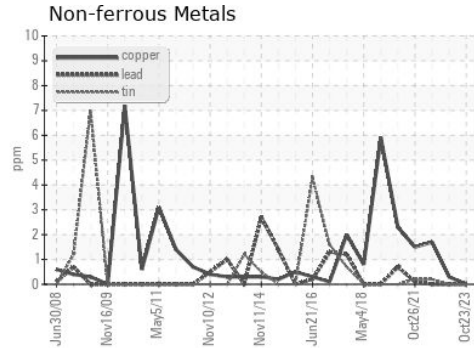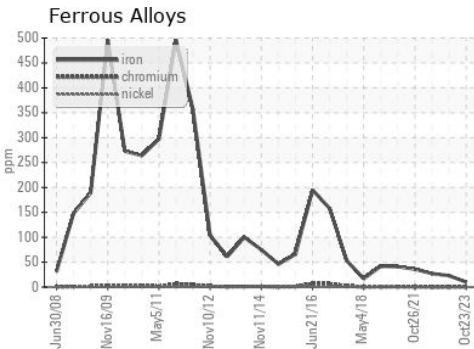

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : WC0851591 **Received** : 02 Nov 2023
Lab Number : **05996835** **Diagnosed** : 03 Nov 2023
Unique Number : 10725195 **Diagnostician** : Wes Davis
Test Package : IND 2

LEPRINO FOODS - ALLENDALE
 4700 RICH STREET
 ALLENDALE, MI
 US 49401
 Contact: BILL FERRIER
 BFERRIER@LEPRINOFOODS.COM
 T:
 F:

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)