




OIL ANALYSIS REPORT

Sample Rating Trend

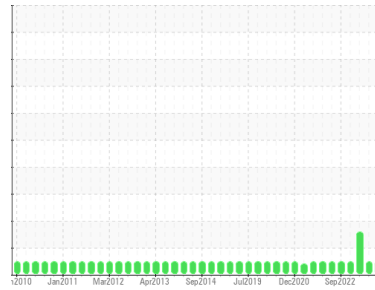

NORMAL



Machine Id
K-1501A Booster Compressor
 Component
Tank Lube System
 Fluid
PHILLIPS 66 Diamond Class® Turbine Oil AW 32 (--- GAL)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

The amount and size of particulates present in the system are acceptable. There is no indication of any contamination in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

| SAMPLE INFORMATION | | method | limit/base | current | history1 | history2 |
|--------------------|-------------|-------------|------------|--------------------|-------------|-------------|
| Sample Number | Client Info | | | HLC0002663 | HLC0002686 | HLC0002292 |
| Sample Date | Client Info | | | 12 Oct 2023 | 10 Jun 2023 | 11 Mar 2023 |
| Machine Age | hrs | Client Info | | 0 | 0 | 0 |
| Oil Age | hrs | Client Info | | 0 | 0 | 0 |
| Oil Changed | Client Info | | | N/A | N/A | N/A |
| Sample Status | | | | NORMAL | NORMAL | ABNORMAL |

| WEAR METALS | | method | limit/base | current | history1 | history2 |
|-------------|-----|-------------|------------|--------------|----------|----------|
| Iron | ppm | ASTM D5185m | >20 | 0 | 0 | 0 |
| Chromium | ppm | ASTM D5185m | >20 | <1 | 0 | 0 |
| Nickel | ppm | ASTM D5185m | >20 | 0 | 0 | 0 |
| Titanium | ppm | ASTM D5185m | | 0 | 0 | <1 |
| Silver | ppm | ASTM D5185m | | 0 | 0 | 0 |
| Aluminum | ppm | ASTM D5185m | >20 | <1 | 1 | 0 |
| Lead | ppm | ASTM D5185m | >20 | <1 | 0 | 0 |
| Copper | ppm | ASTM D5185m | >20 | <1 | 0 | 0 |
| Tin | ppm | ASTM D5185m | >20 | 0 | 0 | 0 |
| Vanadium | ppm | ASTM D5185m | | 0 | 0 | 0 |
| Cadmium | ppm | ASTM D5185m | | 0 | 0 | 0 |

| ADDITIVES | | method | limit/base | current | history1 | history2 |
|------------|-----|-------------|------------|--------------|----------|----------|
| Boron | ppm | ASTM D5185m | | 0 | 0 | 0 |
| Barium | ppm | ASTM D5185m | | 0 | 4 | 0 |
| Molybdenum | ppm | ASTM D5185m | | 0 | 0 | 0 |
| Manganese | ppm | ASTM D5185m | | 0 | 0 | <1 |
| Magnesium | ppm | ASTM D5185m | | <1 | <1 | 1 |
| Calcium | ppm | ASTM D5185m | | <1 | 0 | 0 |
| Phosphorus | ppm | ASTM D5185m | | 0 | 12 | 15 |
| Zinc | ppm | ASTM D5185m | | 0 | 1 | 0 |
| Sulfur | ppm | ASTM D5185m | | 577 | 568 | 302 |


| CONTAMINANTS | | method | limit/base | current | history1 | history2 |
|--------------|-----|-------------|------------|--------------|----------|----------|
| Silicon | ppm | ASTM D5185m | >15 | <1 | 0 | ▲ 30 |
| Sodium | ppm | ASTM D5185m | | 0 | <1 | 0 |
| Potassium | ppm | ASTM D5185m | >20 | 2 | 0 | 0 |

| FLUID CLEANLINESS | | method | limit/base | current | history1 | history2 |
|-------------------|--|--------------|------------|-----------------|----------|----------|
| Particles >4µm | | ASTM D7647 | | 80 | 466 | 1974 |
| Particles >6µm | | ASTM D7647 | >2500 | 27 | 138 | 453 |
| Particles >14µm | | ASTM D7647 | >320 | 6 | 12 | 17 |
| Particles >21µm | | ASTM D7647 | >80 | 1 | 3 | 5 |
| Particles >38µm | | ASTM D7647 | >20 | 0 | 0 | 0 |
| Particles >71µm | | ASTM D7647 | >4 | 0 | 0 | 0 |
| Oil Cleanliness | | ISO 4406 (c) | >--/18/15 | 13/12/10 | 16/14/11 | 18/16/11 |


| FLUID DEGRADATION | | method | limit/base | current | history1 | history2 |
|-------------------|----------|------------|------------|--------------|----------|----------|
| Acid Number (AN) | mg KOH/g | ASTM D8045 | 0.04 | 0.092 | 0.205 | 0.151 |

OIL ANALYSIS REPORT


Particle Trend

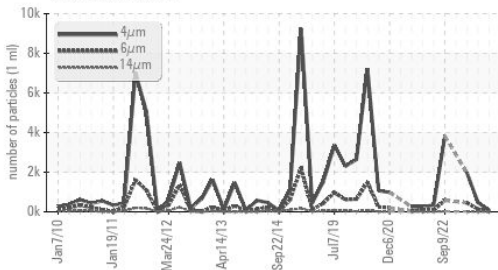


Acid Number

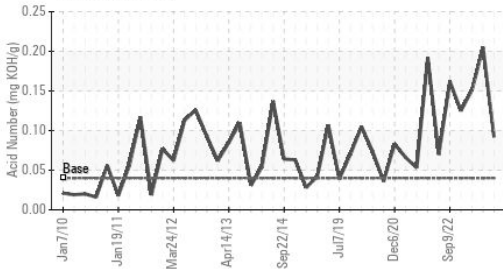

Viscosity @ 40°C

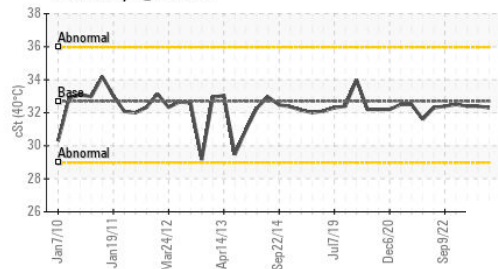


Particle Trend

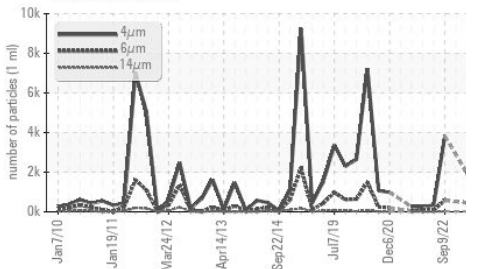

| VISUAL | method | limit/base | current | history1 | history2 |
|------------------|--------|------------|---------|----------|----------|
| White Metal | scalar | *Visual | NONE | NONE | NONE |
| Yellow Metal | scalar | *Visual | NONE | NONE | NONE |
| Precipitate | scalar | *Visual | NONE | NONE | NONE |
| Silt | scalar | *Visual | NONE | NONE | NONE |
| Debris | scalar | *Visual | NONE | NONE | NONE |
| Sand/Dirt | scalar | *Visual | NONE | NONE | NONE |
| Appearance | scalar | *Visual | NORML | NORML | NORML |
| Odor | scalar | *Visual | NORML | NORML | NORML |
| Emulsified Water | scalar | *Visual | >0.05 | NEG | NEG |
| Free Water | scalar | *Visual | | NEG | NEG |


| FLUID PROPERTIES | method | limit/base | current | history1 | history2 | |
|------------------|--------|------------|---------|-------------|----------|------|
| Visc @ 40°C | cSt | ASTM D445 | 32.7 | 32.3 | 32.4 | 32.4 |

| SAMPLE IMAGES | method | limit/base | current | history1 | history2 |
|---------------|--------|------------|---------|----------|----------|
|---------------|--------|------------|---------|----------|----------|

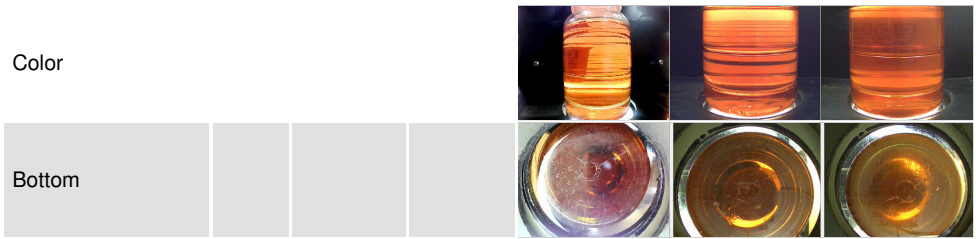


GRAPHS


Ferrous Alloys

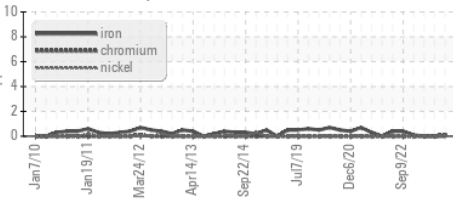


Non-ferrous Metals

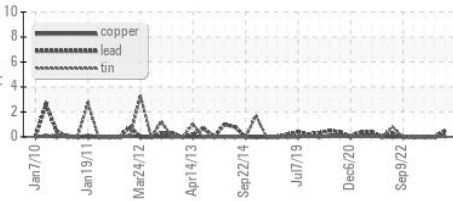


Viscosity @ 40°C

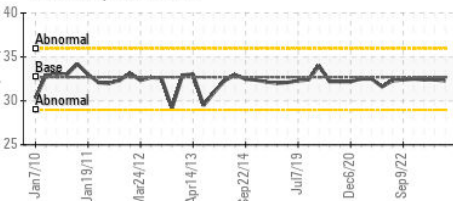

Particle Count

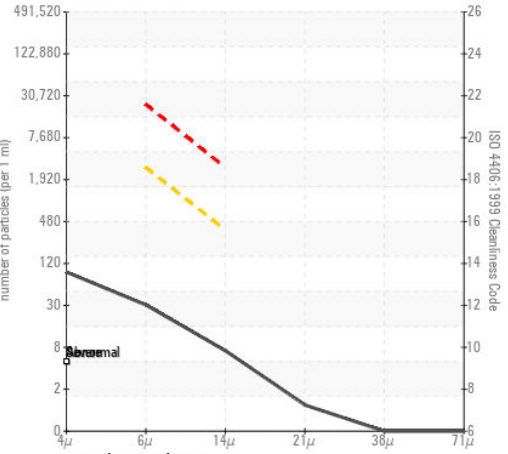

Acid Number

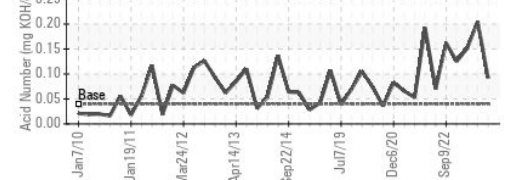

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : HLC0002663 **Received** : 02 Nov 2023
Lab Number : 05997351 **Diagnosed** : 05 Nov 2023
Unique Number : 10725711 **Diagnostician** : Don Baldrige
Test Package : IND 2

HILCORP ALASKA LLC - ENDICOTT
 604 WAREHOUSE ENDICOTT
 PRUDHOE BAY, AK
 US 99734
 Contact: ALASKA NS ENDICOTT MAINT LEAD
 AlaskaNS-Endicott-MaintenanceLeads@hilcorp.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T: x:
 F: x: