

# **OIL ANALYSIS REPORT**

Sample Rating Trend **NORMAL** 

# Machine Id KAESER BSD 50T 7557038 (S/N 1108)

Compressor

KAESER SIGMA (OEM) M-460 (--- GAL)

## Recommendation

Resample at the next service interval to monitor.

All component wear rates are normal.

## Contamination

The amount and size of particulates present in the system are acceptable. There is no indication of any contamination in the oil.

## **Fluid Condition**

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

				Oct2023		
SAMPLE INFORM	IATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KCPA007911		
Sample Date		Client Info		30 Oct 2023		
Machine Age	hrs	Client Info		11982		
Oil Age	hrs	Client Info		0		
Oil Changed		Client Info		N/A		
Sample Status				NORMAL		
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0		
Chromium	ppm	ASTM D5185m	>10	<1		
Nickel	ppm	ASTM D5185m	>3	0		
Titanium	ppm	ASTM D5185m	>3	0		
Silver	ppm	ASTM D5185m	>2	0		
Aluminum	ppm	ASTM D5185m	>10	<1		
Lead	ppm	ASTM D5185m	>10	0		
Copper	ppm	ASTM D5185m	>50	13		
Tin	ppm	ASTM D5185m	>10	0		
Vanadium	ppm	ASTM D5185m		0		
Cadmium	ppm	ASTM D5185m		0		
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0		
Barium	ppm	ASTM D5185m	90	0		
Molybdenum	ppm	ASTM D5185m	0	0		
Manganese	ppm	ASTM D5185m		0		
Magnesium	ppm	ASTM D5185m	100	0		
Calcium	ppm	ASTM D5185m	0	0		
Phosphorus	ppm	ASTM D5185m	0	0		
Zinc	ppm	ASTM D5185m	0	0		
Sulfur	ppm	ASTM D5185m	23500	20733		
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	0		
Sodium	ppm	ASTM D5185m		0		
Potassium	ppm	ASTM D5185m	>20	1		
Water	%	ASTM D6304	>0.05	0.021		
ppm Water	ppm	ASTM D6304	>500	219.9		
FLUID CLEANLIN	ESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		6517		
Particles >6µm		ASTM D7647	>1300	681		
Particles >14μm		ASTM D7647	>80	36		
Particles >21µm		ASTM D7647	>20	10		
Particles >38µm		ASTM D7647	>4	0		
Particles >71µm		ASTM D7647	>3	0		
Oil Cleanliness		ISO 4406 (c)	>/17/13	20/17/12		
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	ma KOH/a	VCTM D001E	1.0	N 42		


Acid Number (AN)

mg KOH/g ASTM D8045 1.0

0.42



## **OIL ANALYSIS REPORT**

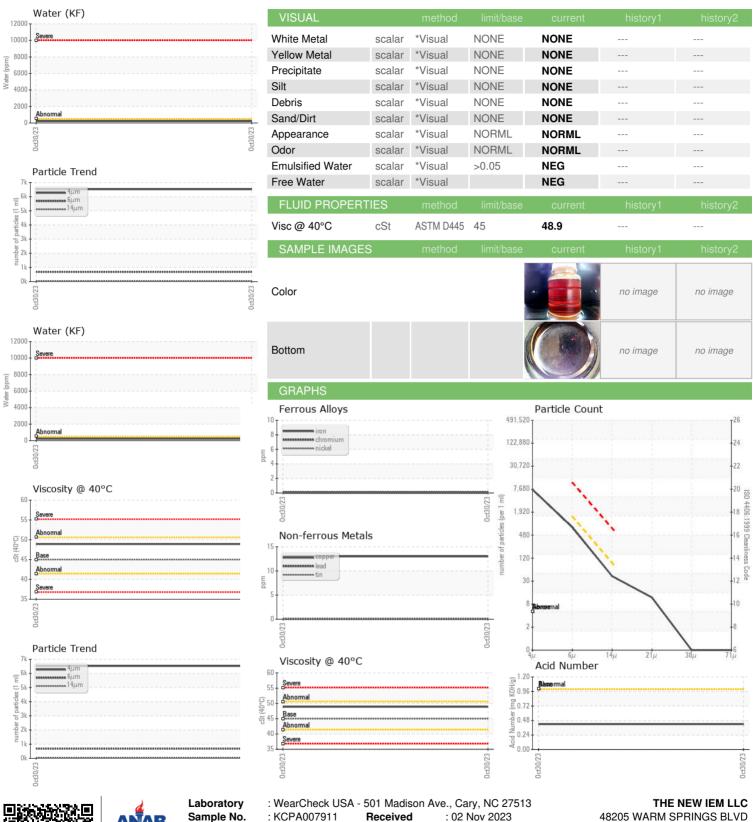



Certificate L2367

Sample No. Lab Number **Unique Number** 

: 05997395

Received : KCPA007911 : 10725755

Diagnosed : 05 Nov 2023 Diagnostician : Don Baldridge

Test Package : IND 2 ( Additional Tests: KF, PrtCount ) To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

48205 WARM SPRINGS BLVD FREMONT, CA

US 94539 Contact: M. BLOSS

mbloss@amada.com

T: F: