




PROBLEM SUMMARY

Sample Rating Trend

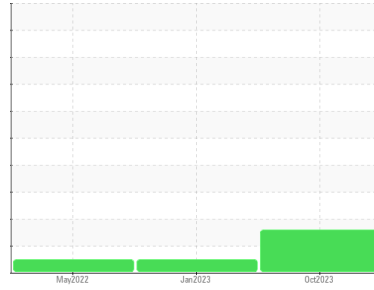


Area
[73454649]
 Machine Id
7252934 (S/N 1142)

Component
Compressor
 Fluid
KAESER SIGMA (OEM) M-460 (--- GAL)

COMPONENT CONDITION SUMMARY

▲ Particle Trend

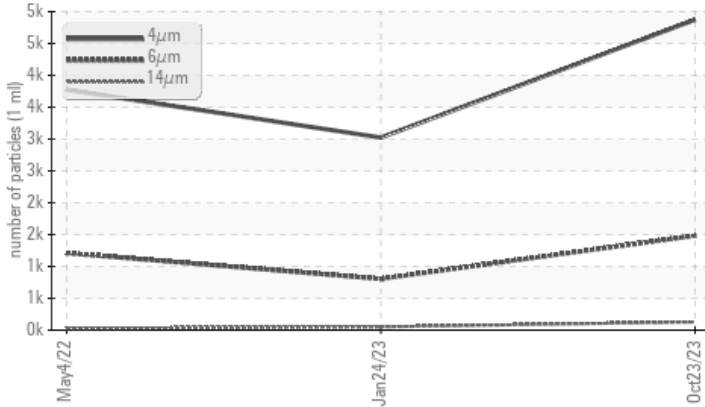

RECOMMENDATION

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

PROBLEMATIC TEST RESULTS

Sample Status	ASTM D7647	ATTENTION	NORMAL	NORMAL
Particles >6µm	>1300	▲ 1481	805	1210
Particles >14µm	>80	▲ 129	51	28
Particles >21µm	>20	▲ 45	13	6
Oil Cleanliness	ISO 4406 (c) >17/13	▲ 18/14	17/13	17/12

Customer Id: APPSANCA
 Sample No.: KCPA007917
 Lab Number: 05997399
 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:
 Don Baldrige +1
don.b505@comcast.net

To change component or sample information:
 Customer Service +1 1-800-237-1369
customerservice@wearcheck.com

RECOMMENDED ACTIONS

There are no recommended actions for this sample.

HISTORICAL DIAGNOSIS

24 Jan 2023 Diag: Jonathan Hester

NORMAL



Resample at the next service interval to monitor. All component wear rates are normal. The amount and size of particulates present in the system are acceptable. There is no indication of any contamination in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



04 May 2022 Diag: Don Baldrige

NORMAL




Resample at the next service interval to monitor. All component wear rates are normal. The amount and size of particulates present in the system are acceptable. There is no indication of any contamination in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



OIL ANALYSIS REPORT

Sample Rating Trend

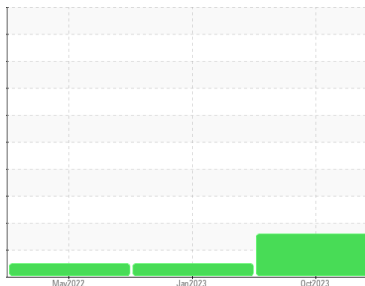

ISO



Area
[73454649]
Machine Id
7252934 (S/N 1142)

Component
Compressor
Fluid
KAESER SIGMA (OEM) M-460 (--- GAL)

DIAGNOSIS

Recommendation

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a moderate amount of particulates present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	KCPA007917	KCP54362	KCP45483
Sample Date	Client Info	23 Oct 2023	24 Jan 2023	04 May 2022
Machine Age	hrs	9798	6600	3337
Oil Age	hrs	0	3000	3500
Oil Changed	Client Info	N/A	Changed	Changed
Sample Status		ATTENTION	NORMAL	NORMAL

WEAR METALS

method	limit/base	current	history1	history2
Iron ppm	ASTM D5185m >50	0	<1	<1
Chromium ppm	ASTM D5185m >10	<1	0	0
Nickel ppm	ASTM D5185m >3	0	<1	0
Titanium ppm	ASTM D5185m >3	0	0	0
Silver ppm	ASTM D5185m >2	0	0	0
Aluminum ppm	ASTM D5185m >10	<1	4	1
Lead ppm	ASTM D5185m >10	0	0	0
Copper ppm	ASTM D5185m >50	7	5	8
Tin ppm	ASTM D5185m >10	0	0	0
Vanadium ppm	ASTM D5185m	0	0	0
Cadmium ppm	ASTM D5185m	0	0	0

ADDITIVES

method	limit/base	current	history1	history2
Boron ppm	ASTM D5185m 0	0	0	0
Barium ppm	ASTM D5185m 90	0	0	0
Molybdenum ppm	ASTM D5185m 0	0	0	0
Manganese ppm	ASTM D5185m	0	0	<1
Magnesium ppm	ASTM D5185m 100	1	<1	6
Calcium ppm	ASTM D5185m 0	0	0	0
Phosphorus ppm	ASTM D5185m 0	0	13	0
Zinc ppm	ASTM D5185m 0	56	82	88
Sulfur ppm	ASTM D5185m 23500	22045	22349	17050

CONTAMINANTS

method	limit/base	current	history1	history2
Silicon ppm	ASTM D5185m >25	<1	<1	<1
Sodium ppm	ASTM D5185m	0	2	<1
Potassium ppm	ASTM D5185m >20	2	<1	4
Water %	ASTM D6304 >0.05	0.011	0.010	0.010
ppm Water ppm	ASTM D6304 >500	110.3	107.5	102.1






FLUID CLEANLINESS

method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	4874	3023	3774
Particles >6µm	ASTM D7647 >1300	▲ 1481	805	1210
Particles >14µm	ASTM D7647 >80	▲ 129	51	28
Particles >21µm	ASTM D7647 >20	▲ 45	13	6
Particles >38µm	ASTM D7647 >4	3	0	0
Particles >71µm	ASTM D7647 >3	0	0	0
Oil Cleanliness	ISO 4406 (c) >17/13	▲ 18/14	17/13	17/12

FLUID DEGRADATION

method	limit/base	current	history1	history2
Acid Number (AN) mg KOH/g	ASTM D8045 1.0	0.42	0.46	0.45


OIL ANALYSIS REPORT

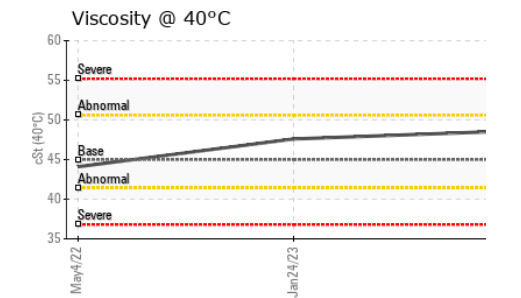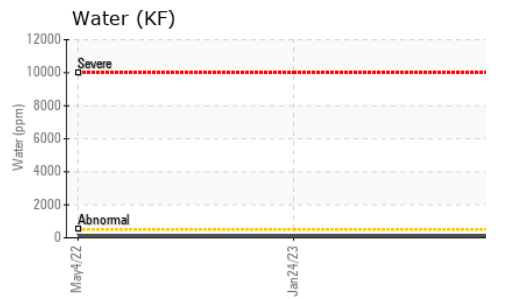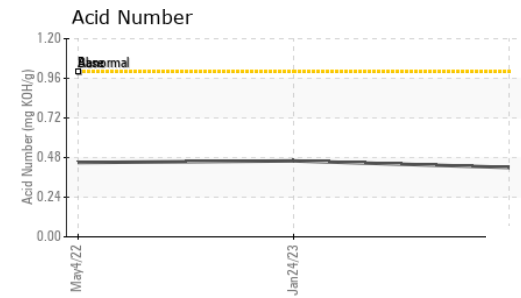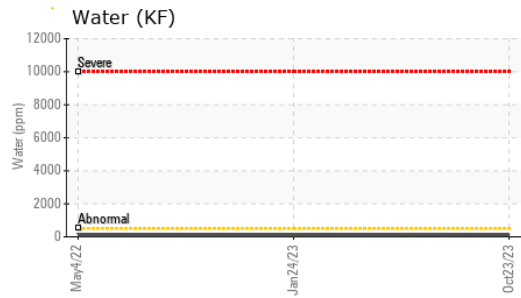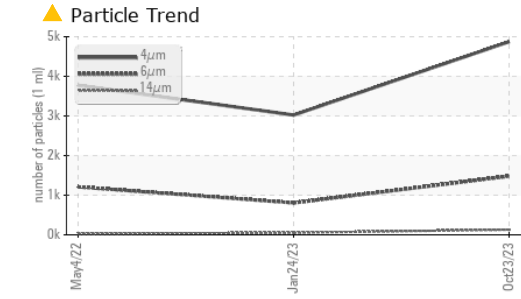





VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 45	48.6	47.6	44.1

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

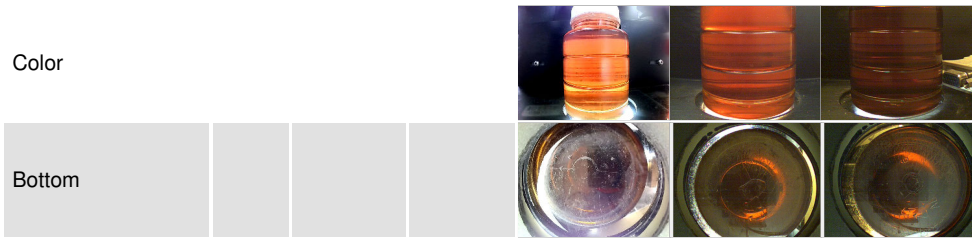

GRAPHS

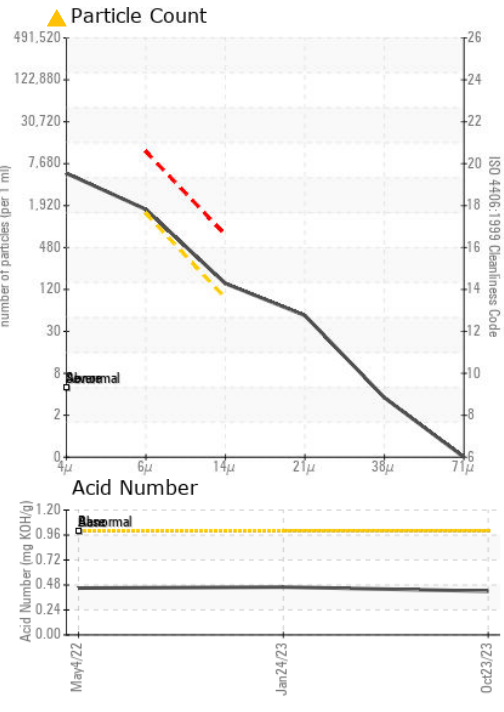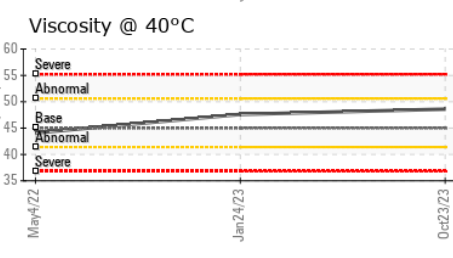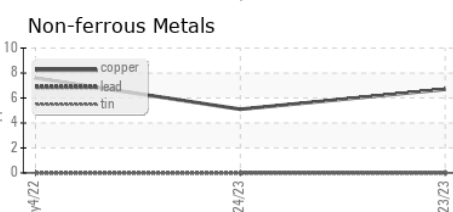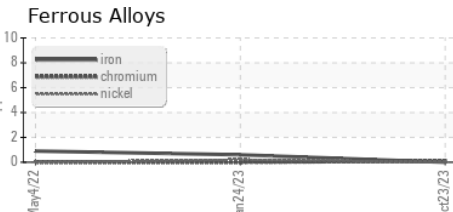

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : KCPA007917 **Received** : 02 Nov 2023
Lab Number : 05997399 **Diagnosed** : 05 Nov 2023
Unique Number : 10725759 **Diagnostician** : Don Baldrige
Test Package : IND 2 (Additional Tests: KF, PrtCount)

APPLIED FUSION - IMG COMPANIES
 1915 REPUBLIC AVE
 SAN LEANDRO, CA
 US 94577
 Contact: N. CHISOM
 nchisom@ichovsystems.com
 T:
 F:

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)