




KAESER 6849736

Compressor Fluid KAESER SIGMA (OEM) M-460 (--- QTS)

COMPONENT CONDITION SUMMARY

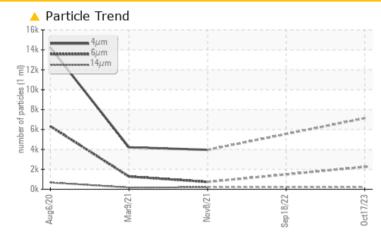

RECOMMENDATION

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

PROBLEMATIC TEST RESULTS Sample Status ABNORMAL ABNORMAL ABNORMAL Particles >6µm ASTM D7647 >1300 2251 737 Particles >14µm ASTM D7647 >80 **2**00 ASTM D7647 >20 Particles >21µm 49 **1**28 **Oil Cleanliness** ISO 4406 (c) >--/17/13 A 20/18/15 ▲ 17/15


Customer Id: PENEAU Sample No.: KCPA007254 Lab Number: 05997413 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data: Don Baldridge +1 don.b505@comcast.net

To change component or sample information: Customer Service +1 1-800-237-1369 customerservice@wearcheck.com

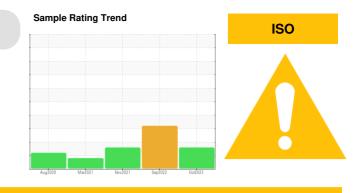

RECOMMENDED ACTIONS

There are no recommended actions for this sample.

HISTORICAL DIAGNOSIS

18 Sep 2022 Diag: Don Baldridge

WATER



There is too much water present in this sample to perform a particle count. We advise that you stop the unit and follow the water drain-off procedure for this component. We recommend an early resample in 500 hours to monitor this condition.All component wear rates are normal. There is a light concentration of water present in the oil. Free water present. The AN level is acceptable for this fluid.



view report

08 Nov 2021 Diag: Don Baldridge

o NOV 2021 Diag. Don Baldridge

No corrective action is recommended at this time. Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.All component wear rates are normal. There is a high amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.




09 Mar 2021 Diag: Angela Borella

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.All component wear rates are normal. There is a high amount of silt (particulates < 14 microns in size) present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.





OIL ANALYSIS REPORT

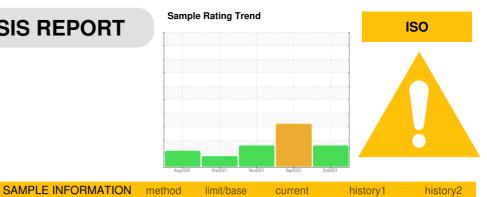

Machine Id **KAESER 6849736** Component

Compressor Fluid KAESER SIGMA (OEM) M-460 (--- QTS)

DIAGNOSIS

Recommendation

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a high amount of particulates present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

	ATION	method	IIIIII/Dase	current	history i	TIIStory2
Sample Number		Client Info		KCPA007254	KCP49109	KCP39747
Sample Date		Client Info		17 Oct 2023	18 Sep 2022	08 Nov 2021
Machine Age	hrs	Client Info		5688	4923	4291
Oil Age	hrs	Client Info		0	700	1689
Oil Changed		Client Info		N/A	Not Changd	Changed
Sample Status				ABNORMAL	ABNORMAL	ABNORMAL
		and the state	1			history O
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0	<1	0
Chromium	ppm	ASTM D5185m	>10	<1	0	0
Nickel	ppm	ASTM D5185m	>3	0	0	0
Titanium	ppm	ASTM D5185m	>3	0	0	0
Silver	ppm	ASTM D5185m	>2	0	0	<1
Aluminum	ppm	ASTM D5185m	>10	<1	<1	0
Lead	ppm	ASTM D5185m	>10	0	<1	0
Copper	ppm	ASTM D5185m	>50	34	16	15
Tin	ppm	ASTM D5185m	>10	0	0	0
Antimony	ppm	ASTM D5185m				0
Vanadium	ppm	ASTM D5185m		0	0	0
Cadmium	ppm	ASTM D5185m		0	0	0
ADDITIVES			11	-		
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	<1
Barium	ppm	ASTM D5185m	90	0	0	0
Molybdenum	ppm	ASTM D5185m	0	0	0	0
Manganese	ppm	ASTM D5185m		0	0	0
Magnesium	ppm	ASTM D5185m	100	<1	6	8
Calcium	ppm	ASTM D5185m	0	0	<1	0
Phosphorus	ppm	ASTM D5185m	0	0	10	0
Zinc	ppm	ASTM D5185m	0	28	45	40
Sulfur	ppm	ASTM D5185m	23500	20971	20686	16754
CONTAMINANTS	;	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<1	<1	<1
Sodium	ppm	ASTM D5185m	- 10	0	2	0
Potassium	ppm	ASTM D5185m	>20	2	0	<1
Water	%	ASTM D6304		- 0.010	▲ 0.229	0.014
ppm Water	ppm	ASTM D6304		102.7	▲ 2290	140.8
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		7140		3961
Particles >6µm		ASTM D7647	>1300	<u> </u>		737
Particles >14µm		ASTM D7647	>80	A 193		<u> </u>
Particles >21µm		ASTM D7647	>20	<u> </u>		1 28
Particles >38µm		ASTM D7647	>4	1		4 6
Particles >71µm		ASTM D7647	>3	0		 11
Oil Cleanliness		ISO 4406 (c)	>/17/13	A 20/18/15		▲ 17/15
FLUID DEGRADA		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	1.0	0.32	0.38	0.502
:36:06) Bev: 1 Contact/Location: Service Manager - PENEA						

Report Id: PENEAU [WUSCAR] 05997413 (Generated: 11/05/2023 10:36:06) Rev: 1


Contact/Location: Service Manager - PENEAU


E F COMPRESSORS Built for a lifetime.


16k 144 Ē 12k

number of particles (1 n 9 k 9 k 9 k 9 k

21 0






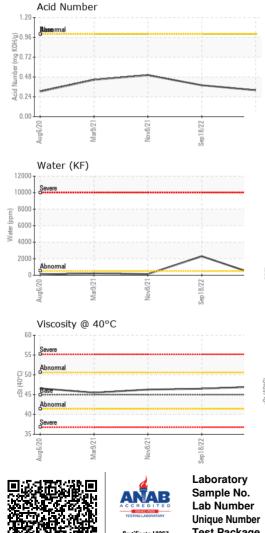

OIL ANALYSIS REPORT

VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	LIGHT	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	▲ 0.2%	NEG
Free Water	scalar	*Visual		NEG	1 .0	NEG
FLUID PROPERT	IES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	45	47.0	46.5	46.28
SAMPLE IMAGES		method	limit/base	current	history1	history2
Color						
Bottom						

Bottom

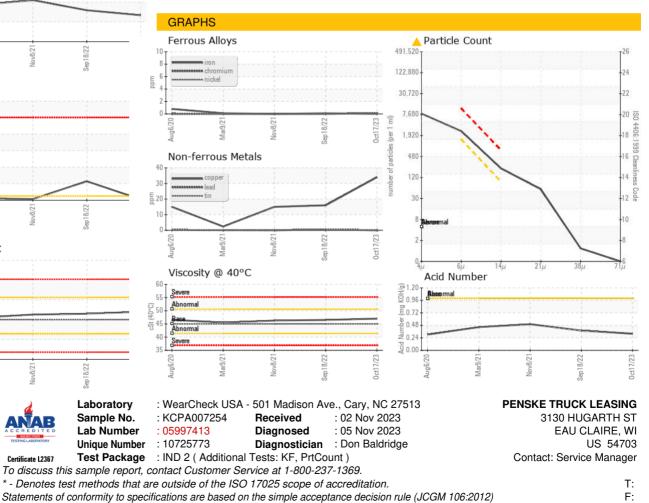

Contact/Location: Service Manager - PENEAU