


OIL ANALYSIS REPORT

Sample Rating Trend



NORMAL

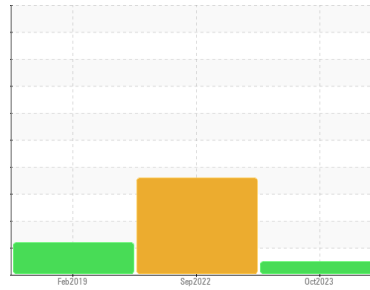

Machine Id
KAESER SM 10 2762395 (S/N 1076)

Component
Compressor

Fluid
KAESER SIGMA (OEM) S-460 (--- GAL)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

The amount and size of particulates present in the system are acceptable. There is no indication of any contamination in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	KCPA007436	KCP49271	KCP00241
Sample Date	Client Info	09 Oct 2023	02 Sep 2022	18 Feb 2019
Machine Age	hrs	35174	31217	25570
Oil Age	hrs	0	5607	700
Oil Changed	Client Info	N/A	Changed	Changed
Sample Status		NORMAL	ABNORMAL	ATTENTION

WEAR METALS

method	limit/base	current	history1	history2	
Iron	ppm	ASTM D5185m >50	0	0	<1
Chromium	ppm	ASTM D5185m >10	0	0	0
Nickel	ppm	ASTM D5185m >3	0	0	<1
Titanium	ppm	ASTM D5185m >3	0	0	0
Silver	ppm	ASTM D5185m >2	0	0	0
Aluminum	ppm	ASTM D5185m >10	0	<1	0
Lead	ppm	ASTM D5185m >10	0	0	0
Copper	ppm	ASTM D5185m >50	3	4	2
Tin	ppm	ASTM D5185m >10	<1	0	<1
Antimony	ppm	ASTM D5185m	---	---	0
Vanadium	ppm	ASTM D5185m	0	0	0
Cadmium	ppm	ASTM D5185m	0	0	0

ADDITIVES

method	limit/base	current	history1	history2	
Boron	ppm	ASTM D5185m	0	0	<1
Barium	ppm	ASTM D5185m 90	49	0	9
Molybdenum	ppm	ASTM D5185m	0	0	<1
Manganese	ppm	ASTM D5185m	<1	0	<1
Magnesium	ppm	ASTM D5185m 90	77	61	66
Calcium	ppm	ASTM D5185m 2	4	0	<1
Phosphorus	ppm	ASTM D5185m	1	<1	<1
Zinc	ppm	ASTM D5185m	4	7	26
Sulfur	ppm	ASTM D5185m	17414	19896	19130

CONTAMINANTS

method	limit/base	current	history1	history2	
Silicon	ppm	ASTM D5185m >25	<1	<1	0
Sodium	ppm	ASTM D5185m	19	19	11
Potassium	ppm	ASTM D5185m >20	2	2	2
Water	%	ASTM D6304 >0.05	0.022	▲ 0.064	0.021
ppm Water	ppm	ASTM D6304 >500	227.9	▲ 645.3	210






FLUID CLEANLINESS

method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	1448	44414	5063
Particles >6µm	ASTM D7647 >1300	419	▲ 10497	▲ 1398
Particles >14µm	ASTM D7647 >80	44	▲ 936	▲ 125
Particles >21µm	ASTM D7647 >20	13	▲ 219	▲ 41
Particles >38µm	ASTM D7647 >4	0	▲ 17	3
Particles >71µm	ASTM D7647 >3	0	1	0
Oil Cleanliness	ISO 4406 (c) >--/17/13	18/16/13	▲ 23/21/17	▲ 18/14

FLUID DEGRADATION

method	limit/base	current	history1	history2	
Acid Number (AN)	mg KOH/g	ASTM D8045 0.4	0.31	0.40	0.328


OIL ANALYSIS REPORT

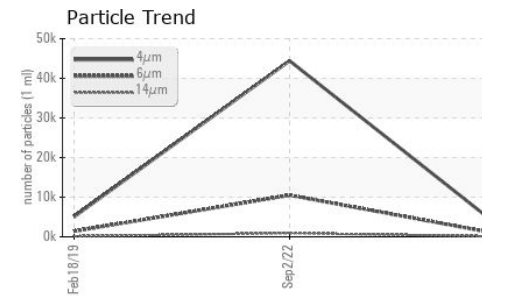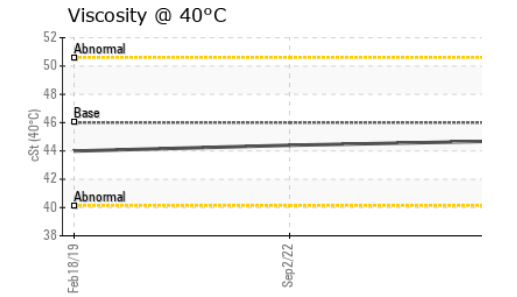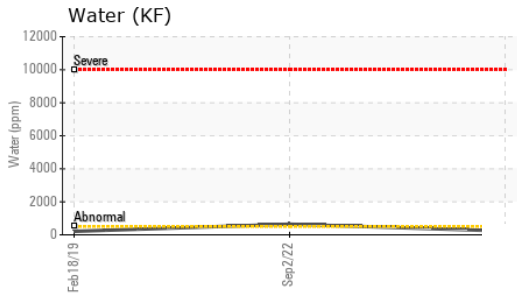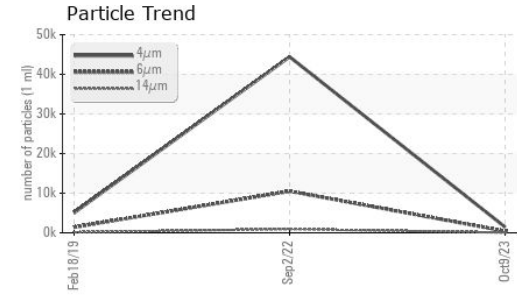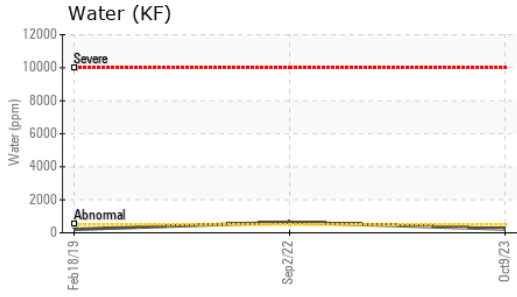






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	LIGHT
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 46	44.7	44.4	43.99

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

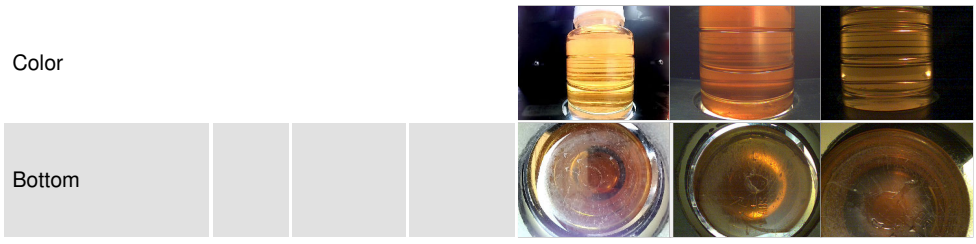

GRAPHS

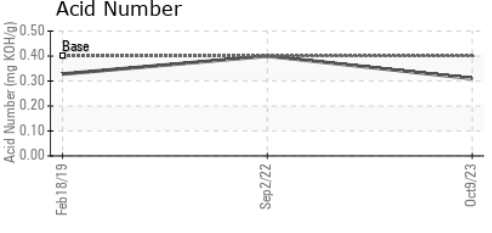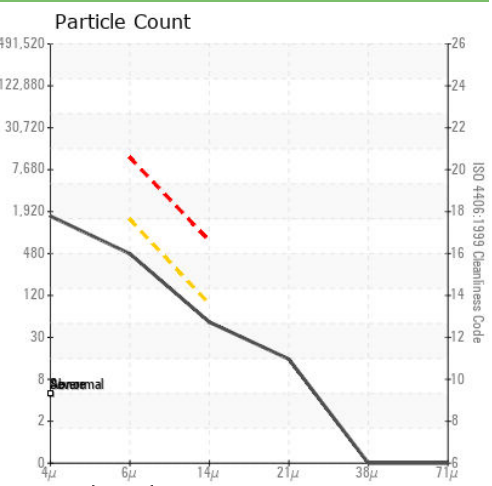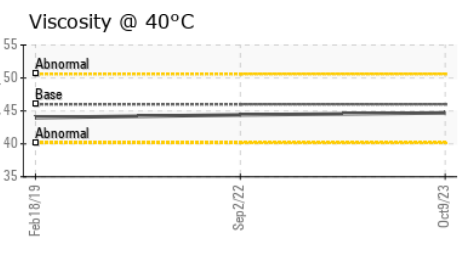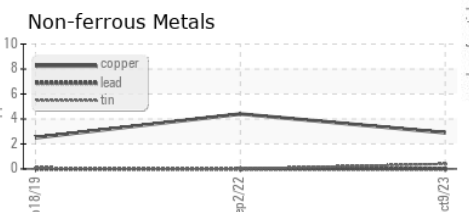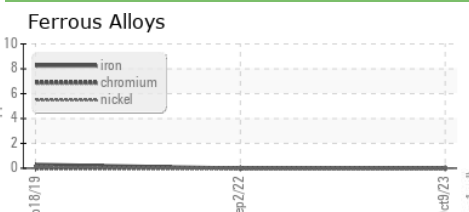

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : KCPA007436 **Received** : 03 Nov 2023
Lab Number : 05997969 **Diagnosed** : 06 Nov 2023
Unique Number : 10726329 **Diagnostician** : Don Baldrige
Test Package : IND 2 (Additional Tests: KF, PrtCount)

LEXUS OF LOUISVILLE
 2400 BLANKENBAKER AVE
 LOUISVILLE, KY
 US 40299
 Contact: Service Manager

Certificate L2367
 To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:
F: