


OIL ANALYSIS REPORT

Sample Rating Trend



NORMAL

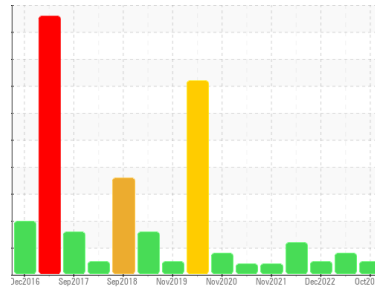

Machine Id
KAESER SX 7.5 5683159 (S/N 1382)

Component
Compressor

Fluid
KAESER SIGMA (OEM) S-460 (--- GAL)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

The amount and size of particulates present in the system are acceptable. There is no indication of any contamination in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		KCPA007864	KCPA004853	KCP55687
Sample Date	Client Info		16 Oct 2023	17 Jul 2023	08 Dec 2022
Machine Age	hrs	Client Info	7137	6796	6083
Oil Age	hrs	Client Info	0	0	1654
Oil Changed	Client Info		N/A	N/A	Not Changd
Sample Status			NORMAL	ATTENTION	NORMAL

WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >50	0	0	<1
Chromium	ppm	ASTM D5185m >10	0	0	0
Nickel	ppm	ASTM D5185m >3	0	0	0
Titanium	ppm	ASTM D5185m >3	0	0	0
Silver	ppm	ASTM D5185m >2	0	0	0
Aluminum	ppm	ASTM D5185m >10	0	<1	0
Lead	ppm	ASTM D5185m >10	0	0	<1
Copper	ppm	ASTM D5185m >50	0	<1	1
Tin	ppm	ASTM D5185m >10	<1	0	0
Vanadium	ppm	ASTM D5185m	0	<1	0
Cadmium	ppm	ASTM D5185m	0	0	0

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0	0
Barium	ppm	ASTM D5185m 90	58	30	23
Molybdenum	ppm	ASTM D5185m	0	0	0
Manganese	ppm	ASTM D5185m	<1	<1	0
Magnesium	ppm	ASTM D5185m 90	75	86	69
Calcium	ppm	ASTM D5185m 2	3	0	1
Phosphorus	ppm	ASTM D5185m	1	2	4
Zinc	ppm	ASTM D5185m	2	0	6
Sulfur	ppm	ASTM D5185m	17015	20280	17869

CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >25	<1	<1	<1
Sodium	ppm	ASTM D5185m	10	15	12
Potassium	ppm	ASTM D5185m >20	<1	<1	2
Water	%	ASTM D6304 >0.05	0.019	0.022	0.015
ppm Water	ppm	ASTM D6304 >500	191.5	223.7	155.5






FLUID CLEANLINESS

	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647		882	3992	2381
Particles >6µm	ASTM D7647 >1300		257	▲ 1871	907
Particles >14µm	ASTM D7647 >80		24	66	33
Particles >21µm	ASTM D7647 >20		6	12	7
Particles >38µm	ASTM D7647 >4		0	0	1
Particles >71µm	ASTM D7647 >3		0	0	1
Oil Cleanliness	ISO 4406 (c) >17/13		15/12	▲ 18/13	17/12

FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045 0.4	0.32	0.32	0.28


OIL ANALYSIS REPORT

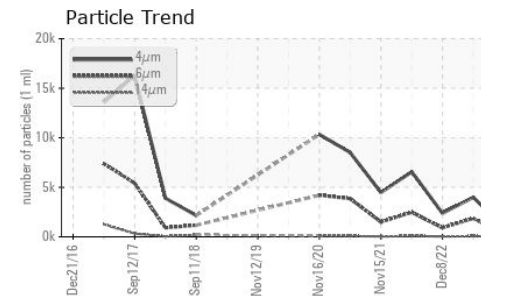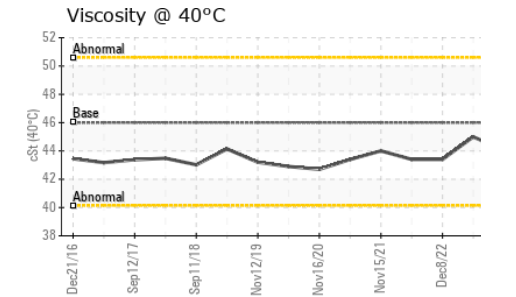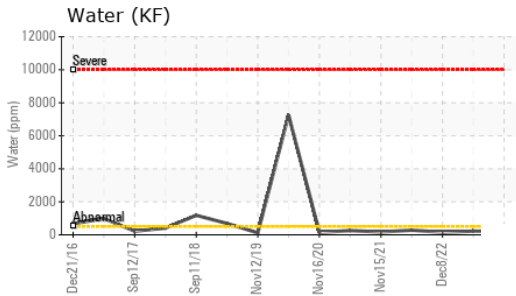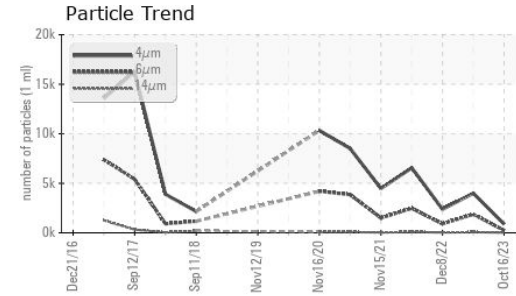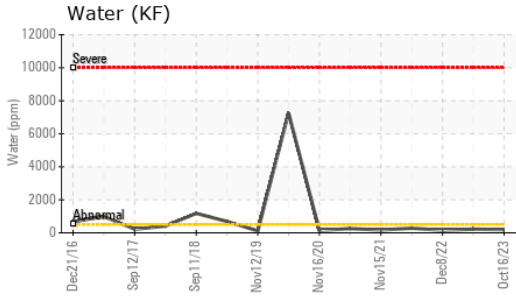






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	LIGHT
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	46	44.0	45.0

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

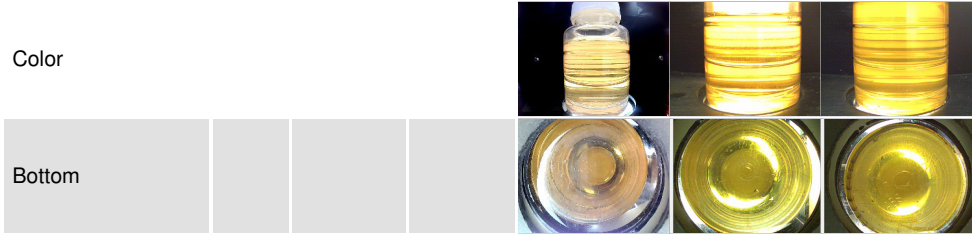

GRAPHS

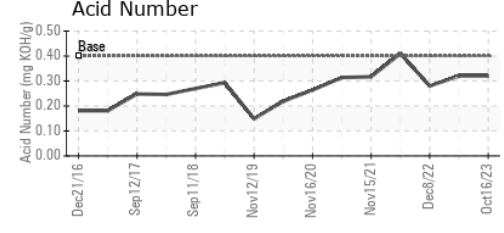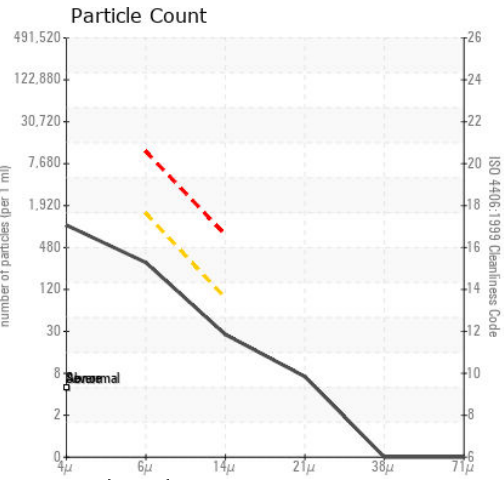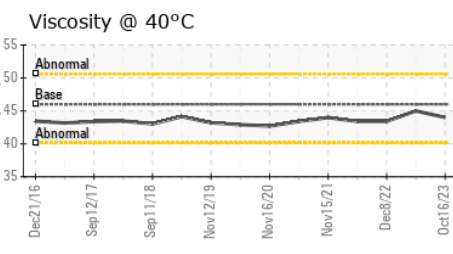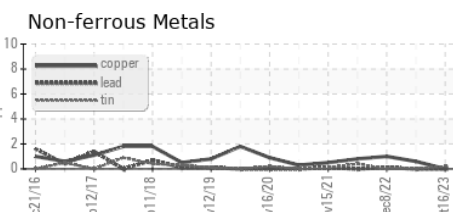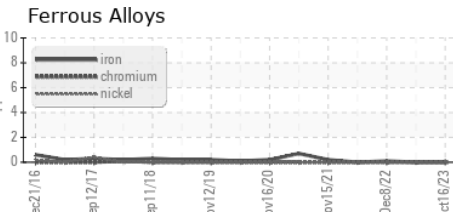

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : KCPA007864 **Received** : 03 Nov 2023
Lab Number : 05997970 **Diagnosed** : 06 Nov 2023
Unique Number : 10726330 **Diagnostician** : Don Baldrige
Test Package : IND 2 (Additional Tests: KF, PrtCount)

OXMOOR MAZDA
 7913 SHELBYVILLE RD
 LOUISVILLE, KY
 US 40222
 Contact:

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:
F: