





OIL ANALYSIS REPORT

Sample Rating Trend

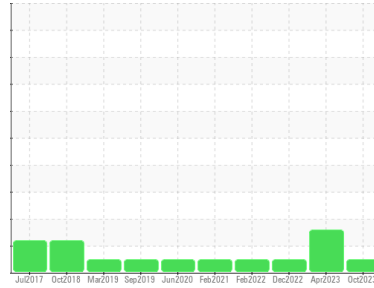

Machine Id
KAESER AS 31 1128909 (S/N 1130)

Component
Compressor
Fluid
KAESER SIGMA (OEM) S-460 (--- QTS)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	KCPA004556	KCPA002588	KCP49876
Sample Date	Client Info	23 Oct 2023	19 Apr 2023	19 Dec 2022
Machine Age	hrs	48848	46849	45609
Oil Age	hrs	0	0	6672
Oil Changed	Client Info	N/A	N/A	Changed
Sample Status		NORMAL	ATTENTION	NORMAL

WEAR METALS

method	limit/base	current	history1	history2	
Iron	ppm	ASTM D5185m >50	0	<1	2
Chromium	ppm	ASTM D5185m >10	0	0	0
Nickel	ppm	ASTM D5185m >3	0	0	0
Titanium	ppm	ASTM D5185m >3	0	0	0
Silver	ppm	ASTM D5185m >2	0	0	0
Aluminum	ppm	ASTM D5185m >10	0	<1	0
Lead	ppm	ASTM D5185m >10	<1	0	0
Copper	ppm	ASTM D5185m >50	<1	2	3
Tin	ppm	ASTM D5185m >10	<1	0	0
Antimony	ppm	ASTM D5185m	---	---	---
Vanadium	ppm	ASTM D5185m	0	0	0
Cadmium	ppm	ASTM D5185m	0	0	0

ADDITIVES

method	limit/base	current	history1	history2	
Boron	ppm	ASTM D5185m	0	0	0
Barium	ppm	ASTM D5185m 90	8	54	0
Molybdenum	ppm	ASTM D5185m	0	0	0
Manganese	ppm	ASTM D5185m	<1	<1	<1
Magnesium	ppm	ASTM D5185m 90	51	75	31
Calcium	ppm	ASTM D5185m 2	2	3	0
Phosphorus	ppm	ASTM D5185m	1	<1	5
Zinc	ppm	ASTM D5185m	5	6	0
Sulfur	ppm	ASTM D5185m	17170	21613	19627

CONTAMINANTS

method	limit/base	current	history1	history2	
Silicon	ppm	ASTM D5185m >25	0	0	<1
Sodium	ppm	ASTM D5185m	22	26	11
Potassium	ppm	ASTM D5185m >20	2	2	<1
Water	%	ASTM D6304 >0.05	0.022	0.019	0.017
ppm Water	ppm	ASTM D6304 >500	225.3	192.3	177.8






FLUID CLEANLINESS

method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	1729	9809	2306
Particles >6µm	ASTM D7647 >1300	279	▲ 1931	295
Particles >14µm	ASTM D7647 >80	27	▲ 124	8
Particles >21µm	ASTM D7647 >20	8	▲ 28	2
Particles >38µm	ASTM D7647 >4	0	4	1
Particles >71µm	ASTM D7647 >3	0	0	0
Oil Cleanliness	ISO 4406 (c) >--/17/13	18/15/12	▲ 20/18/14	18/15/10

FLUID DEGRADATION

method	limit/base	current	history1	history2	
Acid Number (AN)	mg KOH/g	ASTM D8045 0.4	0.32	0.32	0.38


OIL ANALYSIS REPORT

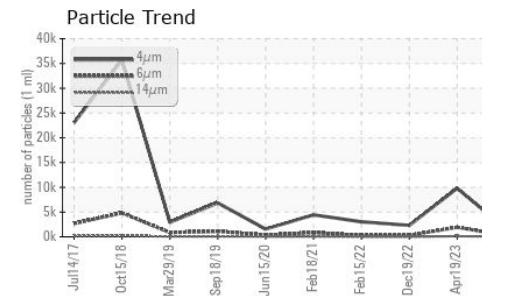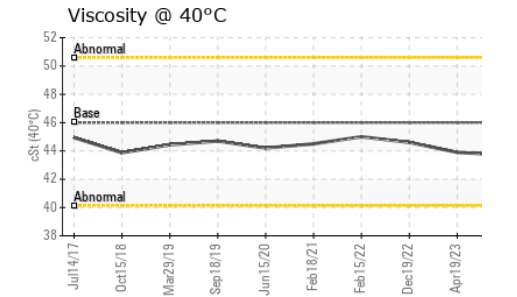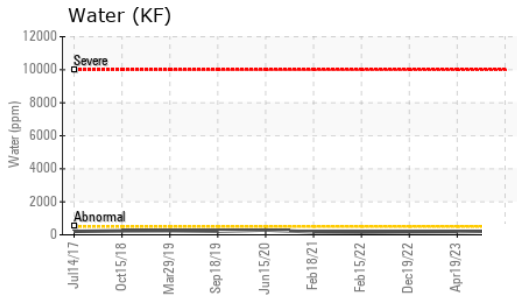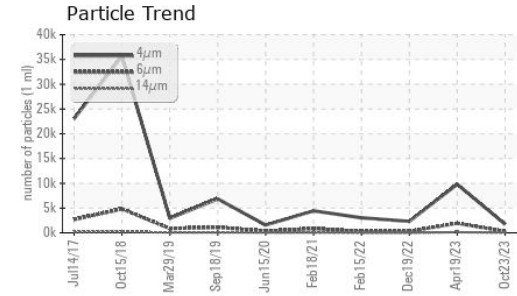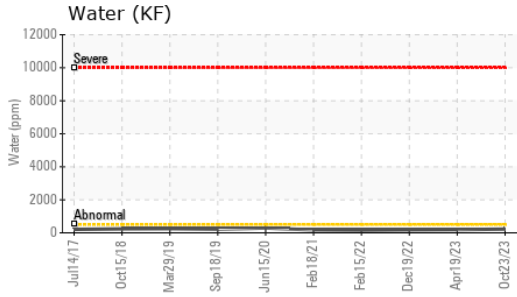






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	LIGHT	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 46	43.7	43.9	44.6

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

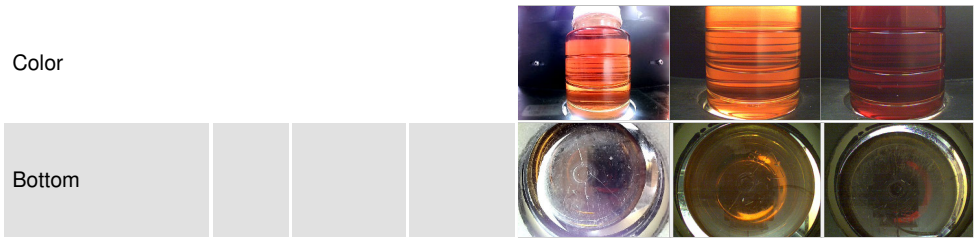

GRAPHS

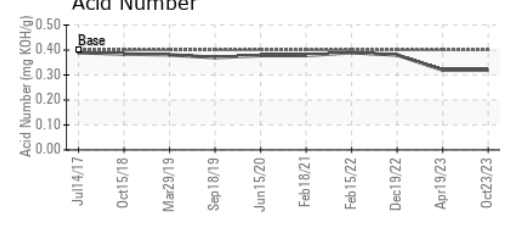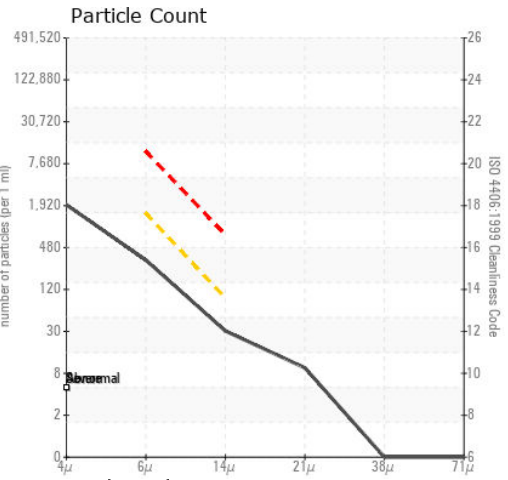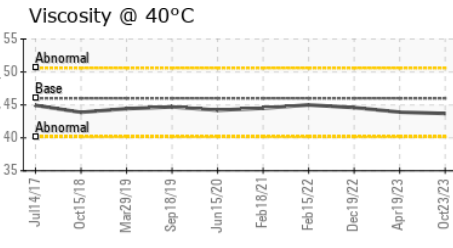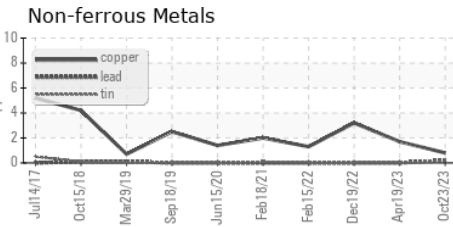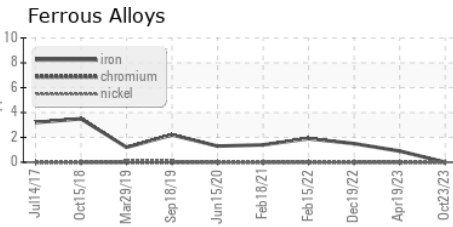

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : KCPA004556 **Received** : 03 Nov 2023
Lab Number : 05997973 **Diagnosed** : 06 Nov 2023
Unique Number : 10726333 **Diagnostician** : Don Baldrige
Test Package : IND 2 (Additional Tests: KF, PrtCount)

CENTRAL BAPTIST HOSPITAL
 1740 NICHOLASVILLE RD
 LEXINGTON, KY
 US 40503
 Contact: R. MOSER
 rmoser@bhsi.com
 T:
 F:

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)