


OIL ANALYSIS REPORT



NORMAL



8433942 (S/N 1932)

Component

Compressor

KAESER SIGMA (OEM) S-460 (--- GAL)

Recommendation

Resample at the next service interval to monitor.

All component wear rates are normal.

Contamination

The amount and size of particulates present in the system are acceptable. There is no indication of any contamination in the oil.


Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

			Nov2022	0et2023		
SAMPLE INFORM	MATION	method	limit/base		hiotory1	history2
	IATION		iiiiii/base	current	history1	nistoryz
Sample Number		Client Info		KC125947	KC106696	
Sample Date	,	Client Info		27 Oct 2023	17 Nov 2022	
Machine Age	hrs	Client Info		7042	2898	
Oil Age	hrs	Client Info		0	2898	
Oil Changed		Client Info		N/A	Not Changd	
Sample Status				NORMAL	ABNORMAL	
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0	<1	
Chromium	ppm	ASTM D5185m	>10	0	0	
Nickel	ppm	ASTM D5185m	>3	0	5	
Titanium	ppm	ASTM D5185m		0	0	
Silver	ppm	ASTM D5185m	>2	0	<1	
Aluminum	ppm	ASTM D5185m	>10	0	2	
Lead	ppm	ASTM D5185m	>10	0	3	
Copper	ppm	ASTM D5185m	>50	<1	6	
Tin	ppm	ASTM D5185m	>10	<1	<1	
Vanadium	ppm	ASTM D5185m		0	<1	
Cadmium	ppm	ASTM D5185m		0	0	
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	
Barium	ppm	ASTM D5185m	90	72	<1	
Molybdenum	ppm	ASTM D5185m		0	<1	
Manganese	ppm	ASTM D5185m		0	0	
Magnesium	ppm	ASTM D5185m	90	69	6	
Calcium	ppm	ASTM D5185m	2	4	2	
Phosphorus	ppm	ASTM D5185m		46	271	
Zinc	ppm	ASTM D5185m		55	321	
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	0	2	
Sodium	ppm	ASTM D5185m		5	4	
Potassium	ppm	ASTM D5185m	>20	0	4	
Water	%	ASTM D6304	>0.05	0.013	0.004	
ppm Water	ppm	ASTM D6304	>500	131.5	46.6	
FLUID CLEANLIN	ESS _	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		3468	14200	
Particles >6µm		ASTM D7647	>1300	1072	△ 4369	
Particles >14µm		ASTM D7647	>80	59	<u>417</u>	
Particles >21µm		ASTM D7647	>20	12	<u></u> 108	
Particles >38μm		ASTM D7647	>4	1	<u> </u>	
Particles >71µm		ASTM D7647	>3	0	2	
Oil Cleanliness		ISO 4406 (c)	>/17/13	19/17/13	△ 21/19/16	
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.4	0.32	0.60	



OIL ANALYSIS REPORT

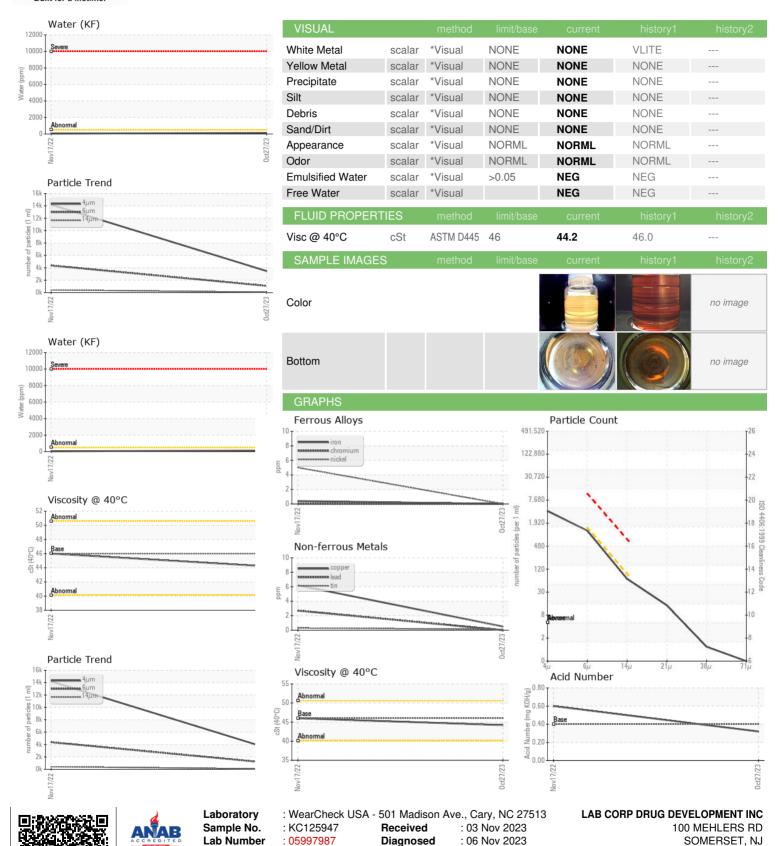

Certificate L2367

Unique Number

Test Package

: 10726347

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

: IND 2

: Don Baldridge

Diagnostician

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

US 08873

T: F:

Contact: Service Manager