




PROBLEM SUMMARY

Sample Rating Trend

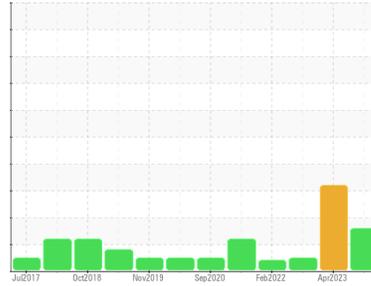

WATER



Machine Id
KAESER SM 11 2004622 (S/N 1545)

Component
Compressor

Fluid
KAESER SIGMA (OEM) S-460 (--- QTS)

COMPONENT CONDITION SUMMARY

No relevant graphs to display

RECOMMENDATION

There is too much water present in this sample to perform a particle count. We advise that you stop the unit and follow the water drain-off procedure for this component. We recommend an early resample in 500 hours to monitor this condition.

PROBLEMATIC TEST RESULTS

Sample Status			ATTENTION	ABNORMAL	NORMAL
Free Water	scalar	*Visual	▲ 10.0	▲ 1.0	NEG

Customer Id: CENLEXY
Sample No.: KCPA004552
Lab Number: 05997990
Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:
Don Baldrige +1
don.b505@comcast.net

To change component or sample information:
Customer Service +1 1-800-237-1369
customerservice@wearcheck.com

RECOMMENDED ACTIONS

There are no recommended actions for this sample.

HISTORICAL DIAGNOSIS

19 Apr 2023 Diag: Angela Borella

WATER



The filter change at the time of sampling has been noted. We advise that you stop the unit and follow the water drain-off procedure for this component. We recommend an early resample in 500 hours to monitor this condition. All component wear rates are normal. There is a light concentration of water present in the oil. Free water present. The amount and size of particulates present in the system are acceptable. The AN level is acceptable for this fluid. The condition of the oil is acceptable for the time in service.

view report



12 Sep 2022 Diag: Angela Borella

NORMAL



Resample at the next service interval to monitor. All component wear rates are normal. The amount and size of particulates present in the system are acceptable. There is no indication of any contamination in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



15 Feb 2022 Diag: Don Baldrige

ISO




The filter change at the time of sampling has been noted. Resample at the next service interval to monitor. All component wear rates are normal. There is a moderate amount of silt (particulates < 14 microns in size) present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



OIL ANALYSIS REPORT

Sample Rating Trend

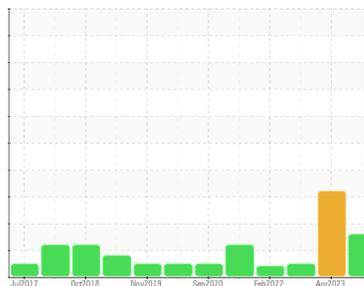

WATER



Machine Id
KAESER SM 11 2004622 (S/N 1545)

Component
Compressor

Fluid
KAESER SIGMA (OEM) S-460 (--- QTS)

DIAGNOSIS

▲ Recommendation

There is too much water present in this sample to perform a particle count. We advise that you stop the unit and follow the water drain-off procedure for this component. We recommend an early resample in 500 hours to monitor this condition.

Wear

All component wear rates are normal.

▲ Contamination

Excessive free water present.

Fluid Condition

The AN level is acceptable for this fluid.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		KCPA004552	KCPA002798	KCP49051
Sample Date	Client Info		23 Oct 2023	19 Apr 2023	12 Sep 2022
Machine Age	hrs	Client Info	90205	87924	85443
Oil Age	hrs	Client Info	0	0	4503
Oil Changed	Client Info		N/A	N/A	Changed
Sample Status			ATTENTION	ABNORMAL	NORMAL

WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >50	0	1	0
Chromium	ppm	ASTM D5185m >10	0	0	0
Nickel	ppm	ASTM D5185m >3	0	0	0
Titanium	ppm	ASTM D5185m >3	0	0	0
Silver	ppm	ASTM D5185m >2	0	0	0
Aluminum	ppm	ASTM D5185m >10	0	<1	0
Lead	ppm	ASTM D5185m >10	0	0	0
Copper	ppm	ASTM D5185m >50	4	3	7
Tin	ppm	ASTM D5185m >10	<1	0	<1
Antimony	ppm	ASTM D5185m	---	---	---
Vanadium	ppm	ASTM D5185m	0	0	0
Cadmium	ppm	ASTM D5185m	0	0	0

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0	0
Barium	ppm	ASTM D5185m 90	0	0	0
Molybdenum	ppm	ASTM D5185m	0	0	0
Manganese	ppm	ASTM D5185m	0	<1	0
Magnesium	ppm	ASTM D5185m 90	<1	15	0
Calcium	ppm	ASTM D5185m 2	1	<1	0
Phosphorus	ppm	ASTM D5185m	1	<1	0
Zinc	ppm	ASTM D5185m	0	19	16
Sulfur	ppm	ASTM D5185m	16245	21620	20518

CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >25	0	0	<1
Sodium	ppm	ASTM D5185m	0	1	<1
Potassium	ppm	ASTM D5185m >20	0	0	0
Water	%	ASTM D6304 >0.05	0.047	▲ 0.157	0.006
ppm Water	ppm	ASTM D6304 >500	470	▲ 1570	61.9




FLUID CLEANLINESS

	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647		---	826	4134
Particles >6µm	ASTM D7647 >1300		---	450	769
Particles >14µm	ASTM D7647 >80		---	77	14
Particles >21µm	ASTM D7647 >20		---	26	1
Particles >38µm	ASTM D7647 >4		---	4	0
Particles >71µm	ASTM D7647 >3		---	0	0
Oil Cleanliness	ISO 4406 (c)	>--/17/13	---	17/16/13	19/17/11

FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045 0.4	0.34	0.36	0.39

OIL ANALYSIS REPORT

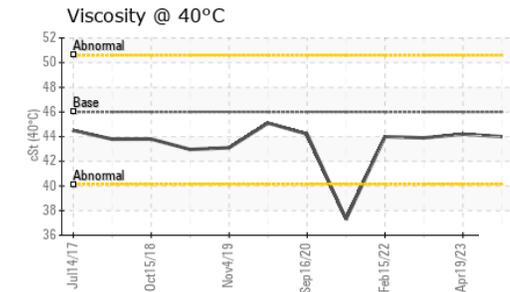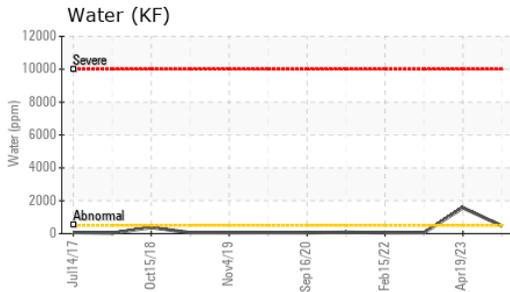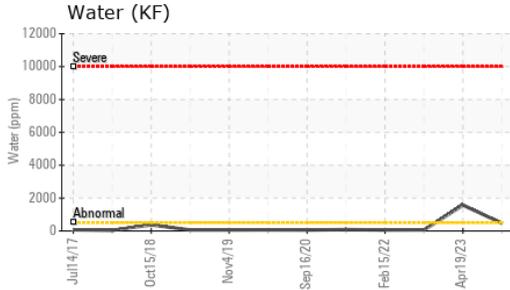





VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	0.2%	NEG
Free Water	scalar	*Visual	▲ 10.0	▲ 1.0	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 46	44.0	44.2	43.9

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------



GRAPHS

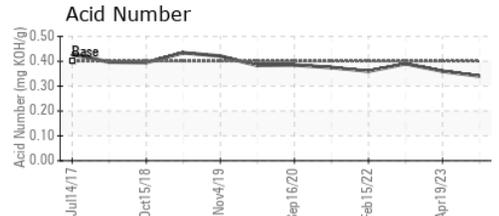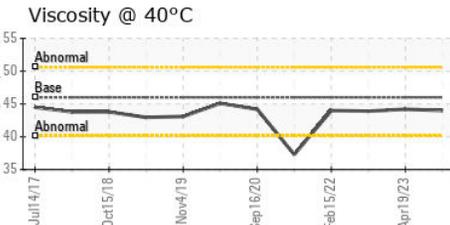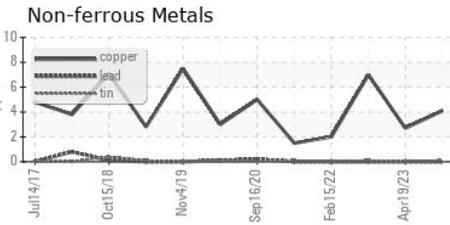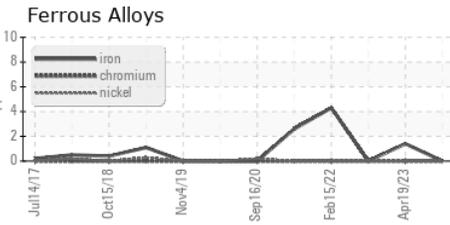

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : KCPA004552 **Received** : 03 Nov 2023
Lab Number : 05997990 **Diagnosed** : 07 Nov 2023
Unique Number : 10726350 **Diagnostician** : Don Baldrige

CENTRAL BAPTIST HOSPITAL
 1740 NICHOLASVILLE RD
 LEXINGTON, KY
 US 40503
 Contact: R. MOSER
 rmoser@bhsi.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:
F: