




PROBLEM SUMMARY

Sample Rating Trend

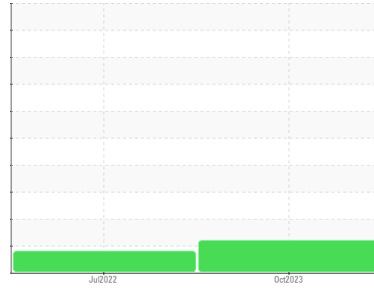


ISO



Machine Id
KAESER 7166277 (S/N 1201)
 Component
Compressor
 Fluid
KAESER SIGMA (OEM) M-460 (--- QTS)

COMPONENT CONDITION SUMMARY

▲ Particle Trend

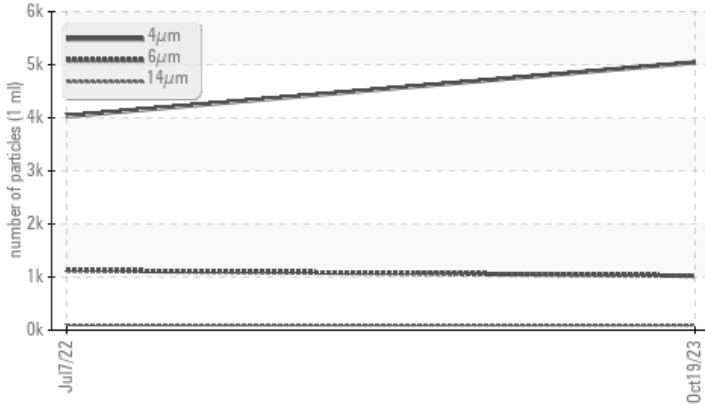

RECOMMENDATION

No corrective action is recommended at this time.
 Resample at the next service interval to monitor.

PROBLEMATIC TEST RESULTS

Sample Status			ATTENTION	ATTENTION	---
Particles >14µm	ASTM D7647	>80	▲ 95	▲ 100	---
Particles >21µm	ASTM D7647	>20	▲ 27	18	---
Oil Cleanliness	ISO 4406 (c)	>17/13	▲ 17/14	▲ 17/14	---

Customer Id: STESHEKY
 Sample No.: KCPA006493
 Lab Number: 05997995
 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:
 Don Baldrige +1
don.b505@comcast.net

To change component or sample information:
 Customer Service +1 1-800-237-1369
customerservice@wearcheck.com

RECOMMENDED ACTIONS

There are no recommended actions for this sample.

HISTORICAL DIAGNOSIS

07 Jul 2022 Diag: Jonathan Hester

ISO



No corrective action is recommended at this time. Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor. All component wear rates are normal. There is a moderate amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.


view report





OIL ANALYSIS REPORT

Sample Rating Trend

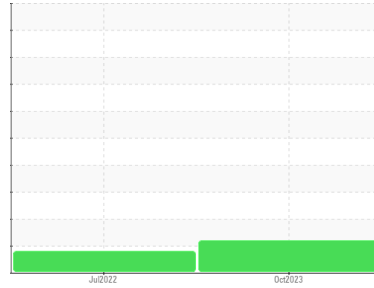

Machine Id
KAESR 7166277 (S/N 1201)
 Component
Compressor
 Fluid
KAESER SIGMA (OEM) M-460 (--- QTS)

DIAGNOSIS

- ▲ Recommendation**
 No corrective action is recommended at this time. Resample at the next service interval to monitor.
- Wear**
 All component wear rates are normal.
- ▲ Contamination**
 There is a moderate amount of particulates present in the oil.
- Fluid Condition**
 The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		KCPA006493	KCP40137	---
Sample Date	Client Info		19 Oct 2023	07 Jul 2022	---
Machine Age	hrs	Client Info	24120	19768	---
Oil Age	hrs	Client Info	0	3227	---
Oil Changed	Client Info		N/A	Changed	---
Sample Status			ATTENTION	ATTENTION	---

WEAR METALS

	method	limit/base	current	history1	history2	
Iron	ppm	ASTM D5185m	>50	0	<1	---
Chromium	ppm	ASTM D5185m	>10	0	0	---
Nickel	ppm	ASTM D5185m		0	0	---
Titanium	ppm	ASTM D5185m		0	0	---
Silver	ppm	ASTM D5185m		0	0	---
Aluminum	ppm	ASTM D5185m	>25	0	<1	---
Lead	ppm	ASTM D5185m	>25	0	0	---
Copper	ppm	ASTM D5185m	>50	12	7	---
Tin	ppm	ASTM D5185m	>15	<1	0	---
Vanadium	ppm	ASTM D5185m		0	0	---
Cadmium	ppm	ASTM D5185m		0	0	---

ADDITIVES

	method	limit/base	current	history1	history2	
Boron	ppm	ASTM D5185m	0	0	0	---
Barium	ppm	ASTM D5185m	90	0	0	---
Molybdenum	ppm	ASTM D5185m	0	0	0	---
Manganese	ppm	ASTM D5185m		<1	0	---
Magnesium	ppm	ASTM D5185m	100	22	43	---
Calcium	ppm	ASTM D5185m	0	1	0	---
Phosphorus	ppm	ASTM D5185m	0	1	6	---
Zinc	ppm	ASTM D5185m	0	15	11	---
Sulfur	ppm	ASTM D5185m	23500	19192	20437	---

CONTAMINANTS

	method	limit/base	current	history1	history2	
Silicon	ppm	ASTM D5185m	>25	1	<1	---
Sodium	ppm	ASTM D5185m		6	3	---
Potassium	ppm	ASTM D5185m	>20	<1	3	---
Water	%	ASTM D6304	>0.1	0.015	0.021	---
ppm Water	ppm	ASTM D6304	>1000	158.6	215.2	---






FLUID CLEANLINESS

	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647		5043	4033	---
Particles >6µm	ASTM D7647	>1300	1023	1127	---
Particles >14µm	ASTM D7647	>80	▲ 95	▲ 100	---
Particles >21µm	ASTM D7647	>20	▲ 27	18	---
Particles >38µm	ASTM D7647	>4	1	2	---
Particles >71µm	ASTM D7647	>3	0	0	---
Oil Cleanliness	ISO 4406 (c)	>17/13	▲ 17/14	▲ 17/14	---

FLUID DEGRADATION

	method	limit/base	current	history1	history2	
Acid Number (AN)	mg KOH/g	ASTM D8045	1.0	0.35	0.34	---


OIL ANALYSIS REPORT

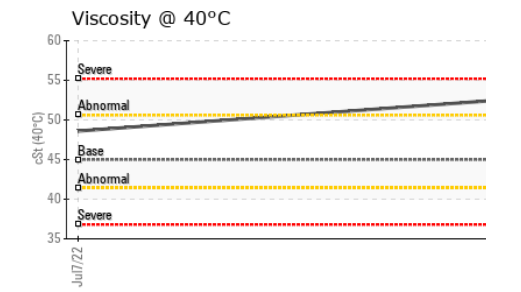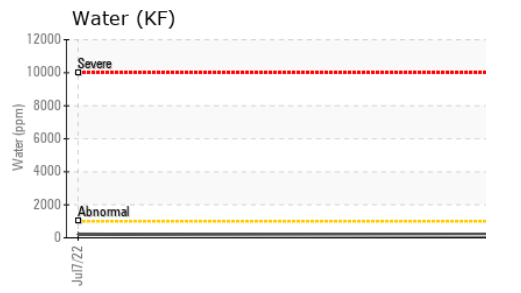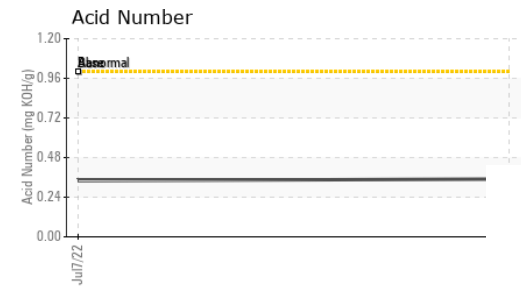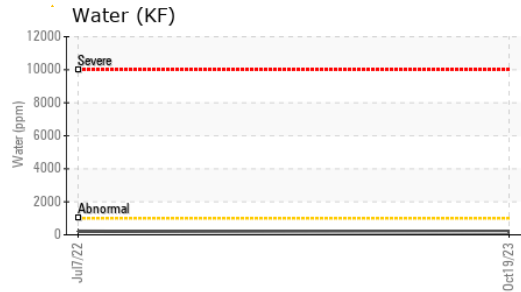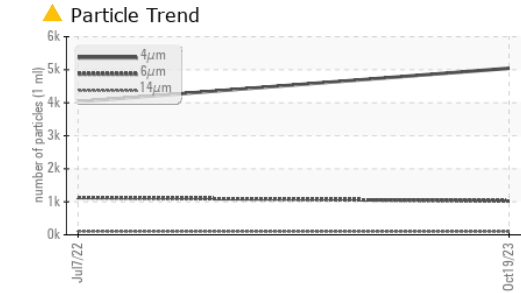





VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	---
Yellow Metal	scalar	*Visual	NONE	NONE	---
Precipitate	scalar	*Visual	NONE	NONE	---
Silt	scalar	*Visual	NONE	NONE	---
Debris	scalar	*Visual	NONE	NONE	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---
Appearance	scalar	*Visual	NORML	NORML	---
Odor	scalar	*Visual	NORML	NORML	---
Emulsified Water	scalar	*Visual	>0.1	NEG	---
Free Water	scalar	*Visual		NEG	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	45	52.6	48.6

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

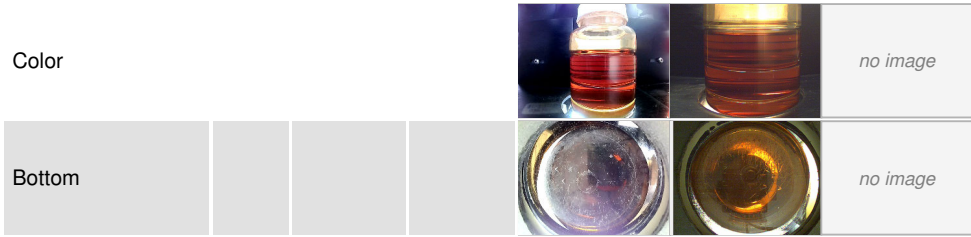

GRAPHS

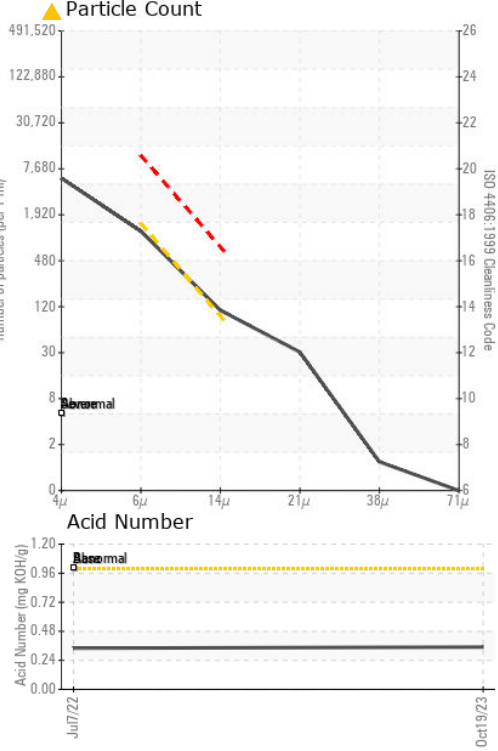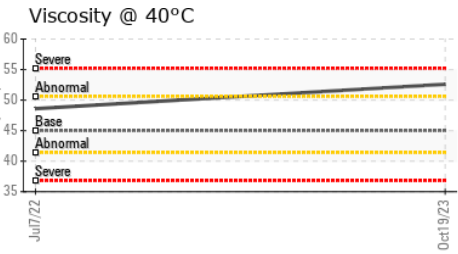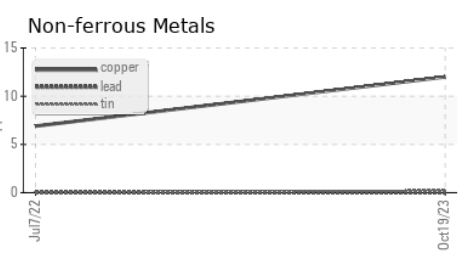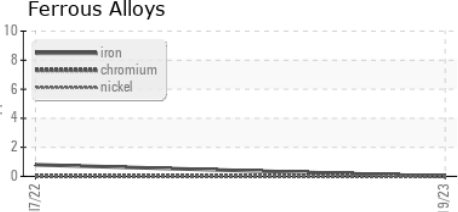

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : KCPA006493 **Received** : 03 Nov 2023
Lab Number : 05997995 **Diagnosed** : 06 Nov 2023
Unique Number : 10726355 **Diagnostician** : Don Baldrige
Test Package : IND 2 (Additional Tests: KF, PrtCount)

STELISED
 566 KENTUCKY ST
 SHELBYVILLE, KY
 US 40065
 Contact: BRAD COLLARD
 bradcollard@bellsouth.net
 T:
 F:

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)