

PROBLEM SUMMARY

Sample Rating Trend


ISO

KAESER AIRCENTER SM 15 6661368 (S/N 1094)

Compressor

KAESER SIGMA (OEM) M-460 (--- GAL)

COMPONENT CONDITION SUMMARY

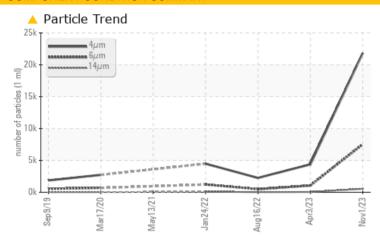

RECOMMENDATION

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

PROBLEMATIC TEST RESULTS									
Sample Status			ABNORMAL	NORMAL	NORMAL				
Particles >6µm	ASTM D7647	>1300	7530	1055	491				
Particles >14μm	ASTM D7647	>80	<u> </u>	47	22				
Particles >21µm	ASTM D7647	>20	122	12	6				
Particles >38μm	ASTM D7647	>4	<u>^</u> 6	0	0				
Oil Cleanliness	ISO 4406 (c)	>/17/13	22/20/16	19/17/13	18/16/12				

Customer Id: SEELOU Sample No.: KC121340 Lab Number: 05998004 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:

Don Baldridge +1 don.b505@comcast.net

To change component or sample information: Customer Service +1 1-800-237-1369 customerservice@wearcheck.com

RECOMMENDED ACTIONS

There are no recommended actions for this sample.

HISTORICAL DIAGNOSIS

03 Apr 2023 Diag: Jonathan Hester

NORMAL



Resample at the next service interval to monitor. All component wear rates are normal. The amount and size of particulates present in the system are acceptable. There is no indication of any contamination in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.



16 Aug 2022 Diag: Doug Bogart

NORMAL



Resample at the next service interval to monitor. All component wear rates are normal. There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.



24 Jan 2022 Diag: Angela Borella

150



Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor. All component wear rates are normal. There is a moderate amount of silt (particulates < 14 microns in size) present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.





OIL ANALYSIS REPORT

Sample Rating Trend



N / - - | - | - | - | - |

KAESER AIRCENTER SM 15 6661368 (S/N 1094)

Component

Compressor

KAESER SIGMA (OEM) M-460 (--- GAL)

DIAGNOSIS

Recommendation

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

▲ Contamination

There is a high amount of particulates present in the oil.


Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

Smp2019 Mm2020 Mmy2021 Jan2022 Aug2022 App2023 Nov2023								
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2		
Sample Number		Client Info		KC121340	KC112491	KC107350		
Sample Date		Client Info		01 Nov 2023	03 Apr 2023	16 Aug 2022		
Machine Age	hrs	Client Info		22918	20295	17894		
Oil Age	hrs	Client Info		0	2400	1967		
Oil Changed		Client Info		N/A	Changed	Changed		
Sample Status				ABNORMAL	NORMAL	NORMAL		
WEAR METALS		method	limit/base	current	history1	history2		
Iron	ppm	ASTM D5185m	>50	0	<1	0		
Chromium	ppm	ASTM D5185m	>10	0	0	0		
Nickel	ppm	ASTM D5185m	>3	0	0	<1		
Titanium	ppm	ASTM D5185m	>3	0	0	0		
Silver	ppm	ASTM D5185m	>2	0	0	<1		
Aluminum	ppm	ASTM D5185m	>10	0	<1	1		
Lead	ppm	ASTM D5185m	>10	<1	0	0		
Copper	ppm	ASTM D5185m	>50	4	3	2		
Tin	ppm	ASTM D5185m	>10	<1	0	<1		
Antimony	ppm	ASTM D5185m						
Vanadium	ppm	ASTM D5185m		0	0	0		
Cadmium	ppm	ASTM D5185m		0	0	0		
ADDITIVES		method	limit/base	current	history1	history2		
Boron	ppm	ASTM D5185m	0	0	0	0		
Barium	ppm	ASTM D5185m	90	27	33	21		
Molybdenum	ppm	ASTM D5185m	0	0	0	0		
Manganese	ppm	ASTM D5185m		<1	<1	0		
Magnesium	ppm	ASTM D5185m	100	63	87	92		
Calcium	ppm	ASTM D5185m	0	2	0	0		
Phosphorus	ppm	ASTM D5185m	0	1	3	1		
Zinc	ppm	ASTM D5185m	0	5	4	4		
CONTAMINANTS		method	limit/base	current	history1	history2		
Silicon	ppm	ASTM D5185m	>25	0	<1	<1		
Sodium	ppm	ASTM D5185m		15	16	3		
Potassium	ppm	ASTM D5185m	>20	<1	2	0		
Water	%	ASTM D6304	>0.05	0.017	0.022	0.019		
ppm Water	ppm	ASTM D6304	>500	173.2	223.3	195.9		
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2		
Particles >4µm		ASTM D7647		21842	4379	2254		
Particles >6µm		ASTM D7647	>1300	7530	1055	491		
Particles >14µm		ASTM D7647	>80	<u></u> 542	47	22		
Particles >21µm		ASTM D7647	>20	<u> </u>	12	6		
Particles >38μm		ASTM D7647	>4	<u> </u>	0	0		
Particles >71μm		ASTM D7647	>3	0	0	0		
Oil Cleanliness		ISO 4406 (c)	>/17/13	22/20/16	19/17/13	18/16/12		
FLUID DEGRADA	TION	method	limit/base	current	history1	history2		
Acid Number (AN)	mg KOH/g	ASTM D8045	1.0	0.33	0.39	0.35		



OIL ANALYSIS REPORT

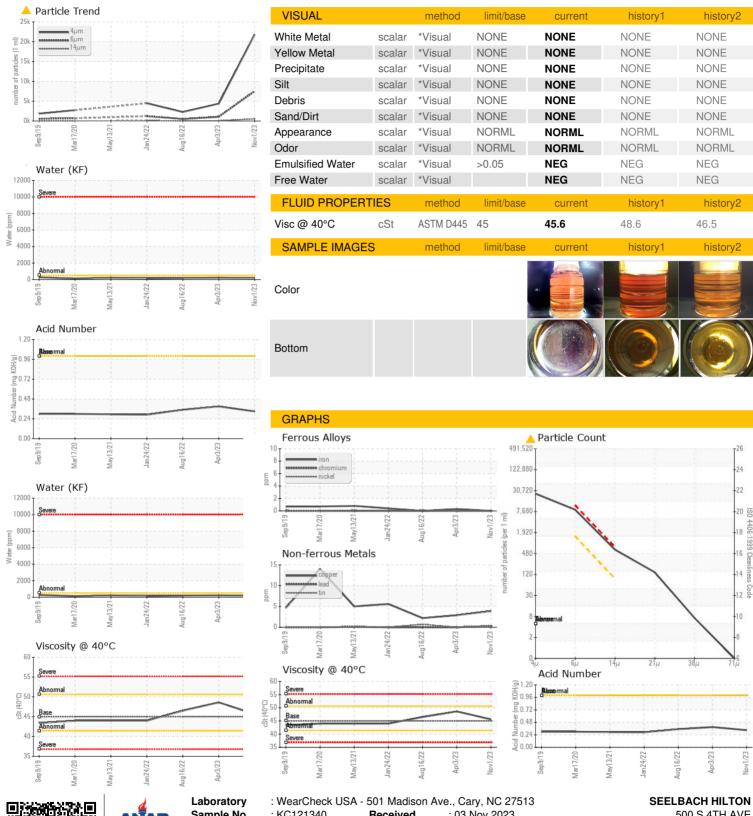





Certificate L2367

Sample No. Lab Number **Unique Number**

Test Package

: KC121340 : 05998004 : 10726364 : IND 2

: 03 Nov 2023 Received Diagnosed Diagnostician

: 06 Nov 2023 : Don Baldridge

500 S 4TH AVE LOUISVILLE, KY US 40202

Contact: SERVICE MANAGER

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T: F: