


PROBLEM SUMMARY


[K43188] 7567476 (S/N 1049)

Compressor Fluid

KAESER SIGMA (OEM) S-460 (--- GAL)

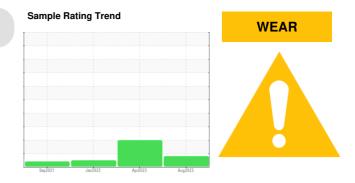

COMPONENT CONDITION SUMMARY

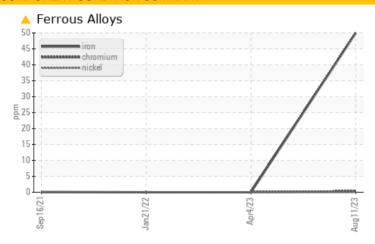

RECOMMENDATION

No corrective action is recommended at this time. Resample at the next service interval to monitor.

PROBLEMATIC TEST RESULTS										
Sample Status				MARGINAL	ABNORMAL	NORMAL				
Iron	ppm	ASTM D5185m	>50	^ 50	0	0				

Customer Id: JAICHI Sample No.: KC101186 Lab Number: 05998008 Test Package: IND 2

To manage this report scan the QR code

To discuss the diagnosis or test data:

Don Baldridge +1 don.b505@comcast.net

To change component or sample information: Customer Service +1 1-800-237-1369 customerservice@wearcheck.com

RECOMMENDED ACTIONS

There are no recommended actions for this sample.

HISTORICAL DIAGNOSIS

04 Apr 2023 Diag: Don Baldridge

ISO



No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor. All component wear rates are normal. There is a high amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.



21 Jan 2022 Diag: Angela Borella

NORMAL



The filter change at the time of sampling has been noted. Resample at the next service interval to monitor. We were unable to perform a particle count due to a high concentration of particles present in this sample.All component wear rates are normal. There is no indication of any contamination in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.



16 Sep 2021 Diag: Don Baldridge

VIS DEBRIS



No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor. We were unable to perform a particle count due to a high concentration of particles present in this sample. All component wear rates are normal. Moderate concentration of visible dirt/debris present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.






OIL ANALYSIS REPORT

[K43188] 7567476 (S/N 1049)

Compressor

KAESER SIGMA (OEM) S-460 (--- GAL)



DIAGNOSIS

Recommendation

No corrective action is recommended at this time. Resample at the next service interval to monitor.

The iron level is marginal. All other component wear rates are normal.

Contamination

The amount and size of particulates present in the system are acceptable. There is no indication of any contamination in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

		Sep202	1 Jan2022	Apr2023 A	ug2023	
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KC101186	KC107534	KC96092
Sample Date		Client Info		11 Aug 2023	04 Apr 2023	21 Jan 2022
Machine Age	hrs	Client Info		14480	12515	5914
Oil Age	hrs	Client Info		4130	2202	3718
Oil Changed		Client Info		Not Changd	Not Changd	Not Changd
Sample Status				MARGINAL	ABNORMAL	NORMAL
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	_ 50	0	0
Chromium	ppm	ASTM D5185m	>10	<1	0	0
Nickel	ppm	ASTM D5185m	>3	0	0	0
Titanium	ppm	ASTM D5185m	>3	0	0	0
Silver	ppm	ASTM D5185m	>2	0	0	0
Aluminum	ppm	ASTM D5185m	>10	<1	0	<1
Lead	ppm	ASTM D5185m	>10	0	0	0
Copper	ppm	ASTM D5185m	>50	9	4	9
Tin	ppm	ASTM D5185m	>10	<1	2	<1
Antimony	ppm	ASTM D5185m		0		0
Vanadium	ppm	ASTM D5185m		0	0	0
Cadmium	ppm	ASTM D5185m		0	0	0
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		55	0	0
Barium	ppm	ASTM D5185m	90	0	29	0
Molybdenum		ASTM D5185m	30	<1	0	0
Manganese	ppm	ASTM D5185m		3	<1	0
Magnesium	ppm	ASTM D5185m	90	2	45	0
Calcium	ppm		2	90	1	0
Phosphorus	ppm	ASTM D5185m	_	150	0	6
Zinc	ppm	ASTM D5185m		14	5	0
-						
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	7	0	<1
Sodium	ppm	ASTM D5185m		4	9	<1
Potassium	ppm	ASTM D5185m	>20	1	40	0
Water	%	ASTM D6304	>0.05	0.004	0.013	0.001
ppm Water	ppm	ASTM D6304	>500	46.3	136.3	3.0
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		260	4496	
Particles >6µm		ASTM D7647	>1300	92	<u>^</u> 2840	
Particles >14μm		ASTM D7647	>80	19	△ 973	
Particles >21µm		ASTM D7647	>20	8	<u></u> 4 358	
Particles >38µm		ASTM D7647	>4	2	△ 33	
Particles >71µm		ASTM D7647	>3	0	2	
Oil Cleanliness		ISO 4406 (c)	>/17/13	15/14/11	1 9/19/17	
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.4	0.42	0.45	0.42



OIL ANALYSIS REPORT







Certificate L2367

Report Id: JAICHI [WUSCAR] 05998008 (Generated: 11/06/2023 18:28:50) Rev: 1

Sample No. Lab Number **Unique Number**

: KC101186 : 05998008 : 10726368 Test Package : IND 2

Received : 03 Nov 2023 : 06 Nov 2023 Diagnosed

Diagnostician : Don Baldridge

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

CHICOPEE, MA

Contact: Service Manager

US 01022

T: F: