


OIL ANALYSIS REPORT

Sample Rating Trend



NORMAL



FRICK RC-3

Refrigeration Compressor

FRICK COMPRESSOR OIL #3 (--- GAL)

Recommendation

Resample at the next service interval to monitor.

All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

				0ct2023		
CAMPLE INCOR	AATIONI	a tla a al			la i a ta murd	history.O
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		USP0003060		
Sample Date		Client Info		25 Oct 2023		
Machine Age	hrs	Client Info		798		
Oil Age	hrs	Client Info		0		
Oil Changed		Client Info		N/A		
Sample Status				NORMAL		
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>8	0		
Chromium	ppm	ASTM D5185m	>2	0		
Nickel	ppm	ASTM D5185m		<1		
Titanium	ppm	ASTM D5185m		0		
Silver	ppm	ASTM D5185m	>2	0		
Aluminum	ppm	ASTM D5185m	>3	0		
Lead	ppm	ASTM D5185m	>2	<1		
Copper	ppm	ASTM D5185m	>8	0		
Tin	ppm	ASTM D5185m	>4	<1		
Vanadium	ppm	ASTM D5185m		0		
Cadmium	ppm	ASTM D5185m		0		
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0		
Barium	ppm	ASTM D5185m		0		
Molybdenum	ppm	ASTM D5185m		0		
Manganese	ppm	ASTM D5185m		<1		
Magnesium	ppm	ASTM D5185m		1		
Calcium	ppm	ASTM D5185m		1		
Phosphorus	ppm	ASTM D5185m		1		
Zinc	ppm	ASTM D5185m		0		
Sulfur	ppm	ASTM D5185m		16		
CONTAMINANTS	;	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>15	<1		
Sodium	ppm	ASTM D5185m		0		
Potassium	ppm	ASTM D5185m	>20	<1		
Water	%	ASTM D6304	>0.01	0.002		
ppm Water	ppm	ASTM D6304	>100	20.9		
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647	>10000	634		
Particles >6µm		ASTM D7647	>2500	112		
Particles >14µm		ASTM D7647	>320	8		
Particles >21µm		ASTM D7647	>80	3		
Particles >38µm		ASTM D7647	>20	0		
Particles >71µm		ASTM D7647	>4	0		
Oil Cleanliness		ISO 4406 (c)	>20/18/15	16/14/10		
FLUID DEGRADA	ATION	method	limit/base	current	history1	history2
Acid Number (ANI)	I/OII/-	A CTM DOZA		0.012		


Acid Number (AN)

mg KOH/g ASTM D974

0.013



OIL ANALYSIS REPORT

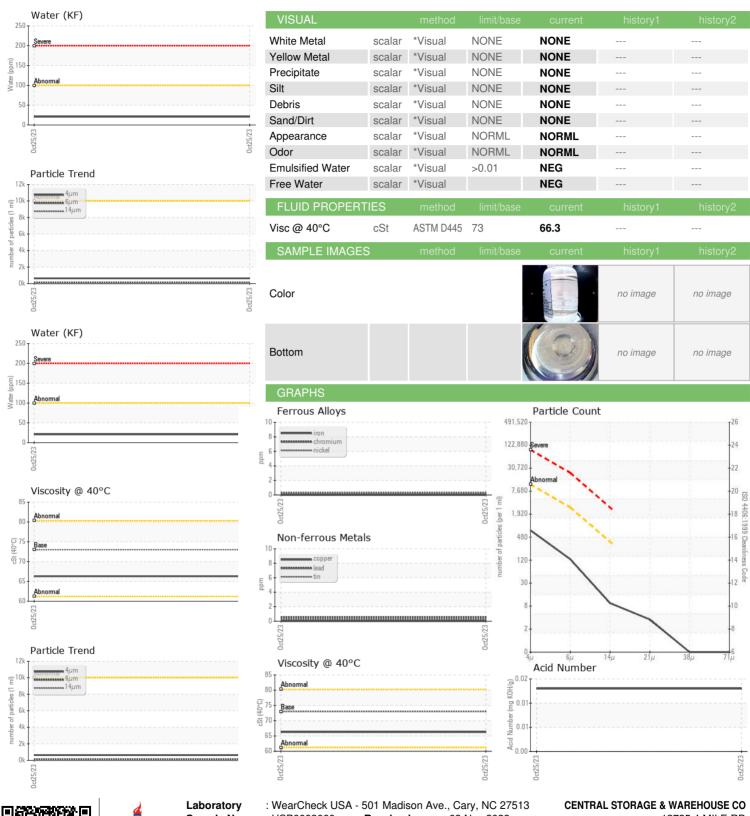





Certificate L2367

Sample No. Lab Number Unique Number

: USP0003060 : 05998049

: 10726409 Test Package : IND 2

Received : 03 Nov 2023 Diagnosed : 06 Nov 2023

: Doug Bogart Diagnostician

12725 4 MILE RD FRANKSVILLE, WI US 53126

Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T: F: