




# OIL ANALYSIS REPORT

Sample Rating Trend

**NORMAL**

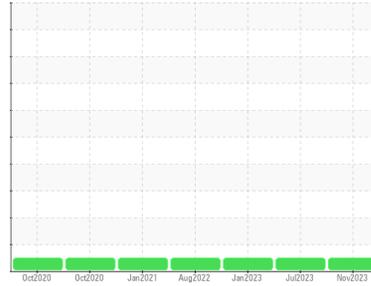

Area  
**CMPL**  
 Machine Id  
**CMPL LEVELLER REDUCER**  
 Component  
**Gearbox**  
 Fluid  
**GEAR OIL ISO 220 (--- LTR)**

## DIAGNOSIS

### Recommendation

Little or no information is provided as to the component and lubricant being tested. Recommendations are therefore generic in nature and may not apply to the current application. Please forward information as to equipment type, reservoir capacity, lubricant type and any pertinent information to allow for a more accurate assessment. Resample at the next service interval to monitor. NOTE: Please provide information regarding reservoir capacity, filter type and micron rating with next sample. Please specify the brand, type, and viscosity of the oil on your next sample.

### Wear

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the oil.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			<b>RP0038567</b>	RP0035029	RP0031409
Sample Date	Client Info			<b>02 Nov 2023</b>	07 Jul 2023	17 Jan 2023
Machine Age	hrs	Client Info		<b>0</b>	0	0
Oil Age	hrs	Client Info		<b>0</b>	0	0
Oil Changed	Client Info			<b>N/A</b>	N/A	N/A
Sample Status				<b>NORMAL</b>	NORMAL	NORMAL





WEAR METALS		method	limit/base	current	history1	history2
PQ		ASTM D8184		<b>38</b>	26	23
Iron	ppm	ASTM D5185m	>200	<b>59</b>	44	49
Chromium	ppm	ASTM D5185m	>15	<b>&lt;1</b>	<1	<1
Nickel	ppm	ASTM D5185m	>15	<b>0</b>	<1	<1
Titanium	ppm	ASTM D5185m		<b>0</b>	1	1
Silver	ppm	ASTM D5185m		<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m	>25	<b>2</b>	3	1
Lead	ppm	ASTM D5185m	>100	<b>0</b>	0	0
Copper	ppm	ASTM D5185m	>200	<b>&lt;1</b>	2	3
Tin	ppm	ASTM D5185m	>25	<b>0</b>	<1	<1
Vanadium	ppm	ASTM D5185m		<b>0</b>	0	0
Cadmium	ppm	ASTM D5185m		<b>0</b>	0	0

ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	50	<b>2</b>	0	0
Barium	ppm	ASTM D5185m	15	<b>19</b>	0	0
Molybdenum	ppm	ASTM D5185m	15	<b>0</b>	0	<1
Manganese	ppm	ASTM D5185m		<b>0</b>	<1	<1
Magnesium	ppm	ASTM D5185m	50	<b>1</b>	0	2
Calcium	ppm	ASTM D5185m	50	<b>22</b>	18	20
Phosphorus	ppm	ASTM D5185m	350	<b>159</b>	130	151
Zinc	ppm	ASTM D5185m	100	<b>11</b>	<1	10

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>50	<b>5</b>	3	4
Sodium	ppm	ASTM D5185m		<b>0</b>	<1	<1
Potassium	ppm	ASTM D5185m	>20	<b>&lt;1</b>	2	<1
Water	%	ASTM D6304	>0.2	<b>0.007</b>	0.006	0.013
ppm Water	ppm	ASTM D6304	>2000	<b>75.1</b>	67.1	133.0

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.85	<b>0.33</b>	0.43	0.45

# OIL ANALYSIS REPORT

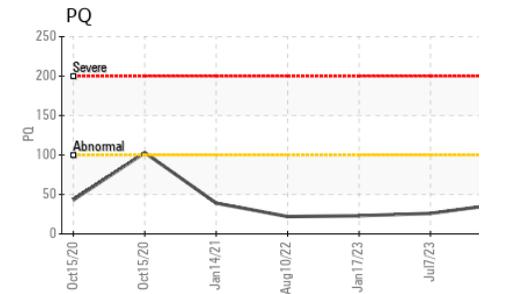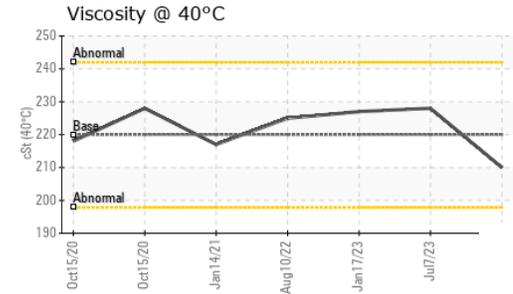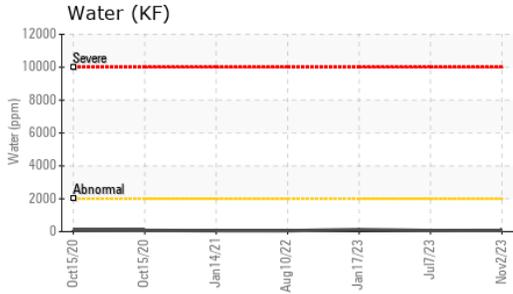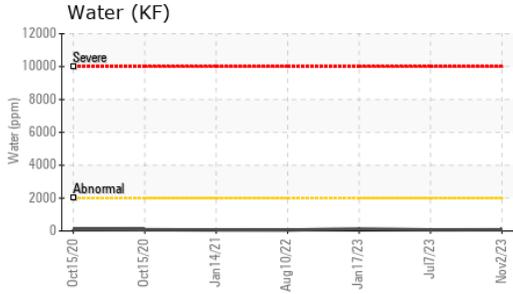






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	<b>LIGHT</b>	NONE
Yellow Metal	scalar	*Visual	NONE	<b>NONE</b>	NONE
Precipitate	scalar	*Visual	NONE	<b>NONE</b>	NONE
Silt	scalar	*Visual	NONE	<b>NONE</b>	NONE
Debris	scalar	*Visual	NONE	<b>NONE</b>	NONE
Sand/Dirt	scalar	*Visual	NONE	<b>NONE</b>	NONE
Appearance	scalar	*Visual	NORML	<b>NORML</b>	NORML
Odor	scalar	*Visual	NORML	<b>NORML</b>	NORML
Emulsified Water	scalar	*Visual	>0.2	<b>NEG</b>	NEG
Free Water	scalar	*Visual		<b>NEG</b>	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	220	<b>210</b>	228

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------



## GRAPHS

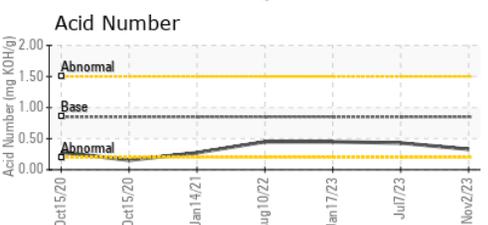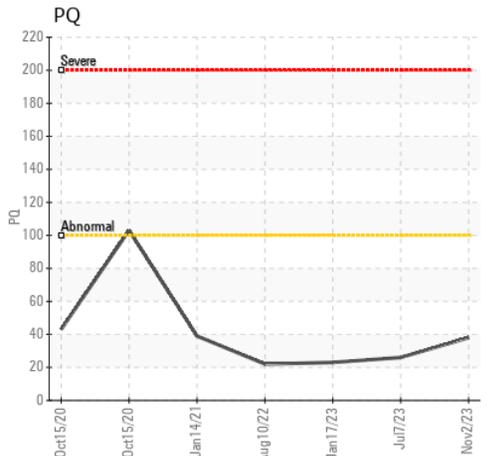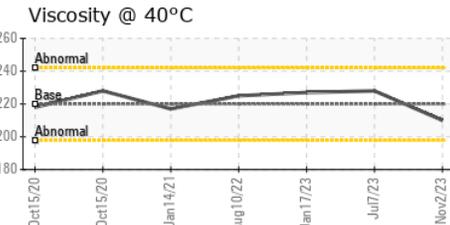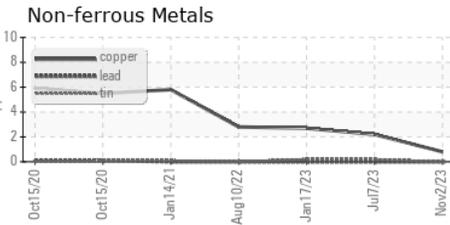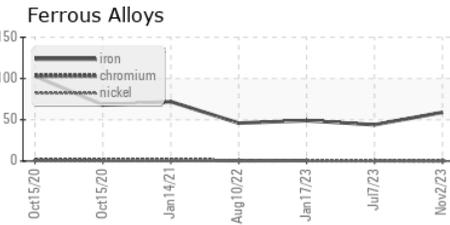

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : RP0038567 **Received** : 03 Nov 2023  
**Lab Number** : **05998075** **Diagnosed** : 06 Nov 2023  
**Unique Number** : 10726435 **Diagnostician** : Wes Davis  
**Test Package** : IND 2 ( Additional Tests: PQ )

**OUTOKUMPU STAINLESS USA**  
 HWY 43 N  
 CALVERT, AL  
 US 36513  
 Contact: MARIO JOHNSON  
 Mario.johnson@outokumpu.com  
 T: (251)321-4105  
 F: x:

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)