




# OIL ANALYSIS REPORT

Sample Rating Trend

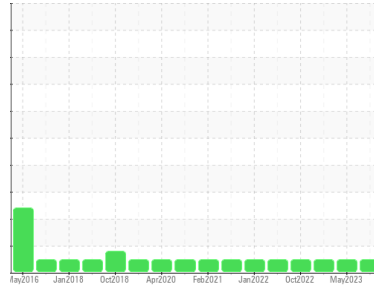

Machine Id  
**BLWR-408 (S/N 5423648)**  
 Component  
**Drive End Blower**  
 Fluid  
**AEON (1 PNT)**

## DIAGNOSIS

- Recommendation**  
 Resample at the next service interval to monitor.
- Wear**  
 All component wear rates are normal.
- Contamination**  
 The water content is negligible. There is no indication of any contamination in the oil.
- Fluid Condition**  
 The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			<b>RP0036673</b>	RP0027811	RP0027890
Sample Date	Client Info			<b>04 Nov 2023</b>	02 May 2023	25 Jan 2023
Machine Age	mths	Client Info		<b>0</b>	0	0
Oil Age	mths	Client Info		<b>0</b>	0	0
Oil Changed	Client Info			<b>N/A</b>	N/A	N/A
Sample Status				<b>NORMAL</b>	NORMAL	NORMAL

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>20	<b>&lt;1</b>	9	10
Chromium	ppm	ASTM D5185m	>20	<b>&lt;1</b>	0	0
Nickel	ppm	ASTM D5185m	>20	<b>0</b>	0	0
Titanium	ppm	ASTM D5185m		<b>0</b>	0	0
Silver	ppm	ASTM D5185m		<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m	>20	<b>2</b>	0	0
Lead	ppm	ASTM D5185m	>20	<b>0</b>	0	0
Copper	ppm	ASTM D5185m	>20	<b>2</b>	6	5
Tin	ppm	ASTM D5185m	>20	<b>0</b>	<1	<1
Vanadium	ppm	ASTM D5185m		<b>0</b>	0	0
Cadmium	ppm	ASTM D5185m		<b>0</b>	0	0




ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		<b>0</b>	0	0
Barium	ppm	ASTM D5185m		<b>19</b>	0	0
Molybdenum	ppm	ASTM D5185m		<b>0</b>	<1	<1
Manganese	ppm	ASTM D5185m		<b>0</b>	0	0
Magnesium	ppm	ASTM D5185m		<b>&lt;1</b>	<1	0
Calcium	ppm	ASTM D5185m		<b>1</b>	0	0
Phosphorus	ppm	ASTM D5185m		<b>604</b>	580	586
Zinc	ppm	ASTM D5185m		<b>7</b>	5	5

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>15	<b>2</b>	2	2
Sodium	ppm	ASTM D5185m		<b>0</b>	0	0
Potassium	ppm	ASTM D5185m	>20	<b>&lt;1</b>	<1	0
Water	%	ASTM D6304		<b>0.010</b>	0.006	0.012
ppm Water	ppm	ASTM D6304		<b>104.5</b>	62.9	120.8

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045		<b>1.04</b>	0.91	1.09

VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	<b>LIGHT</b>	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Precipitate	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Silt	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Debris	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Appearance	scalar	*Visual	NORML	<b>NORML</b>	NORML	NORML
Odor	scalar	*Visual	NORML	<b>NORML</b>	NORML	NORML
Emulsified Water	scalar	*Visual		<b>NEG</b>	NEG	NEG
Free Water	scalar	*Visual		<b>NEG</b>	NEG	NEG





# OIL ANALYSIS REPORT

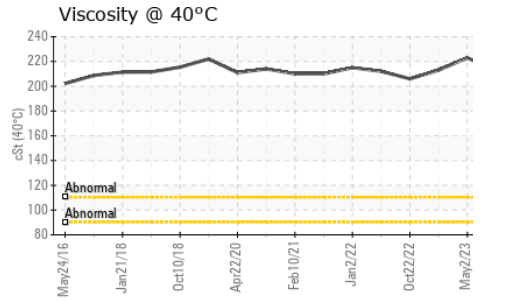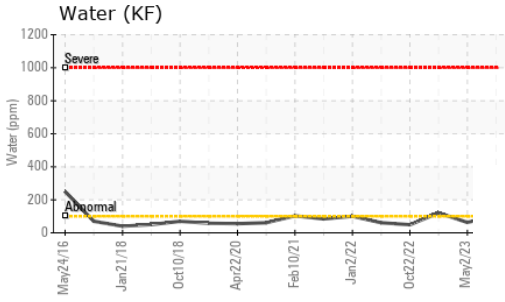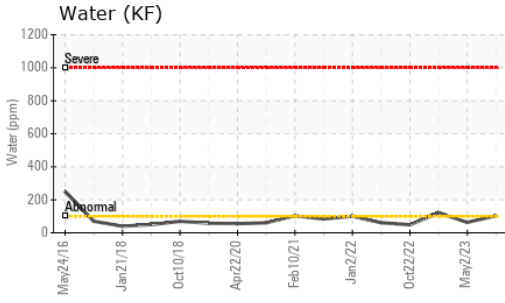

FLUID PROPERTIES		method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445		212	223	213

SAMPLE IMAGES		method	limit/base	current	history1	history2
Color						
Bottom						

## GRAPHS

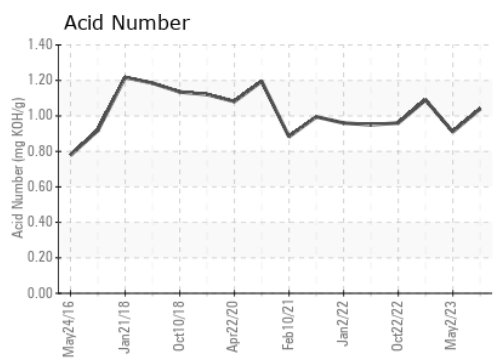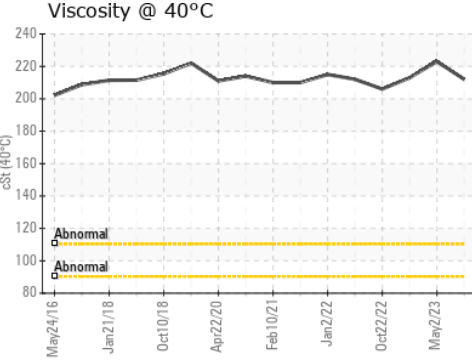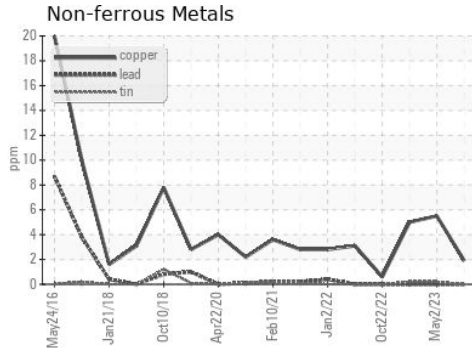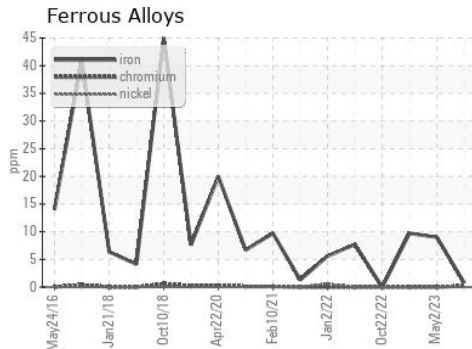

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : RP0036673  
**Lab Number** : 05998109  
**Unique Number** : 10726469  
**Test Package** : IND 2

**HOLLINGSWORTH & VOSE CO**  
 1115 SE CRYSTAL LAKE DR  
 CORVALLIS, OR  
 US 97333  
 Contact: Jon Ayers  
 jonathan.ayers@hovo.com  
 T: (541)738-5399  
 F: x:

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)