




# OIL ANALYSIS REPORT

Sample Rating Trend

**NORMAL**

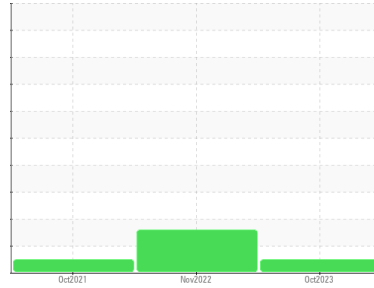

Area  
**ALL ADVANTAGE**  
 Machine Id  
**1128 - ELLIOT AVIATION**  
 Component  
**Compressor**

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor. Please specify the brand, type, and viscosity of the oil on your next sample.

### Wear

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the oil.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			<b>UCH05998115</b>	UCH05711095	UCH05382039
Sample Date	Client Info			<b>13 Oct 2023</b>	22 Nov 2022	19 Oct 2021
Machine Age	hrs	Client Info		<b>4468</b>	3833	3478
Oil Age	hrs	Client Info		<b>0</b>	0	400
Oil Changed	Client Info			<b>Not Chngd</b>	Not Chngd	Changed
Sample Status				<b>NORMAL</b>	ATTENTION	NORMAL

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<b>0</b>	0	0
Chromium	ppm	ASTM D5185m	>10	<b>&lt;1</b>	0	0
Nickel	ppm	ASTM D5185m	>3	<b>0</b>	0	0
Titanium	ppm	ASTM D5185m	>3	<b>0</b>	0	0
Silver	ppm	ASTM D5185m	>2	<b>0</b>	0	<1
Aluminum	ppm	ASTM D5185m	>10	<b>2</b>	<1	0
Lead	ppm	ASTM D5185m	>10	<b>0</b>	0	0
Copper	ppm	ASTM D5185m	>50	<b>&lt;1</b>	<1	<1
Tin	ppm	ASTM D5185m	>10	<b>0</b>	<1	<1
Antimony	ppm	ASTM D5185m		<b>---</b>	---	0
Vanadium	ppm	ASTM D5185m		<b>0</b>	0	0
Cadmium	ppm	ASTM D5185m		<b>0</b>	0	0

ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		<b>0</b>	0	<1
Barium	ppm	ASTM D5185m		<b>19</b>	0	10
Molybdenum	ppm	ASTM D5185m		<b>0</b>	0	0
Manganese	ppm	ASTM D5185m		<b>0</b>	0	0
Magnesium	ppm	ASTM D5185m		<b>&lt;1</b>	0	0
Calcium	ppm	ASTM D5185m		<b>&lt;1</b>	0	0
Phosphorus	ppm	ASTM D5185m		<b>301</b>	303	241
Zinc	ppm	ASTM D5185m		<b>44</b>	30	45
Sulfur	ppm	ASTM D5185m		<b>302</b>	475	409



CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<b>&lt;1</b>	<1	<1
Sodium	ppm	ASTM D5185m		<b>0</b>	1	0
Potassium	ppm	ASTM D5185m	>20	<b>&lt;1</b>	0	0

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045		<b>0.29</b>	0.25	0.228

VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Precipitate	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Silt	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Debris	scalar	*Visual	NONE	<b>NONE</b>	NONE	LIGHT
Sand/Dirt	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Appearance	scalar	*Visual	NORML	<b>NORML</b>	NORML	NORML
Odor	scalar	*Visual	NORML	<b>NORML</b>	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	<b>NEG</b>	0.2%	NEG
Free Water	scalar	*Visual		<b>NEG</b>	NEG	NEG




# OIL ANALYSIS REPORT



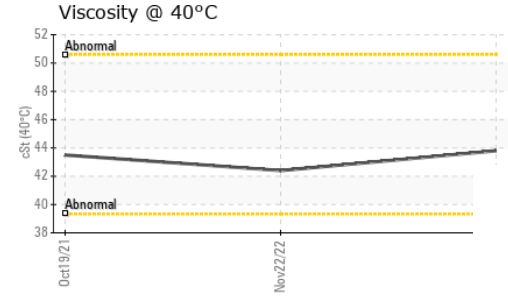
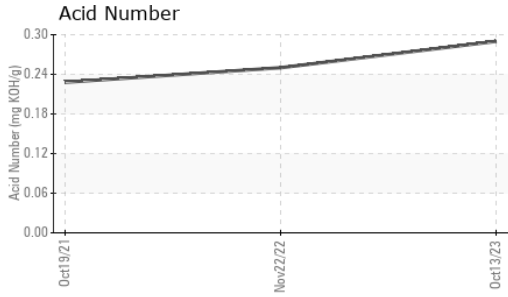


FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	43.8	42.4	43.5

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

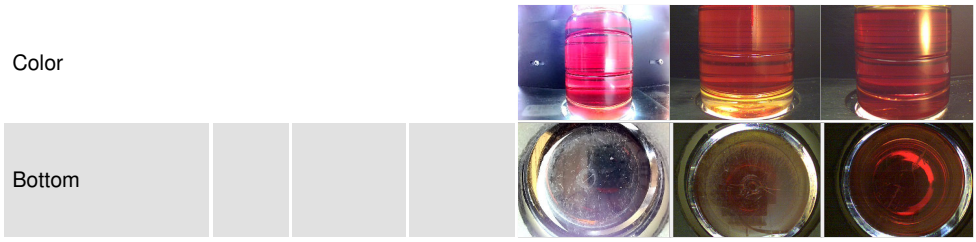

## GRAPHS

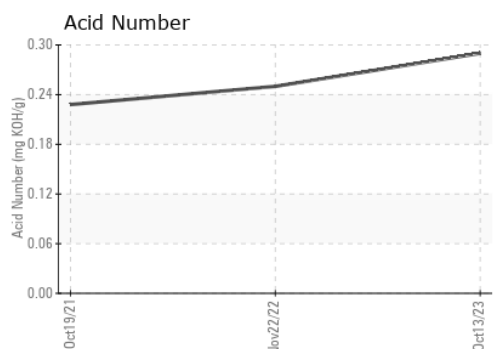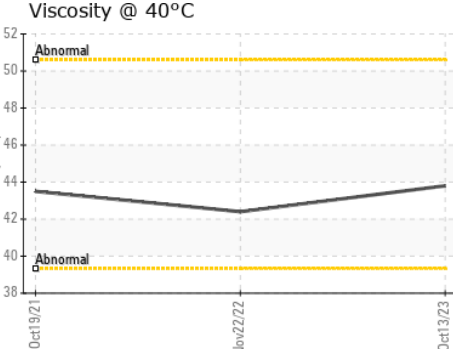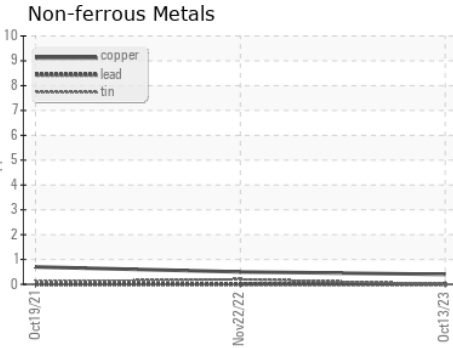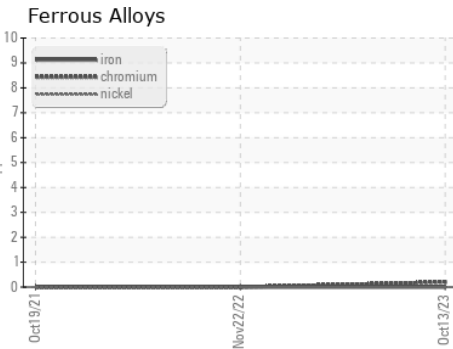

Certificate L2367

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : UCH05998115 **Received** : 03 Nov 2023  
**Lab Number** : 05998115 **Diagnosed** : 06 Nov 2023  
**Unique Number** : 10726475 **Diagnostician** : Angela Borella  
**Test Package** : IND 2

**A-L-L EQUIPMENT INC**  
 204 38TH ST  
 MOLINE, IL  
 US 61265  
 Contact: KEVIN DESPOT  
 kevind@a-l-equipment.com  
 T: (815)877-7000  
 F: (309)762-9950

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)