

OIL ANALYSIS REPORT

Area ULTRA COOLANT Machine Id KV5258 - KVF QUAD CORP (S/N VK5258) Component

Compressor

DIAGNOSIS

Recommendation

Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear


All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.



Sample Rating Trend




NORMAL

				Oct2023		
SAMPLE INFORM	ΛΑΤΙΟΝ	method	limit/base	current	history1	history2
Sample Number		Client Info		UCH05998119		
Sample Date		Client Info		26 Oct 2023		
Machine Age	hrs	Client Info		23216		
Oil Age	hrs	Client Info		4227		
Oil Changed		Client Info		Not Changd		
Sample Status				NORMAL		
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<1		
Chromium	ppm	ASTM D5185m		<1		
Nickel	ppm	ASTM D5185m	210	0		
Titanium		ASTM D5185m		0		
Silver	ppm	ASTM D5185m		0		
	ppm	ASTM D5185m	>25	2		
Aluminum	ppm					
Lead	ppm	ASTM D5185m	>25	0		
Copper	ppm	ASTM D5185m	>50	<1		
Tin	ppm	ASTM D5185m	>15	0		
Vanadium	ppm	ASTM D5185m		0		
Cadmium	ppm	ASTM D5185m		0		
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0		
Barium	ppm	ASTM D5185m	556	702		
Molybdenum	ppm	ASTM D5185m		0		
Manganese	ppm	ASTM D5185m		0		
Magnesium	ppm	ASTM D5185m		3		
Calcium	ppm	ASTM D5185m	242	7		
Phosphorus	ppm	ASTM D5185m	0	38		
Zinc	ppm	ASTM D5185m	0	14		
Sulfur	ppm	ASTM D5185m	306	304		
CONTAMINANTS	;	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	2		
Sodium	ppm	ASTM D5185m		60		
Potassium	ppm	ASTM D5185m	>20	7		
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.2	0.43		
VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	MODER		
Yellow Metal	scalar	*Visual	NONE	NONE		
Precipitate	scalar	*Visual	NONE	NONE		
Silt	scalar	*Visual	NONE	NONE		
Debris	scalar	*Visual	NONE	NONE		
Sand/Dirt	scalar	*Visual	NONE	NONE		
Appearance	scalar	*Visual	NORML	NORML		
Odor	scalar	*Visual	NORML	NORML		
Emulsified Water	scalar	*Visual	>0.1	NEG		
Free Water	scalar	*Visual	20.1	NEG		
	Scalai	visual		NLG		



OIL ANALYSIS REPORT

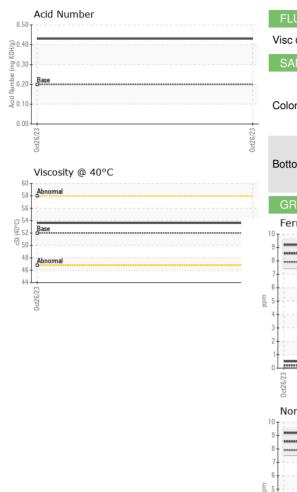

FLUID PROPERTIES ASTM D445 52 53.6 Visc @ 40°C cSt SAMPLE IMAGES Color no image no image Bottom no image no image GRAPHS Ferrous Alloys chro nickel Non-ferrous Metals head bpm Viscosity @ 40°C Acid Number 60 0.45 58 0.40 0.35 (b/HO) 0.30 (b/HO) 56 54 E 0.25 € £52 š ළ 은 0.20 50 N DOLD 48 Abnorm 0.10 46 0.05 44 0.00 0ct26/23 : WearCheck USA - 501 Madison Ave., Cary, NC 27513 A-L-L EQUIPMENT INC Laboratory Sample No. : UCH05998119 Received : 03 Nov 2023 204 38TH ST Lab Number : 05998119 Diagnosed : 06 Nov 2023 MOLINE, IL Unique Number : 10726479 Diagnostician : Angela Borella US 61265 Test Package : IND 2 Contact: KEVIN DESPOT To discuss this sample report, contact Customer Service at 1-800-237-1369. kevind@a-l-lequipment.com * - Denotes test methods that are outside of the ISO 17025 scope of accreditation. T: (815)877-7000 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012) F: (309)762-9950



Report Id: UCALLMOL [WUSCAR] 05998119 (Generated: 11/06/2023 15:03:20) Rev: 1

Certificate L2367

Contact/Location: KEVIN DESPOT - UCALLMOL