



FUEL REPORT

Sample Rating Trend

NORMAL



Area
[WO 27032-01]
 Machine Id
KOHLER 5227900766 - RDO EQUIPMENT
 Component
Diesel Fuel
 Fluid
NOT GIVEN (--- GAL)

DIAGNOSIS

Recommendation

No corrective action is recommended at this time. All laboratory tests indicate that this sample meets specifications for No.2 ultra-low-sulfur diesel fuel.

Corrosion

All metal levels are normal indicating no corrosion in the system.

Contaminants

There is a moderate amount of silt (particulates < 14 microns in size) present in the fuel. There is no bacteria or fungus (yeast and/or mold) indicated in the sample. The water content is negligible.

Fuel Condition

Sulfur value derived by ASTM D5453 method for ULSD validation. Sulfur level is acceptable for ULSD specification.

SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	AOL05998328	---	---
Sample Date	Client Info	24 Oct 2023	---	---
Machine Age	hrs Client Info	1667	---	---
Sample Status		NORMAL	---	---

PHYSICAL PROPERTIES

method	limit/base	current	history1	history2
Specific Gravity	*ASTM D1298	0.845	---	---
Fuel Color	text *Visual Screen	Red	---	---
ASTM Color	scalar *ASTM D1500	L4.5	---	---
Visc @ 40°C	cSt ASTM D445	2.23	---	---

SULFUR CONTENT

method	limit/base	current	history1	history2
Sulfur	ppm ASTM D5185m	8	---	---
Sulfur (UVF)	ppm ASTM D5453	14	---	---

DISTILLATION

method	limit/base	current	history1	history2
Initial Boiling Point	°C ASTM D86	158	---	---
5% Distillation Point	°C ASTM D86	184	---	---
10% Distill Point	°C ASTM D86	192	---	---
15% Distillation Point	°C ASTM D86	201	---	---
20% Distill Point	°C ASTM D86	209	---	---
30% Distill Point	°C ASTM D86	221	---	---
40% Distill Point	°C ASTM D86	235	---	---
50% Distill Point	°C ASTM D86	250	---	---
60% Distill Point	°C ASTM D86	265	---	---
70% Distill Point	°C ASTM D86	282	---	---
80% Distill Point	°C ASTM D86	302	---	---
85% Distillation Point	°C ASTM D86	314	---	---
90% Distill Point	°C ASTM D86	329	---	---
95% Distillation Point	°C ASTM D86	350	---	---
Final Boiling Point	°C ASTM D86	357	---	---
Distillation Residue	% ASTM D86	1.4	---	---
Distillation Loss	% ASTM D86	0.8	---	---

IGNITION QUALITY






method	limit/base	current	history1	history2
API Gravity	ASTM D7777	36.0	---	---
Cetane Index	ASTM D4737 <40.0	44.5	---	---

CONTAMINANTS

method	limit/base	current	history1	history2
Silicon	ppm ASTM D5185m <1.0	0	---	---
Sodium	ppm ASTM D5185m <0.1	<1	---	---
Potassium	ppm ASTM D5185m <0.1	0	---	---
Water	% ASTM D6304 <0.05	0.003	---	---
ppm Water	ppm ASTM D6304 <500	39.1	---	---
% Gasoline	% *In-House <0.50	0.0	---	---
% Biodiesel	% *In-House <20.0	0.0	---	---





FUEL REPORT

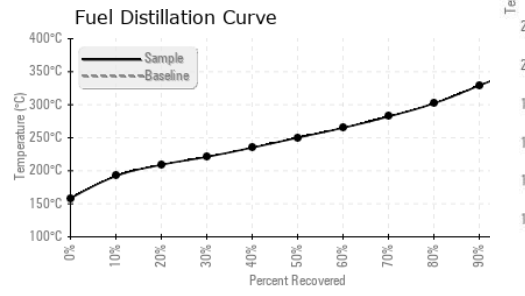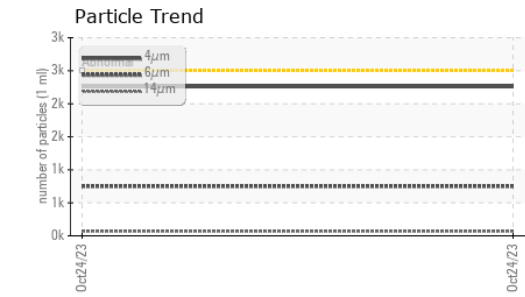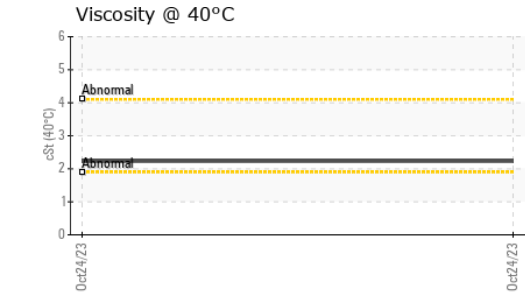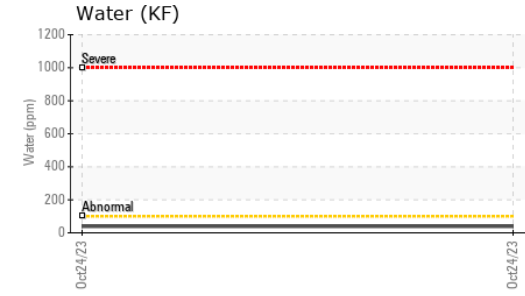
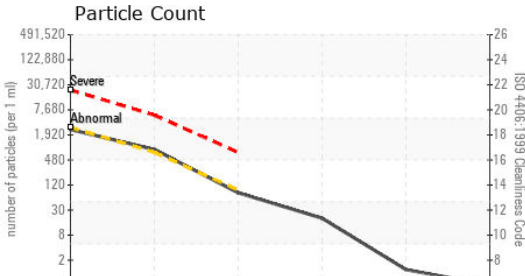


FLUID CLEANLINESS	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	>2500	2259	---	---
Particles >6µm	ASTM D7647	>640	751	---	---
Particles >14µm	ASTM D7647	>80	69	---	---
Particles >21µm	ASTM D7647	>20	17	---	---
Particles >38µm	ASTM D7647	>4	1	---	---
Particles >71µm	ASTM D7647	>3	0	---	---
Oil Cleanliness	ISO 4406 (c)	>18/16/13	18/17/13	---	---

HEAVY METALS	method	limit/base	current	history1	history2
Aluminum	ppm	ASTM D5185m <0.1	0	---	---
Nickel	ppm	ASTM D5185m <0.1	0	---	---
Lead	ppm	ASTM D5185m <0.1	0	---	---
Vanadium	ppm	ASTM D5185m <0.1	0	---	---
Iron	ppm	ASTM D5185m <0.1	0	---	---
Calcium	ppm	ASTM D5185m <0.1	2	---	---
Magnesium	ppm	ASTM D5185m <0.1	0	---	---
Phosphorus	ppm	ASTM D5185m <0.1	2	---	---
Zinc	ppm	ASTM D5185m <0.1	0	---	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
Color				no image	no image
Bottom				no image	no image

GRAPHS

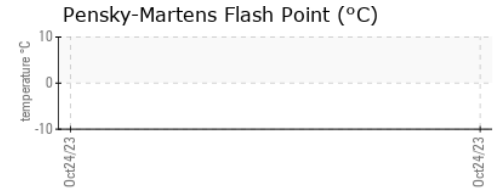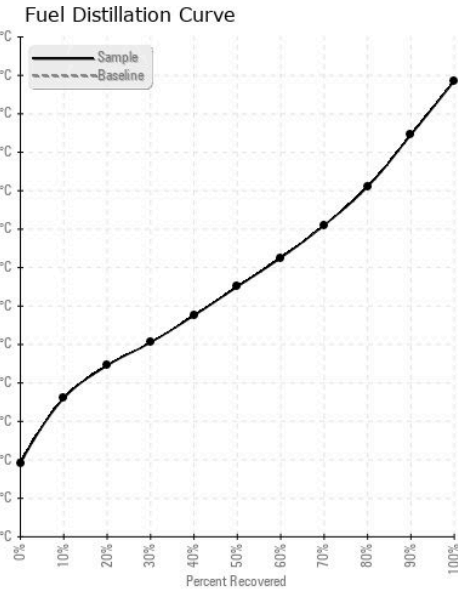

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : AOL05998328 **Received** : 03 Nov 2023
Lab Number : **05998328** **Diagnosed** : 07 Nov 2023
Unique Number : 10726688 **Diagnostician** : Doug Bogart
Test Package : DF-1 (Additional Tests: Screen)

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

APEX OIL LAB
 3956 44th STREET SE
 GRAND RAPIDS, MI
 US 49512
 Contact: JASON RAINEY
 jraine@apexoilab.com
 T: (616)328-6672
 F: (616)828-1791