


# **OIL ANALYSIS REPORT**

Sample Rating Trend





# 7473379 (S/N 1140)

Component

**Compressor** Fluid

KAESER SIGMA (OEM) S-460 (--- GAL)

### Recommendation

Resample at the next service interval to monitor.

All component wear rates are normal.

### Contamination

The amount and size of particulates present in the system are acceptable. There is no indication of any contamination in the oil.

### **Fluid Condition**

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

		Nov2020	Nov2021 Apr2022	Nov2022 Apr2023	Oct2023	
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KC05998439	KC111565	KC111365
Sample Date		Client Info		24 Oct 2023	12 Jul 2023	11 Apr 2023
Machine Age	hrs	Client Info		0	23403	21507
Oil Age	hrs	Client Info		0	5289	3392
Oil Changed		Client Info		N/A	Not Changd	Not Changd
Sample Status				NORMAL	ABNORMAL	ABNORMAL
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0	0	0
Chromium	ppm	ASTM D5185m	>10	0	0	0
Nickel	ppm	ASTM D5185m	>3	0	0	0
Titanium	ppm	ASTM D5185m	>3	0	0	0
Silver	ppm	ASTM D5185m	>2	0	0	0
Aluminum	ppm	ASTM D5185m	>10	0	0	<1
Lead	ppm	ASTM D5185m	>10	0	0	0
Copper	ppm	ASTM D5185m	>50	12	8	5
Tin	ppm	ASTM D5185m	>10	0	0	0
Vanadium	ppm	ASTM D5185m		0	0	0
Cadmium	ppm	ASTM D5185m		0	0	0
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	0
Barium	ppm	ASTM D5185m	90	0	0	0
Molybdenum	ppm	ASTM D5185m		0	0	0
Manganese	ppm	ASTM D5185m		0	0	<1
Magnesium	ppm	ASTM D5185m	90	0	<1	5
Calcium	ppm	ASTM D5185m	2	0	0	0
Phosphorus	ppm	ASTM D5185m		4	1	<1
Zinc	ppm	ASTM D5185m		0	0	0
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	0	0	0
Sodium	ppm	ASTM D5185m		0	<1	<1
Potassium	ppm	ASTM D5185m	>20	0	<1	0
Water	%	ASTM D6304	>0.05	0.005	0.006	0.013
ppm Water	ppm	ASTM D6304	>500	58.4	60.3	139.4
FLUID CLEANLIN	ESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		1044		
Particles >6µm		ASTM D7647	>1300	312		
Particles >14µm		ASTM D7647	>80	48		
Particles >21µm		ASTM D7647	>20	19		
Particles >38µm		ASTM D7647	>4	1		
Particles >71µm		ASTM D7647	>3	0		
Oil Cleanliness		ISO 4406 (c)	>/17/13	17/15/13		
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
	1/011/	4 OT1 4 D 00 4 F	0.4		0.00	

Acid Number (AN)

mg KOH/g ASTM D8045 0.4


0.39

0.39

0.40



## **OIL ANALYSIS REPORT**

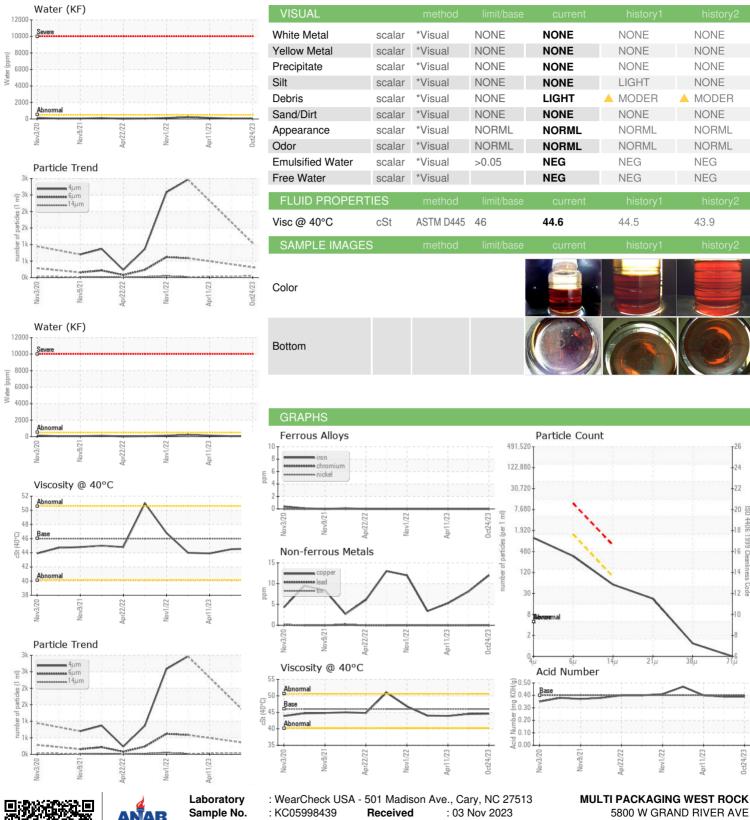





Certificate L2367

Lab Number **Unique Number** 

Test Package

: 05998439 : 10726799 : IND 2

Diagnosed : 07 Nov 2023 : Don Baldridge

Diagnostician

LANSING, MI US 48906

Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T: F: