

OIL ANALYSIS REPORT

Sample Rating Trend





Compressor

KAESER SIGMA (OEM) M-460 (--- GAL)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

The amount and size of particulates present in the system are acceptable. There is no indication of any contamination in the oil.


Fluid Condition


The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.


SAMPLE INFORM	IATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KCPA009453		
Sample Date		Client Info		30 Oct 2023		
Machine Age	hrs	Client Info		3634		
Oil Age	hrs	Client Info		0		
Oil Changed		Client Info		N/A		
Sample Status				NORMAL		
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0		
Chromium	ppm	ASTM D5185m	>10	0		
Nickel	ppm	ASTM D5185m	>3	0		
Titanium	ppm	ASTM D5185m		0		
Silver	ppm	ASTM D5185m	>2	0		
Aluminum	ppm	ASTM D5185m	>10	0		
Lead	ppm	ASTM D5185m	>10	0		
Copper	ppm		>50	1		
Tin	ppm	ASTM D5185m	>10	0		
Vanadium		ASTM D5185m	210	0		
Cadmium	ppm ppm	ASTM D5185m		0		
ADDITIVES	ppm	method	limit/base	current	history1	history2
						TIISTOL ÀZ
Boron	ppm	ASTM D5185m	0	0		
Barium	ppm	ASTM D5185m	90	14		
Molybdenum	ppm	ASTM D5185m	0	0		
Manganese	ppm	ASTM D5185m		0		
Magnesium	ppm	ASTM D5185m	100	64		
Calcium	ppm		0	0		
Phosphorus	ppm	ASTM D5185m	0	0		
Zinc	ppm		0	0		
Sulfur	ppm	ASTM D5185m	23500	17028		
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	0		
Sodium	ppm	ASTM D5185m		16		
Potassium	ppm	ASTM D5185m	>20	5		
Water	%	ASTM D6304	>0.05	0.023		
ppm Water	ppm	ASTM D6304	>500	236.3		
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		2697		
Particles >6µm		ASTM D7647	>1300	912		
Particles >14µm		ASTM D7647	>80	61		
Particles >21µm		ASTM D7647	>20	13		
Particles >38µm		ASTM D7647	>4	0		
Particles >71µm		ASTM D7647	>3	0		
Oil Cleanliness		ISO 4406 (c)	>/17/13	19/17/13		
FLUID DEGRADA		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	1.0	0.34		



OIL ANALYSIS REPORT





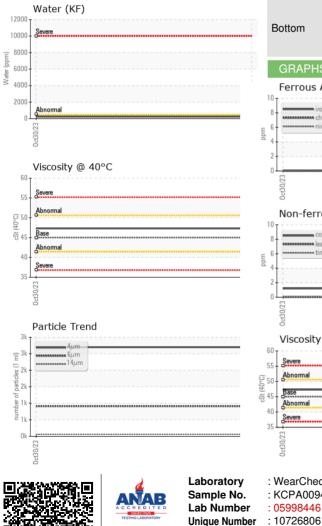

VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE		
Yellow Metal	scalar	*Visual	NONE	NONE		
Precipitate	scalar	*Visual	NONE	NONE		
Silt	scalar	*Visual	NONE	NONE		
Debris	scalar	*Visual	NONE	NONE		
Sand/Dirt	scalar	*Visual	NONE	NONE		
Appearance	scalar	*Visual	NORML	NORML		
Odor	scalar	*Visual	NORML	NORML		
Emulsified Water	scalar	*Visual	>0.05	NEG		
Free Water	scalar	*Visual		NEG		
FLUID PROPER	TIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	45	47.3		
SAMPLE IMAGE	S	method	limit/base	current	history1	history2
Color					no image	no image
Bottom					no image	no image
GRAPHS						
Ferrous Alloys				Particle Coun	t	
			491,52	^D T		T ²⁶
8 - iron			122,88			-24
6 nickel						
2			30,72	1		-22
<u></u>			7,68	D-		-20
0ct30/23			0ct30/23 . (per 1 ml)			-18
Oct			S [per		N	+10
Non-ferrous Meta	ls		apitred 48			-16
copper			1200 1201 1201 1201 1201 1201 1201 1201			-18 -16 -14
second lead						12
			3	-		-12
2-				Bieresemal		-10
				2	/	-8
0ct30/23			ct30/			
0			Ő	0 4μ 6μ	14µ 21µ	38µ 71µ
Viscosity @ 40°C				Acid Number		
			-1.2	J _T		
Severe			(B) 1.2 (B) HO 0.9	Basermal		
0 - Severe 5 - Abnormal			(5)HO 0.9 B 0.7	Alexermal		
Severe Abnormal Base			(C)HO 0.9 (C)HO	Baseormal		
Severe			(9,HO) BU 0.7 W 0.9 GHO 0.9 GHO 0.4 M 0.4 V 0.2 V 0.0	2 2 4		

0ct30/23 .

0ct30/73

: WearCheck USA - 501 Madison Ave., Cary, NC 27513 AMAZON.COM SERVICES LLC CMH7 : 03 Nov 2023 1245 BEECH RD : 07 Nov 2023 NEW ALBANY, OH Diagnostician : Don Baldridge US 43062 Contact: Service Manager stepearc@amazon.com Т: F:



To discuss this sample report, contact Customer Service at 1-800-237-1369. * - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Test Package : IND 2 (Additional Tests: KF, PrtCount)

Received

Diagnosed

: KCPA009453

: 05998446

Certificate L2367