



PROBLEM SUMMARY

Sample Rating Trend




ISO



Machine Id
KAESER ASD 40S 6911200 (S/N 1075)
 Component
Compressor
 Fluid
KAESER SIGMA (OEM) M-460 (--- GAL)

COMPONENT CONDITION SUMMARY

▲ Particle Trend

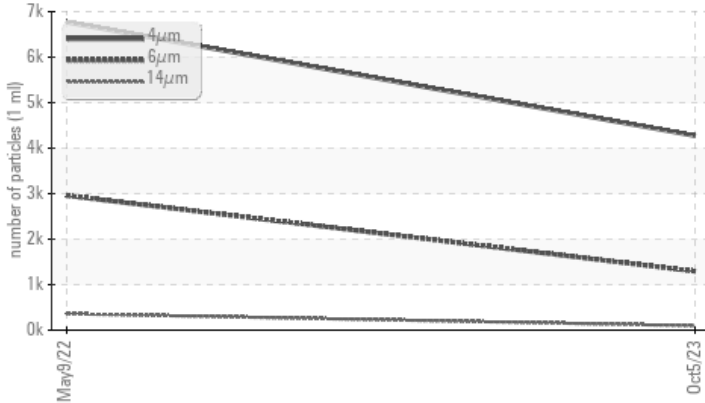

RECOMMENDATION

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

PROBLEMATIC TEST RESULTS

Sample Status			ATTENTION	ABNORMAL	---
Particles >14µm	ASTM D7647	>80	▲ 96	▲ 360	---
Particles >21µm	ASTM D7647	>20	▲ 23	▲ 55	---
Oil Cleanliness	ISO 4406 (c)	>--/17/13	▲ 19/17/14	▲ 20/19/16	---

Customer Id: LAFBEL
 Sample No.: KCPA000512
 Lab Number: 05998455
 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:
 Don Baldrige +1
don.b505@comcast.net

To change component or sample information:
 Customer Service +1 1-800-237-1369
customerservice@wearcheck.com

RECOMMENDED ACTIONS

There are no recommended actions for this sample.

HISTORICAL DIAGNOSIS

09 May 2022 Diag: Angela Borella

ISO




Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor. All component wear rates are normal. There is a high amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



OIL ANALYSIS REPORT

Sample Rating Trend

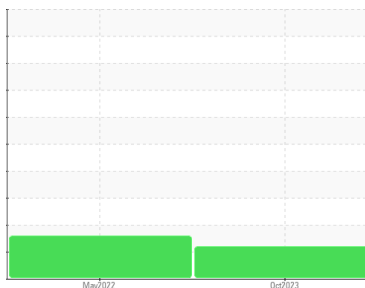

ISO



Machine Id
KAESER ASD 40S 6911200 (S/N 1075)

Component
Compressor

Fluid
KAESER SIGMA (OEM) M-460 (--- GAL)

DIAGNOSIS

▲ Recommendation

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

▲ Contamination

There is a moderate amount of particulates present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	KCPA000512	KCP44335	---
Sample Date	Client Info	05 Oct 2023	09 May 2022	---
Machine Age	hrs	9889	6438	---
Oil Age	hrs	0	6438	---
Oil Changed	Client Info	N/A	Changed	---
Sample Status		ATTENTION	ABNORMAL	---

WEAR METALS

method	limit/base	current	history1	history2	
Iron	ppm	ASTM D5185m >50	0	<1	---
Chromium	ppm	ASTM D5185m >10	0	0	---
Nickel	ppm	ASTM D5185m >3	0	0	---
Titanium	ppm	ASTM D5185m >3	0	0	---
Silver	ppm	ASTM D5185m >2	0	<1	---
Aluminum	ppm	ASTM D5185m >10	0	<1	---
Lead	ppm	ASTM D5185m >10	0	0	---
Copper	ppm	ASTM D5185m >50	8	6	---
Tin	ppm	ASTM D5185m >10	0	0	---
Vanadium	ppm	ASTM D5185m	0	0	---
Cadmium	ppm	ASTM D5185m	0	0	---

ADDITIVES

method	limit/base	current	history1	history2	
Boron	ppm	ASTM D5185m 0	0	0	---
Barium	ppm	ASTM D5185m 90	0	0	---
Molybdenum	ppm	ASTM D5185m 0	0	0	---
Manganese	ppm	ASTM D5185m	0	<1	---
Magnesium	ppm	ASTM D5185m 100	20	36	---
Calcium	ppm	ASTM D5185m 0	0	0	---
Phosphorus	ppm	ASTM D5185m 0	0	3	---
Zinc	ppm	ASTM D5185m 0	57	70	---
Sulfur	ppm	ASTM D5185m 23500	18007	15566	---

CONTAMINANTS

method	limit/base	current	history1	history2	
Silicon	ppm	ASTM D5185m >25	<1	0	---
Sodium	ppm	ASTM D5185m	11	12	---
Potassium	ppm	ASTM D5185m >20	4	0	---
Water	%	ASTM D6304 >0.05	0.013	0.010	---
ppm Water	ppm	ASTM D6304 >500	131.7	102.6	---






FLUID CLEANLINESS

method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	4272	6769	---
Particles >6µm	ASTM D7647 >1300	1293	▲ 2957	---
Particles >14µm	ASTM D7647 >80	▲ 96	▲ 360	---
Particles >21µm	ASTM D7647 >20	▲ 23	▲ 55	---
Particles >38µm	ASTM D7647 >4	1	2	---
Particles >71µm	ASTM D7647 >3	0	0	---
Oil Cleanliness	ISO 4406 (c) >--/17/13	▲ 19/17/14	▲ 20/19/16	---

FLUID DEGRADATION

method	limit/base	current	history1	history2	
Acid Number (AN)	mg KOH/g	ASTM D8045 1.0	0.36	0.39	---


OIL ANALYSIS REPORT

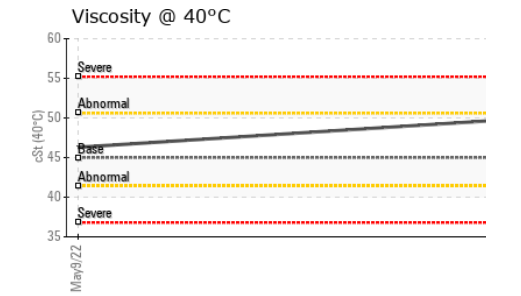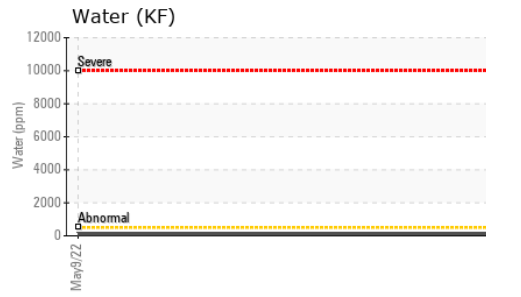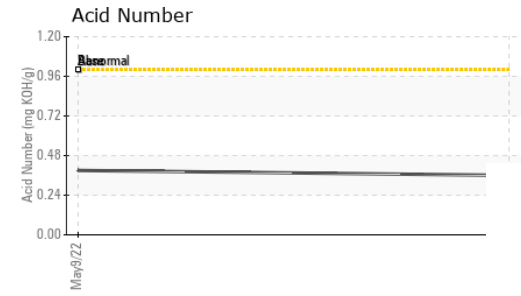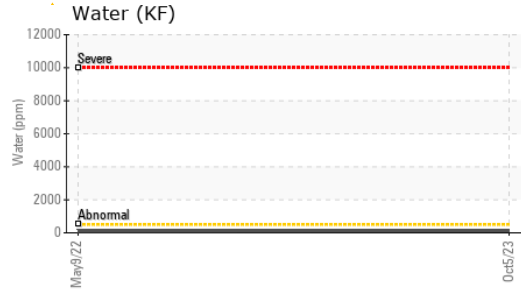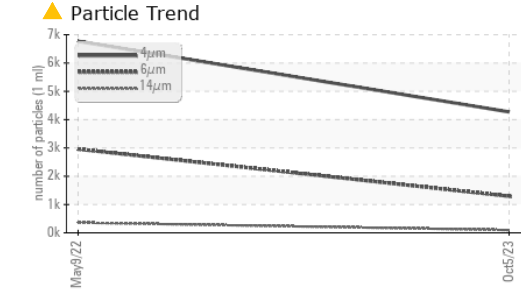





PARAMETER	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	---
Yellow Metal	scalar	*Visual	NONE	NONE	---
Precipitate	scalar	*Visual	NONE	NONE	---
Silt	scalar	*Visual	NONE	NONE	---
Debris	scalar	*Visual	NONE	NONE	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---
Appearance	scalar	*Visual	NORML	NORML	---
Odor	scalar	*Visual	NORML	NORML	---
Emulsified Water	scalar	*Visual	>0.05	NEG	---
Free Water	scalar	*Visual		NEG	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	45	49.8	46.3

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

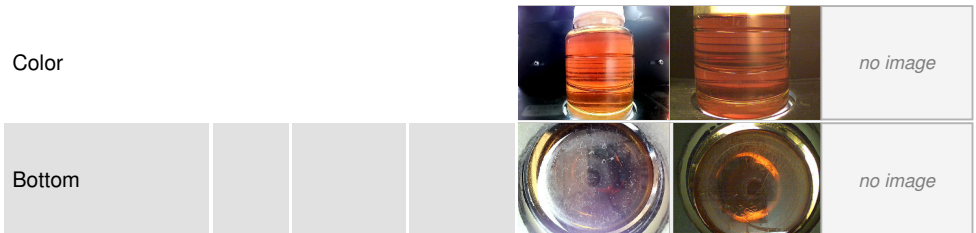

GRAPHS

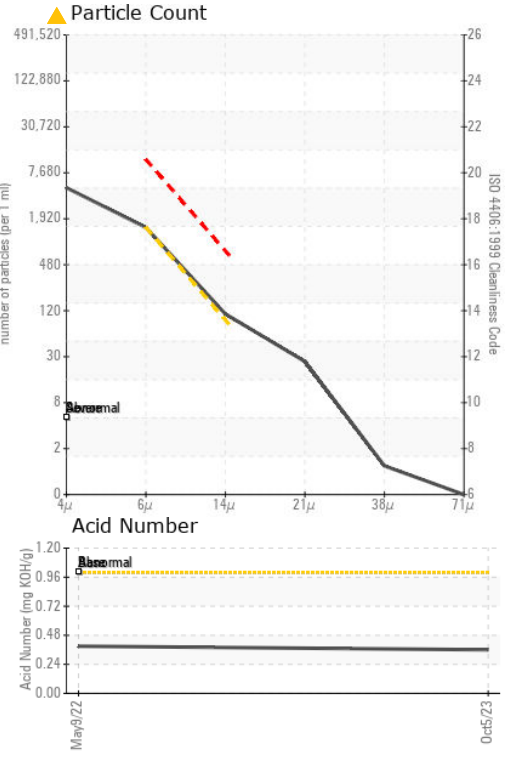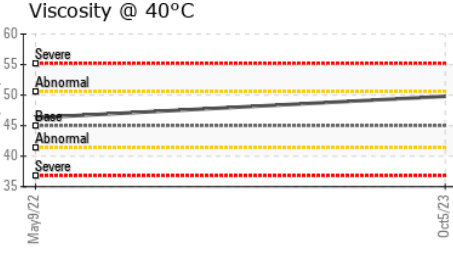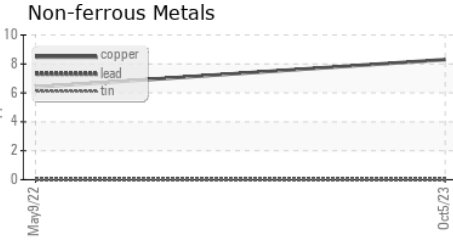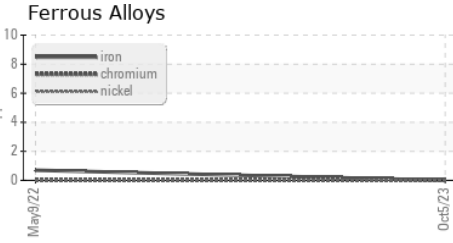

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : KCPA000512 **Received** : 03 Nov 2023
Lab Number : 05998455 **Diagnosed** : 07 Nov 2023
Unique Number : 10726815 **Diagnostician** : Don Baldrige
Test Package : IND 2 (Additional Tests: KF, PrtCount)

LAFARGE NORTH AMERICA
 1684 STATE ROUTE 618
 BELPRE, OH
 US 45714
 Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:
F: