




# OIL ANALYSIS REPORT

Sample Rating Trend

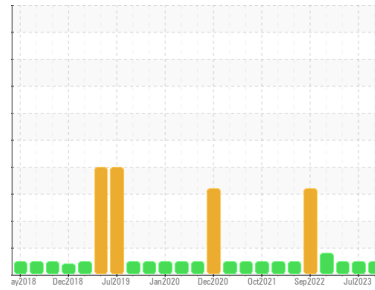

**NORMAL**



Machine Id  
**ATLAS COPCO ATLAS 2 (S/N API625587)**  
 Component  
**Air Compressor**  
 Fluid  
**USPI AIR 46 (--- GAL)**

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>USPM31153</b>	USPM27487	USPR000664
Sample Date	Client Info		<b>02 Nov 2023</b>	12 Jul 2023	05 Apr 2023
Machine Age	hrs	Client Info	<b>0</b>	0	0
Oil Age	hrs	Client Info	<b>0</b>	0	0
Oil Changed	Client Info		<b>N/A</b>	N/A	N/A
Sample Status			<b>NORMAL</b>	NORMAL	NORMAL

## WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >50	<b>0</b>	1	<1
Chromium	ppm	ASTM D5185m >4	<b>0</b>	<1	0
Nickel	ppm	ASTM D5185m >4	<b>0</b>	<1	0
Titanium	ppm	ASTM D5185m	<b>0</b>	<1	0
Silver	ppm	ASTM D5185m	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m >10	<b>0</b>	<1	1
Lead	ppm	ASTM D5185m >20	<b>0</b>	<1	0
Copper	ppm	ASTM D5185m >40	<b>0</b>	<1	0
Tin	ppm	ASTM D5185m >5	<b>0</b>	1	0
Vanadium	ppm	ASTM D5185m	<b>0</b>	<1	0
Cadmium	ppm	ASTM D5185m	<b>0</b>	<1	0

## ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m 0	<b>0</b>	0	0
Barium	ppm	ASTM D5185m 0	<b>0</b>	0	0
Molybdenum	ppm	ASTM D5185m 0	<b>0</b>	<1	0
Manganese	ppm	ASTM D5185m	<b>0</b>	<1	<1
Magnesium	ppm	ASTM D5185m 0	<b>0</b>	0	1
Calcium	ppm	ASTM D5185m 0	<b>0</b>	<1	2
Phosphorus	ppm	ASTM D5185m 1	<b>5</b>	7	6
Zinc	ppm	ASTM D5185m 0	<b>0</b>	0	0
Sulfur	ppm	ASTM D5185m 0	<b>0</b>	5	0

## CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >25	<b>0</b>	1	<1
Sodium	ppm	ASTM D5185m	<b>0</b>	1	0
Potassium	ppm	ASTM D5185m >20	<b>0</b>	2	0
Water	%	ASTM D6304 >0.2	<b>0.143</b>	0.119	0.132
ppm Water	ppm	ASTM D6304 >2000	<b>1430.6</b>	1195.0	1322.1

## FLUID CLEANLINESS






	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	>10000	<b>9242</b>	447	533
Particles >6µm	ASTM D7647	>2500	<b>287</b>	101	107
Particles >14µm	ASTM D7647	>320	<b>17</b>	12	13
Particles >21µm	ASTM D7647	>80	<b>6</b>	5	2
Particles >38µm	ASTM D7647	>20	<b>1</b>	1	0
Particles >71µm	ASTM D7647	>4	<b>0</b>	0	0
Oil Cleanliness	ISO 4406 (c)	>20/18/15	<b>20/15/11</b>	16/14/11	16/14/11

## FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045 0.05	<b>0.40</b>	0.35	0.28




# OIL ANALYSIS REPORT

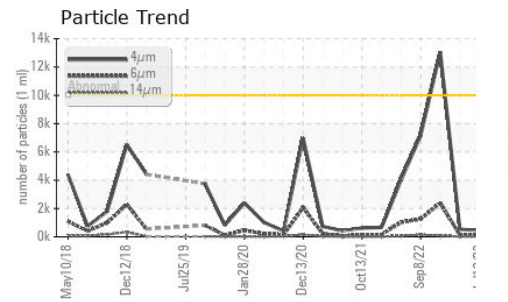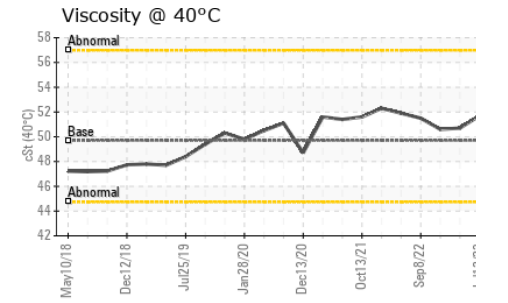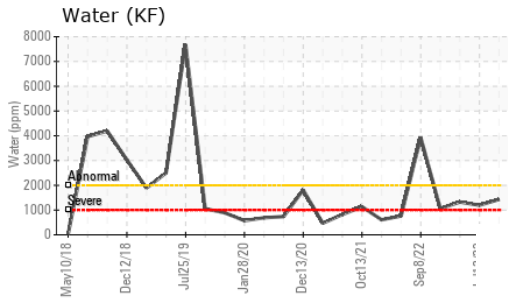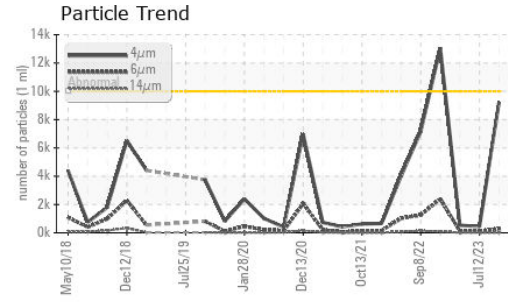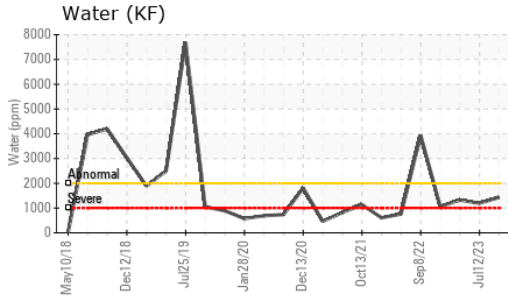






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	<b>NONE</b>	NONE
Yellow Metal	scalar	*Visual	NONE	<b>NONE</b>	NONE
Precipitate	scalar	*Visual	NONE	<b>NONE</b>	NONE
Silt	scalar	*Visual	NONE	<b>NONE</b>	NONE
Debris	scalar	*Visual	NONE	<b>NONE</b>	NONE
Sand/Dirt	scalar	*Visual	NONE	<b>NONE</b>	NONE
Appearance	scalar	*Visual	NORML	<b>NORML</b>	NORML
Odor	scalar	*Visual	NORML	<b>NORML</b>	NORML
Emulsified Water	scalar	*Visual	>0.2	<b>NEG</b>	NEG
Free Water	scalar	*Visual		<b>NEG</b>	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	49.7	<b>52.8</b>	51.7

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

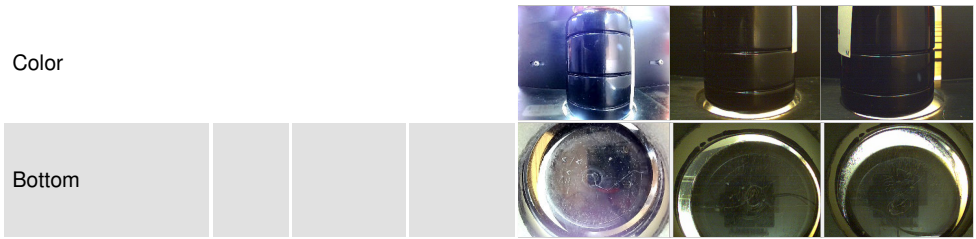

## GRAPHS

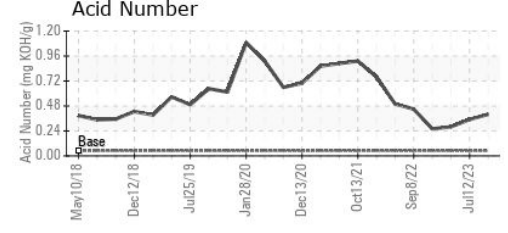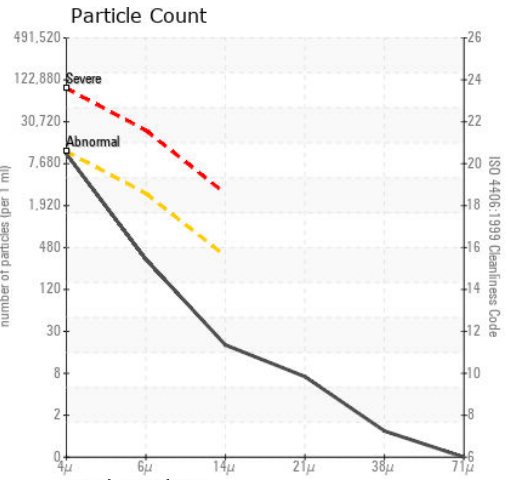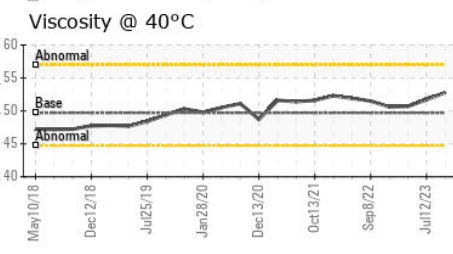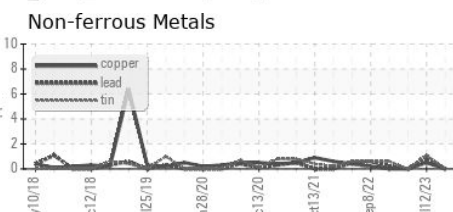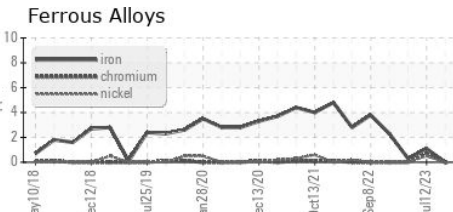

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : USPM31153  
**Lab Number** : 05998470  
**Unique Number** : 10726830  
**Test Package** : IND 2

**TYSON-HOUSTON-USP-TYSHOUPOR**  
 300 PORTWELL RD.  
 HOUSTON, TX  
 US 77029  
 Contact: SERVICE MANAGER

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:  
F: