




PROBLEM SUMMARY

Sample Rating Trend

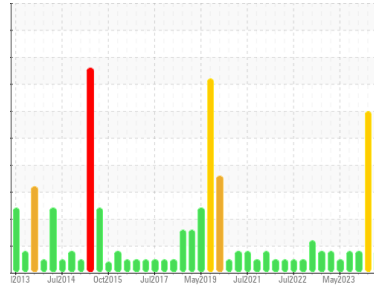


WEAR



Area
BLEACH O2
Machine Id
BX060 POST02 PRESS SW (S/N 0661-03-02-040-040)
Component
Bearing
Fluid
Bearing Oil (4 GAL)

COMPONENT CONDITION SUMMARY

▲ Ferrous Alloys

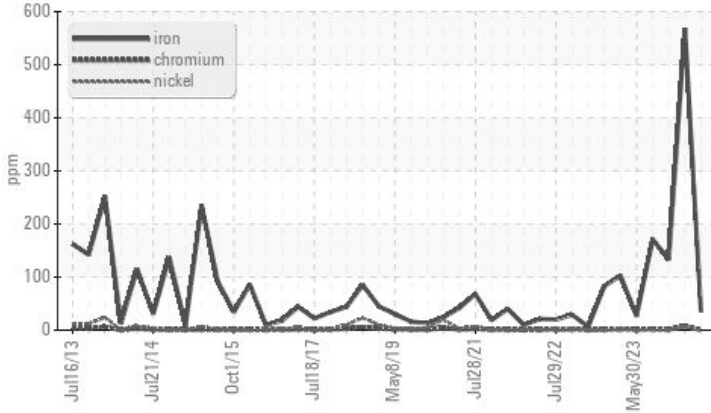

RECOMMENDATION

No corrective action is recommended at this time.
Resample at the next service interval to monitor.

PROBLEMATIC TEST RESULTS

Sample Status				ABNORMAL	SEVERE	ABNORMAL
Iron	ppm	ASTM D5185m	>20	▲ 35	● 568	▲ 133

Customer Id: INTRIERP
Sample No.: WC0851761
Lab Number: 05998492
Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:
Don Baldrige +1
don.b505@comcast.net

To change component or sample information:
Customer Service +1 1-800-237-1369
customerservice@wearcheck.com

RECOMMENDED ACTIONS

There are no recommended actions for this sample.

HISTORICAL DIAGNOSIS

09 Oct 2023 Diag: Doug Bogart

WEAR



We advise that you inspect for the source(s) of wear. We recommend an early resample to monitor this condition. The iron level is severe. There is no indication of any contamination in the oil. The AN level is acceptable for this fluid.

view report



17 Aug 2023 Diag: Doug Bogart

WEAR



We recommend an early resample to monitor this condition. The iron level is abnormal. All other component wear rates are normal. There is no indication of any contamination in the oil. The AN level is acceptable for this fluid.

view report



24 Jul 2023 Diag: Doug Bogart

WEAR



We recommend an early resample to monitor this condition. The iron level is abnormal. All other component wear rates are normal. There is no indication of any contamination in the oil. The AN level is acceptable for this fluid.


view report





OIL ANALYSIS REPORT

Sample Rating Trend

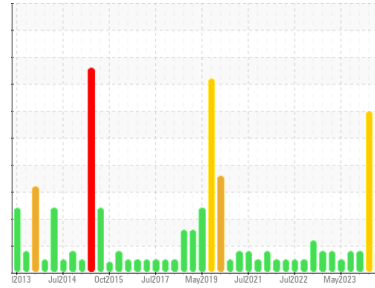

WEAR



Area
BLEACH O2
 Machine Id
BX060 POST02 PRESS SW (S/N 0661-03-02-040-040)
 Component
Bearing
 Fluid
Bearing Oil (4 GAL)

DIAGNOSIS

▲ Recommendation

No corrective action is recommended at this time. Resample at the next service interval to monitor.

▲ Wear

The iron level has decreased, but is still abnormal. All other component wear rates are normal.

Contamination

There is no indication of any contamination in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		WC0851761	WC0760573	WC0760568
Sample Date	Client Info		01 Nov 2023	09 Oct 2023	17 Aug 2023
Machine Age	mls	Client Info	0	0	0
Oil Age	mls	Client Info	0	0	0
Oil Changed	Client Info		N/A	N/A	N/A
Sample Status			ABNORMAL	SEVERE	ABNORMAL

WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >20	▲ 35	568	▲ 133
Chromium	ppm	ASTM D5185m >20	0	8	1
Nickel	ppm	ASTM D5185m >20	0	6	<1
Titanium	ppm	ASTM D5185m	0	0	0
Silver	ppm	ASTM D5185m	0	0	0
Aluminum	ppm	ASTM D5185m >20	0	0	<1
Lead	ppm	ASTM D5185m >20	0	0	0
Copper	ppm	ASTM D5185m >20	0	<1	<1
Tin	ppm	ASTM D5185m >20	0	0	0
Vanadium	ppm	ASTM D5185m	0	0	<1
Cadmium	ppm	ASTM D5185m	0	0	<1

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	<1	0
Barium	ppm	ASTM D5185m	0	0	0
Molybdenum	ppm	ASTM D5185m	0	<1	0
Manganese	ppm	ASTM D5185m	0	6	2
Magnesium	ppm	ASTM D5185m	0	<1	<1
Calcium	ppm	ASTM D5185m	0	2	1
Phosphorus	ppm	ASTM D5185m	448	504	512
Zinc	ppm	ASTM D5185m	0	2	<1
Sulfur	ppm	ASTM D5185m	13373	17512	18264

CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >15	6	13	8
Sodium	ppm	ASTM D5185m	<1	1	2
Potassium	ppm	ASTM D5185m >20	0	<1	1

FLUID DEGRADATION




	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.88	0.70	0.85

VISUAL

	method	limit/base	current	history1	history2
White Metal	scalar	*Visual NONE	LIGHT	NONE	NONE
Yellow Metal	scalar	*Visual NONE	NONE	NONE	NONE
Precipitate	scalar	*Visual NONE	NONE	NONE	NONE
Silt	scalar	*Visual NONE	NONE	NONE	NONE
Debris	scalar	*Visual NONE	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual NONE	NONE	NONE	NONE
Appearance	scalar	*Visual NORML	NORML	NORML	NORML
Odor	scalar	*Visual NORML	NORML	NORML	NORML
Emulsified Water	scalar	*Visual >2	NEG	0.2%	NEG
Free Water	scalar	*Visual	NEG	NEG	NEG




OIL ANALYSIS REPORT


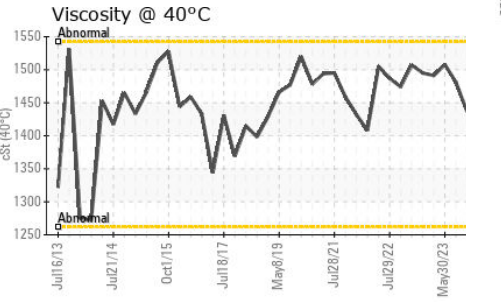
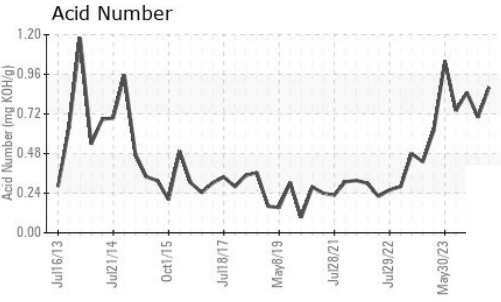
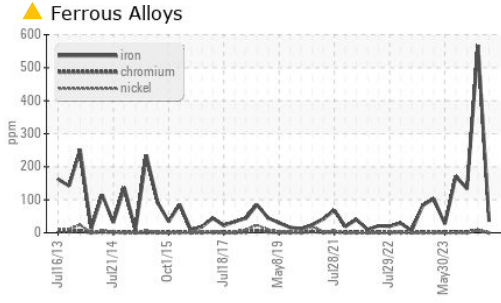


FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	1485	1438	1437.

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

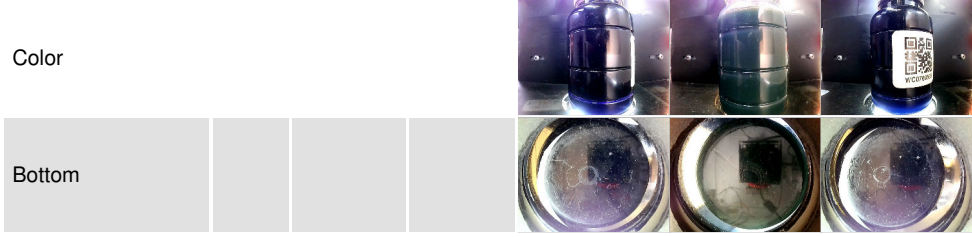

GRAPHS

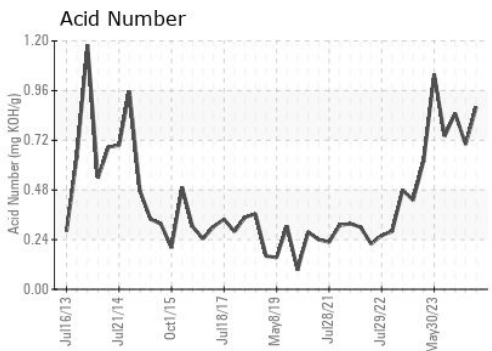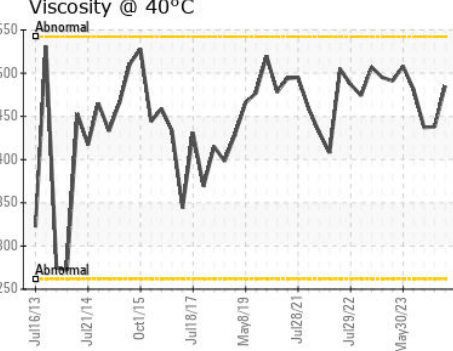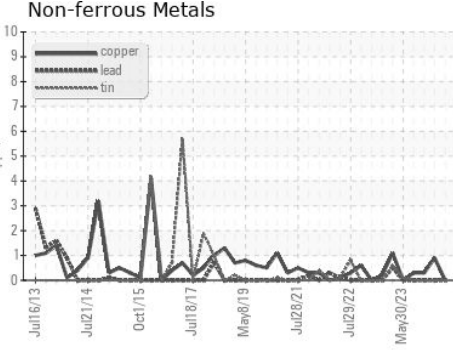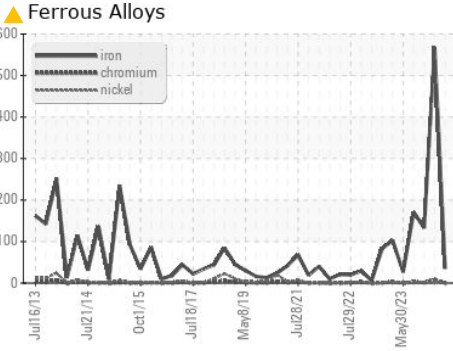

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : WC0851761 **Received** : 03 Nov 2023
Lab Number : **05998492** **Diagnosed** : 07 Nov 2023
Unique Number : 10726852 **Diagnostician** : Don Baldrige
Test Package : IND 2

INTERNATIONAL PAPER
 865 JOHN L REGEL RD
 RIEGELWOOD, NC
 US 28456
 Contact: Zach Lizana
 zachary.lizana@ipaper.com
 T: (910)362-4775
 F:

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)