



OIL ANALYSIS REPORT

Sample Rating Trend

ISO



Area
[175674-N2STV4W]
 Machine Id
100-04
 Component
Hydraulic System
 Fluid
CHEVRON RANDO HD 46 (--- GAL)



DIAGNOSIS

Recommendation
 No corrective action is recommended at this time. Resample at the next service interval to monitor.

Wear
 All component wear rates are normal.

Contamination
 There is a moderate amount of silt (particulates < 14 microns in size) present in the oil. The system cleanliness is above the acceptable limit for the target ISO 4406 cleanliness code.

Fluid Condition
 The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	PH05999036	---	---
Sample Date	Client Info	05 Nov 2023	---	---
Machine Age	hrs Client Info	0	---	---
Oil Age	hrs Client Info	0	---	---
Oil Changed	Client Info	N/A	---	---
Sample Status		ATTENTION	---	---

CONTAMINATION

method	limit/base	current	history1	history2
Water	WC Method >0.05	NEG	---	---

WEAR METALS

method	limit/base	current	history1	history2
Iron	ppm ASTM D5185m >20	0	---	---
Chromium	ppm ASTM D5185m >20	0	---	---
Nickel	ppm ASTM D5185m >20	0	---	---
Titanium	ppm ASTM D5185m	0	---	---
Silver	ppm ASTM D5185m	0	---	---
Aluminum	ppm ASTM D5185m >20	0	---	---
Lead	ppm ASTM D5185m >20	0	---	---
Copper	ppm ASTM D5185m >20	0	---	---
Tin	ppm ASTM D5185m >20	0	---	---
Vanadium	ppm ASTM D5185m	0	---	---
Cadmium	ppm ASTM D5185m	0	---	---

ADDITIVES

method	limit/base	current	history1	history2
Boron	ppm ASTM D5185m	0	---	---
Barium	ppm ASTM D5185m	0	---	---
Molybdenum	ppm ASTM D5185m	0	---	---
Manganese	ppm ASTM D5185m	0	---	---
Magnesium	ppm ASTM D5185m	<1	---	---
Calcium	ppm ASTM D5185m	57	---	---
Phosphorus	ppm ASTM D5185m	308	---	---
Zinc	ppm ASTM D5185m	387	---	---
Sulfur	ppm ASTM D5185m	668	---	---

CONTAMINANTS


method	limit/base	current	history1	history2
Silicon	ppm ASTM D5185m >15	0	---	---
Sodium	ppm ASTM D5185m	<1	---	---
Potassium	ppm ASTM D5185m >20	0	---	---

FLUID CLEANLINESS

method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647 >10000	10570	---	---
Particles >6µm	ASTM D7647 >2500	2581	---	---
Particles >14µm	ASTM D7647 >320	120	---	---
Particles >21µm	ASTM D7647 >80	27	---	---
Particles >38µm	ASTM D7647 >20	0	---	---
Particles >71µm	ASTM D7647 >4	0	---	---
Oil Cleanliness	ISO 4406 (c) >20/18/15	21/19/14	---	---





FLUID DEGRADATION

method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g ASTM D8045	0.37	---	---

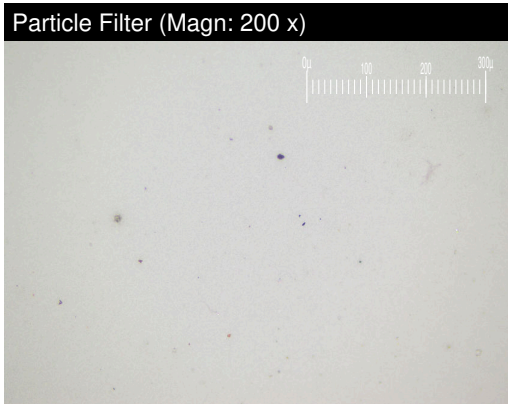



OIL ANALYSIS REPORT

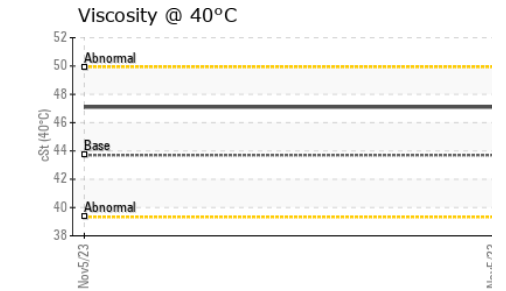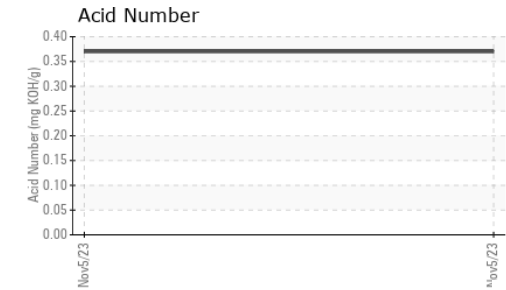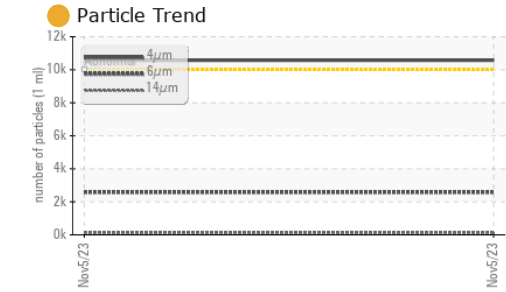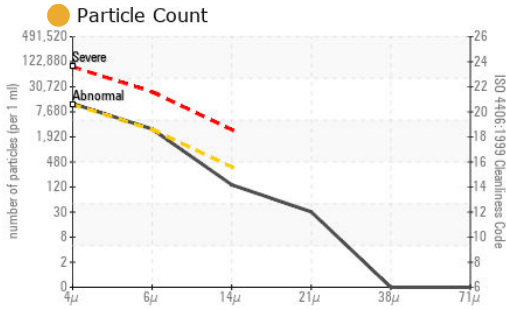






VISUAL	method	limit/base	current	history1	history2	
White Metal	scalar	*Visual	NONE	NONE	---	---
Yellow Metal	scalar	*Visual	NONE	NONE	---	---
Precipitate	scalar	*Visual	NONE	NONE	---	---
Silt	scalar	*Visual	NONE	NONE	---	---
Debris	scalar	*Visual	NONE	NONE	---	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---	---
Appearance	scalar	*Visual	NORML	NORML	---	---
Odor	scalar	*Visual	NORML	NORML	---	---
Emulsified Water	scalar	*Visual	>0.05	NEG	---	---
Free Water	scalar	*Visual		NEG	---	---

FLUID PROPERTIES	method	limit/base	current	history1	history2	
Visc @ 40°C	cSt	ASTM D445	43.7	47.1	---	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

Color				no image	no image
Bottom				no image	no image
PrtFilter				no image	no image

GRAPHS

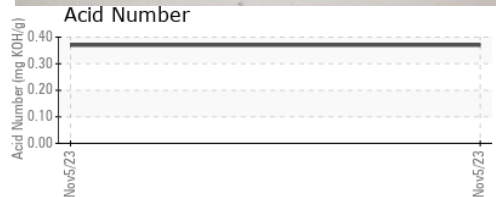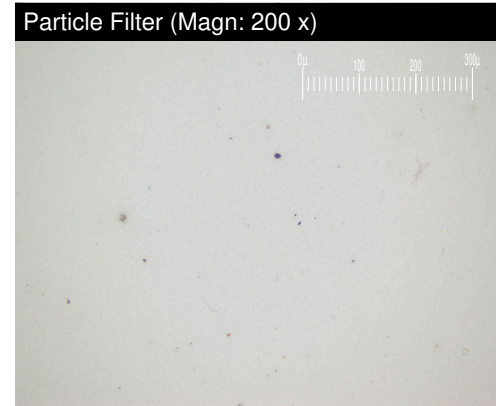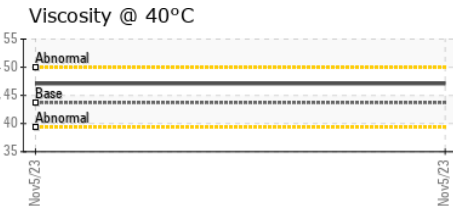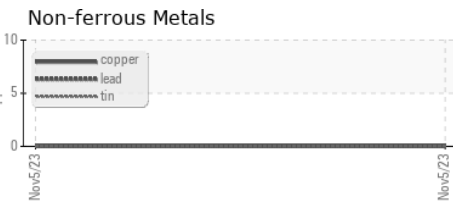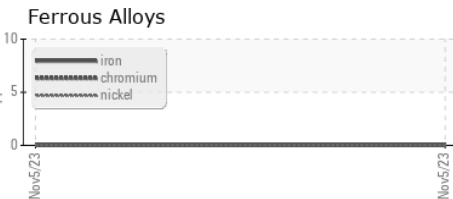

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : PH05999036 **Received** : 06 Nov 2023
Lab Number : 05999036 **Tested** : 08 Nov 2023
Unique Number : 10727396 **Diagnosed** : 08 Nov 2023 - Jonathan Hester
Test Package : PLANT (Additional Tests: PrtFilter)

PARKER HANNIFIN
 1440 N 24TH ST
 MANITOWOC, WI
 US 54220
 Contact: RAE MONKA
 rae.monka@parker.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:
F: