


# **OIL ANALYSIS REPORT**

# NOT GIVEN ATLAS COPCO API629143 - FABRIKAL HP 4

Component

Compressor





### Recommendation

Resample at the next service interval to monitor. Please specify the brand, type, and viscosity of the oil on your next sample.

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the


### **Fluid Condition**

The condition of the oil is acceptable for the time in

				Sep2023		
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		UCH05999100		
Sample Date		Client Info		20 Sep 2023		
Machine Age	hrs	Client Info		18722		
Oil Age	hrs	Client Info		5377		
Oil Changed	0	Client Info		Not Changd		
Sample Status				NORMAL		
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0		
Chromium	ppm	ASTM D5185m	>5	0		
Nickel	ppm	ASTM D5185m		0		
Titanium	ppm	ASTM D5185m		0		
Silver	ppm	ASTM D5185m		0		
Aluminum	ppm	ASTM D5185m	>15	<1		
Lead	ppm	ASTM D5185m	>65	0		
Copper	ppm	ASTM D5185m	>65	8		
Tin	ppm	ASTM D5185m	>10	0		
Vanadium	ppm	ASTM D5185m		0		
Cadmium	ppm	ASTM D5185m		0		
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0		
Barium	ppm	ASTM D5185m		0		
Molybdenum	ppm	ASTM D5185m		0		
Manganese	ppm	ASTM D5185m		0		
Magnesium	ppm	ASTM D5185m		0		
Calcium	ppm	ASTM D5185m		2		
Phosphorus	ppm	ASTM D5185m		74		
Zinc	ppm	ASTM D5185m		13		
Sulfur	ppm	ASTM D5185m		0		
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>35	0		
Sodium	ppm	ASTM D5185m	700	1		
Potassium	ppm	ASTM D5185m	>20	0		
FLUID DEGRADA		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	IIIIII/base	1.38	Thistory I	1115t01 y 2
VISUAL	ang NOTING	method	limit/base	current	history1	history2
White Metal	cooler		NONE	NONE	,	
Yellow Metal	scalar	*Visual		NONE		
Precipitate	scalar		NONE NONE	NONE		
Silt	scalar	*Visual	NONE	NONE		
Debris	scalar	*Visual	NONE	NONE		
Sand/Dirt	scalar scalar	*Visual	NONE	NONE		
			NORML			
Appearance Odor	scalar	*Visual	NORML	NORML NORML		
Emulsified Water	scalar	*Visual		NEG		
Free Water	scalar	*Visual	>0.1	NEG		
i iee vvalei	scalar	visual		NEG		



## **OIL ANALYSIS REPORT**

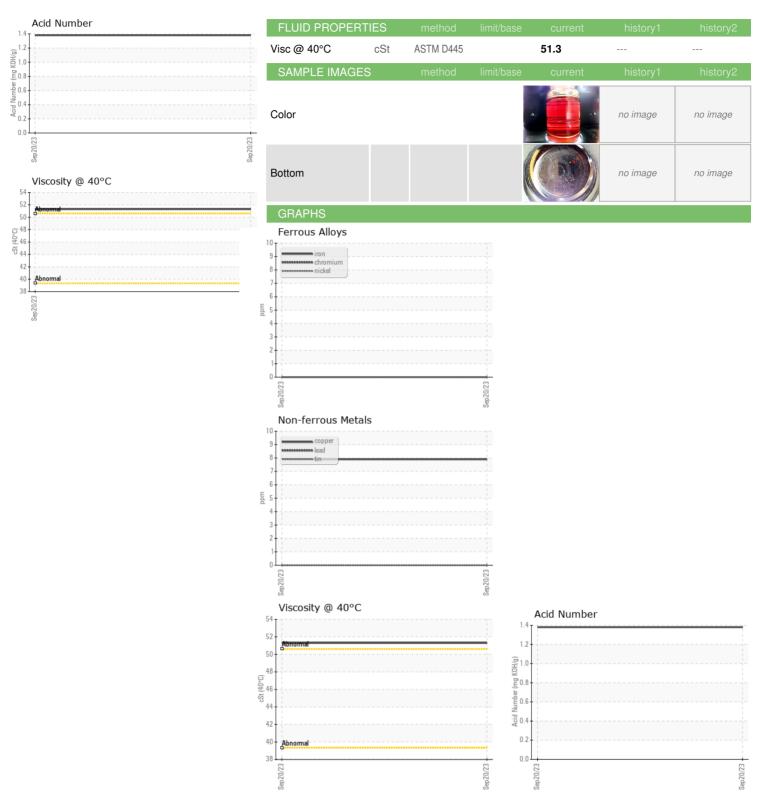





Certificate L2367

Laboratory Sample No. Lab Number Unique Number : 10727460

: UCH05999100 : 05999100 Test Package : IND 2

: WearCheck USA - 501 Madison Ave., Cary, NC 27513 Received : 06 Nov 2023 Diagnosed : 07 Nov 2023 Diagnostician : Angela Borella

**DIRECT AIR - AIR TECHNOLOGIES** 

400 WRIGHT AVE MIDDLETOWN, OH US 45044

Contact: DAVID DUNCAN david.duncan@aircompressors.com

T: (502)254-2520 F: (513)539-6040

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)