



# PROBLEM SUMMARY

Sample Rating Trend




DEGRADATION



Area  
**PLUS 10**  
 Machine Id  
**ATLAS COPCO API621845**  
 Component  
**Compressor**

## COMPONENT CONDITION SUMMARY

### ▲ Acid Number

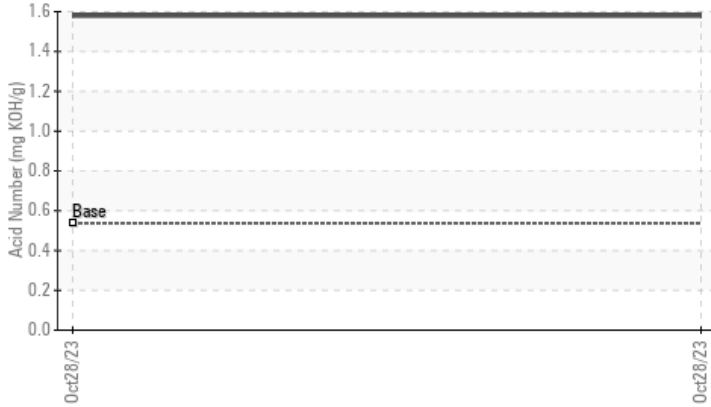

## RECOMMENDATION

Resample at the next service interval to monitor.

## PROBLEMATIC TEST RESULTS

Sample Status	ABNORMAL		---	---		
Acid Number (AN)	mg KOH/g	ASTM D8045	0.537	▲ 1.58	---	---

Customer Id: UCDIRMID  
 Sample No.: UCH05999111  
 Lab Number: 05999111  
 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:  
 Angela Borella +1 800-237-1369  
[angela.borella@wearcheckusa.com](mailto:angela.borella@wearcheckusa.com)

To change component or sample information:  
 Customer Service +1 1-800-237-1369  
[customerservice@wearcheck.com](mailto:customerservice@wearcheck.com)

## RECOMMENDED ACTIONS

*There are no recommended actions for this sample.*

## HISTORICAL DIAGNOSIS



# OIL ANALYSIS REPORT

Sample Rating Trend

DEGRADATION

Area  
**PLUS 10**  
 Machine Id  
**ATLAS COPCO API621845**  
 Component  
**Compressor**



## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the oil.

### Fluid Condition

The AN level is above the recommended limit.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>UCH05999111</b>	---	---
Sample Date	Client Info		<b>28 Oct 2023</b>	---	---
Machine Age	hrs	Client Info	<b>38323</b>	---	---
Oil Age	hrs	Client Info	<b>5312</b>	---	---
Oil Changed	Client Info		<b>Not Chngd</b>	---	---
Sample Status			<b>ABNORMAL</b>	---	---

## WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >50	<b>0</b>	---	---
Chromium	ppm	ASTM D5185m >5	<b>0</b>	---	---
Nickel	ppm	ASTM D5185m	<b>0</b>	---	---
Titanium	ppm	ASTM D5185m	<b>0</b>	---	---
Silver	ppm	ASTM D5185m	<b>0</b>	---	---
Aluminum	ppm	ASTM D5185m >15	<b>6</b>	---	---
Lead	ppm	ASTM D5185m >65	<b>0</b>	---	---
Copper	ppm	ASTM D5185m >65	<b>7</b>	---	---
Tin	ppm	ASTM D5185m >10	<b>0</b>	---	---
Vanadium	ppm	ASTM D5185m	<b>0</b>	---	---
Cadmium	ppm	ASTM D5185m	<b>0</b>	---	---

## ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m 0.1	<b>0</b>	---	---
Barium	ppm	ASTM D5185m 0.8	<b>0</b>	---	---
Molybdenum	ppm	ASTM D5185m 0	<b>0</b>	---	---
Manganese	ppm	ASTM D5185m 0.9	<b>0</b>	---	---
Magnesium	ppm	ASTM D5185m 0	<b>0</b>	---	---
Calcium	ppm	ASTM D5185m 0	<b>0</b>	---	---
Phosphorus	ppm	ASTM D5185m 409	<b>97</b>	---	---
Zinc	ppm	ASTM D5185m 0	<b>6</b>	---	---
Sulfur	ppm	ASTM D5185m 1290	<b>68</b>	---	---

## CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >35	<b>0</b>	---	---
Sodium	ppm	ASTM D5185m	<b>1</b>	---	---
Potassium	ppm	ASTM D5185m >20	<b>&lt;1</b>	---	---

## FLUID DEGRADATION



	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045 0.537	<b>▲ 1.58</b>	---	---

## VISUAL

	method	limit/base	current	history1	history2
White Metal	scalar	*Visual NONE	<b>NONE</b>	---	---
Yellow Metal	scalar	*Visual NONE	<b>NONE</b>	---	---
Precipitate	scalar	*Visual NONE	<b>NONE</b>	---	---
Silt	scalar	*Visual NONE	<b>NONE</b>	---	---
Debris	scalar	*Visual NONE	<b>LIGHT</b>	---	---
Sand/Dirt	scalar	*Visual NONE	<b>NONE</b>	---	---
Appearance	scalar	*Visual NORML	<b>NORML</b>	---	---
Odor	scalar	*Visual NORML	<b>NORML</b>	---	---
Emulsified Water	scalar	*Visual >0.1	<b>NEG</b>	---	---
Free Water	scalar	*Visual	<b>NEG</b>	---	---







# OIL ANALYSIS REPORT

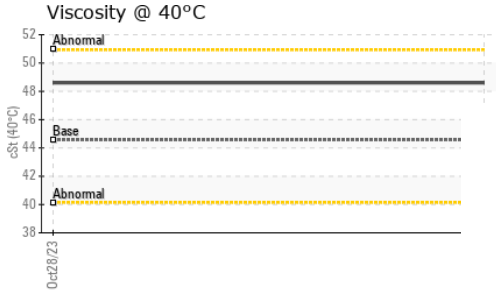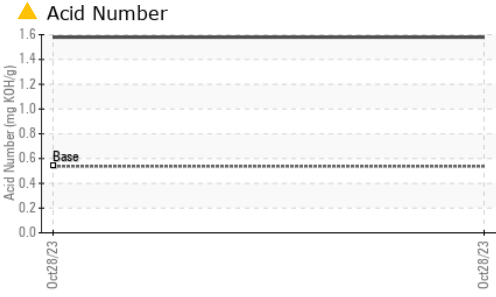

FLUID PROPERTIES	method	limit/base	current	history1	history2	
Visc @ 40°C	cSt	ASTM D445	44.56	<b>48.6</b>	---	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
Color				no image	no image
Bottom				no image	no image

## GRAPHS

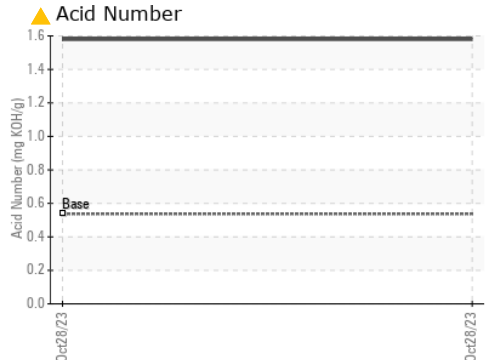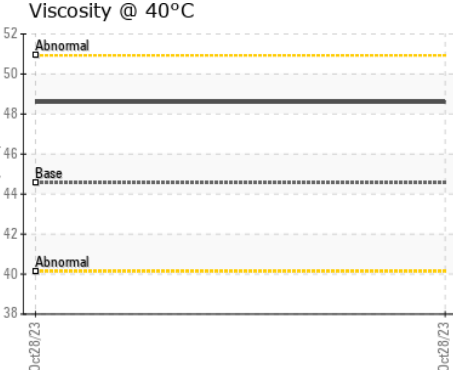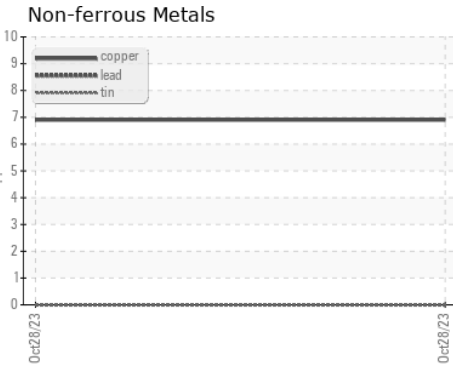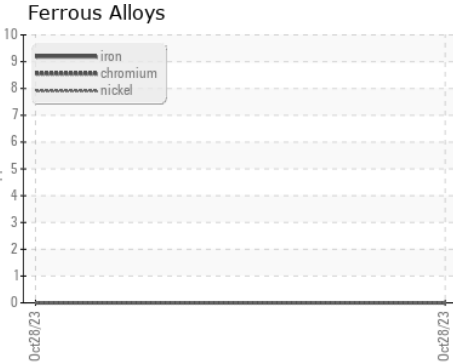

Certificate L2367

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : UCH05999111    **Received** : 06 Nov 2023  
**Lab Number** : 05999111    **Diagnosed** : 07 Nov 2023  
**Unique Number** : 10727471    **Diagnostician** : Angela Borella  
**Test Package** : IND 2

**DIRECT AIR - AIR TECHNOLOGIES**  
 400 WRIGHT AVE  
 MIDDLETOWN, OH  
 US 45044  
 Contact: DAVID DUNCAN  
 david.duncan@aircompressors.com  
 T: (502)254-2520  
 F: (513)539-6040

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)