




# OIL ANALYSIS REPORT

Sample Rating Trend

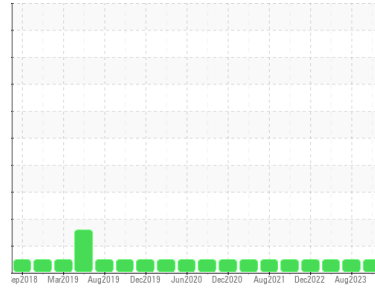

**NORMAL**



Area  
**SULLUBE**  
 Machine Id  
**SULLAIR 200606190030 - ARTISTIC STONE**  
 Component  
**Compressor**

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the oil.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>UCH05999144</b>	UCH05928844	UCH05813982
Sample Date	Client Info		<b>01 Nov 2023</b>	03 Aug 2023	22 Mar 2023
Machine Age	hrs	Client Info	<b>39239</b>	38510	37643
Oil Age	hrs	Client Info	<b>5338</b>	3190	8
Oil Changed	Client Info		<b>Not Changed</b>	Not Changd	Changed
Sample Status			<b>NORMAL</b>	NORMAL	NORMAL

## WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >50	<1	<1	0
Chromium	ppm	ASTM D5185m >10	0	0	0
Nickel	ppm	ASTM D5185m	<1	0	0
Titanium	ppm	ASTM D5185m	0	0	0
Silver	ppm	ASTM D5185m	0	0	0
Aluminum	ppm	ASTM D5185m >25	<1	0	0
Lead	ppm	ASTM D5185m >25	<1	0	0
Copper	ppm	ASTM D5185m >50	<1	<1	0
Tin	ppm	ASTM D5185m >15	0	0	<1
Vanadium	ppm	ASTM D5185m	0	0	0
Cadmium	ppm	ASTM D5185m	<1	0	0

## ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0	0
Barium	ppm	ASTM D5185m 745	<b>294</b>	394	660
Molybdenum	ppm	ASTM D5185m 0.0	0	0	0
Manganese	ppm	ASTM D5185m	0	<1	<1
Magnesium	ppm	ASTM D5185m 0.0	<1	<1	4
Calcium	ppm	ASTM D5185m 1	<b>2</b>	<1	3
Phosphorus	ppm	ASTM D5185m 3	<b>9</b>	2	6
Zinc	ppm	ASTM D5185m 0.1	0	6	3
Sulfur	ppm	ASTM D5185m 240	<b>231</b>	382	403

## CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >25	<b>1</b>	1	4
Sodium	ppm	ASTM D5185m	<b>41</b>	31	13
Potassium	ppm	ASTM D5185m >20	<b>6</b>	3	2

## FLUID DEGRADATION



	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045 .06	<b>0.12</b>	0.537	0.503

## VISUAL

	method	limit/base	current	history1	history2
White Metal	scalar	*Visual NONE	<b>NONE</b>	NONE	NONE
Yellow Metal	scalar	*Visual NONE	<b>NONE</b>	NONE	NONE
Precipitate	scalar	*Visual NONE	<b>NONE</b>	NONE	NONE
Silt	scalar	*Visual NONE	<b>NONE</b>	NONE	NONE
Debris	scalar	*Visual NONE	<b>NONE</b>	NONE	NONE
Sand/Dirt	scalar	*Visual NONE	<b>NONE</b>	NONE	NONE
Appearance	scalar	*Visual NORML	<b>NORML</b>	NORML	NORML
Odor	scalar	*Visual NORML	<b>NORML</b>	NORML	NORML
Emulsified Water	scalar	*Visual >0.1	<b>NEG</b>	NEG	NEG
Free Water	scalar	*Visual	<b>NEG</b>	NEG	NEG



# OIL ANALYSIS REPORT

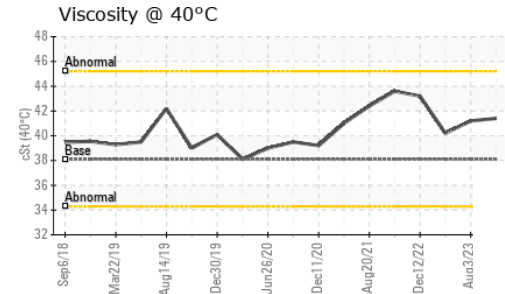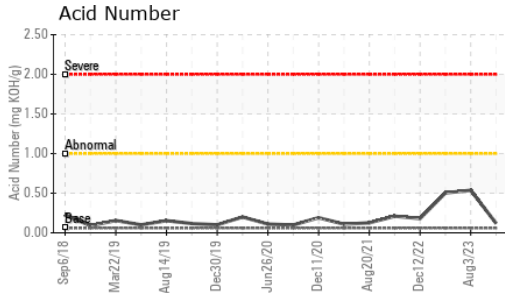

FLUID PROPERTIES		method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	38.1	<b>41.4</b>	41.2	40.2

SAMPLE IMAGES		method	limit/base	current	history1	history2
---------------	--	--------	------------	---------	----------	----------


Color




Bottom

## GRAPHS


### Ferrous Alloys

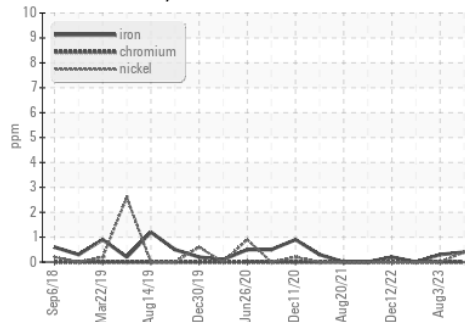


### Non-ferrous Metals

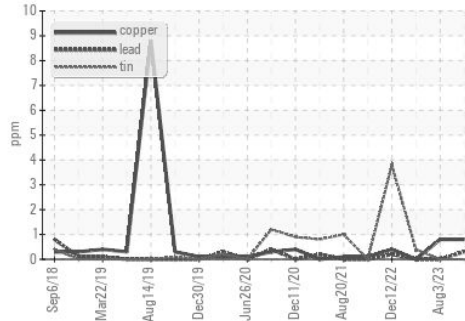

### Viscosity @ 40°C

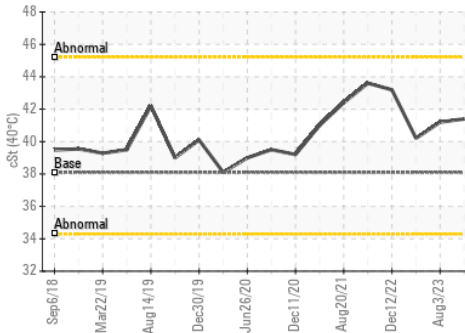

### Acid Number

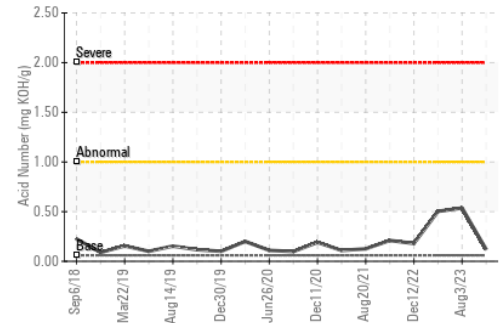

Certificate L2367

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : UCH05999144 **Received** : 06 Nov 2023  
**Lab Number** : **05999144** **Diagnosed** : 07 Nov 2023  
**Unique Number** : 10727504 **Diagnostician** : Angela Borella  
**Test Package** : IND 2

**TATE ENGINEERING**  
 8131 VIRGINIA PINE CT  
 RICHMOND, VA  
 US 23237  
 Contact: JOE MYRICK  
 JOE.MYRICK@TATE.COM  
 T: (804)339-0007  
 F: (804)743-0415

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)