




PROBLEM SUMMARY

Sample Rating Trend

DEGRADATION




Area
NOT GIVEN [1398752]
Machine Id
INGERSOLL RAND EE4073U16056 - BRADY LINEN
Component
Compressor

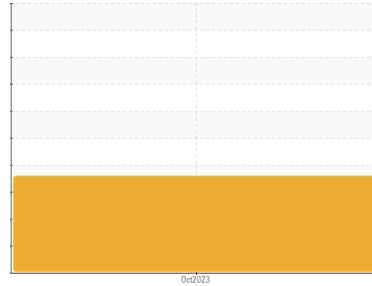


COMPONENT CONDITION SUMMARY

Acid Number

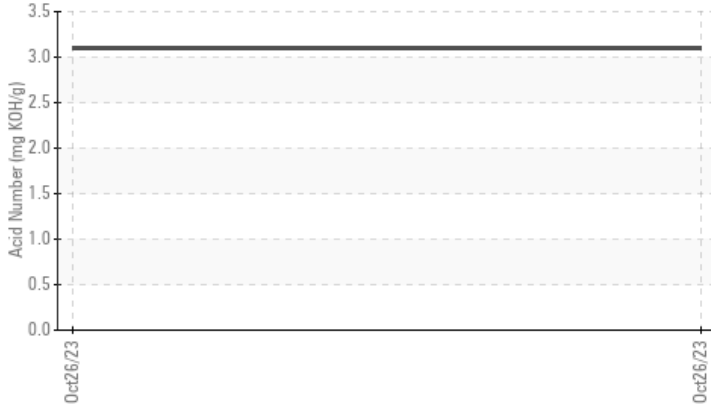

Viscosity @ 40°C

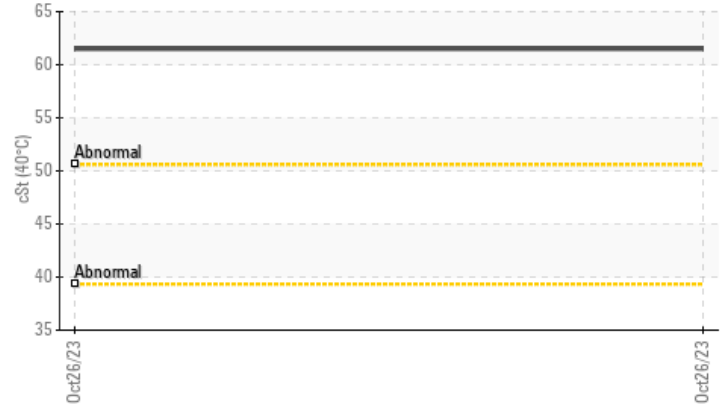

RECOMMENDATION

Recommend drain oil if not already done and flush with cleaner before refilling with oil. Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

PROBLEMATIC TEST RESULTS

Sample Status			SEVERE	---	---
Acid Number (AN)	mg KOH/g	ASTM D8045	3.10	---	---
Visc @ 40°C	cSt	ASTM D445	61.5	---	---

Customer Id: ULTRACHEM
Sample No.: UCH05999145
Lab Number: 05999145
Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:
Angela Borella +1 800-237-1369
angela.borella@wearcheckusa.com

To change component or sample information:
Customer Service +1 1-800-237-1369
customerservice@wearcheck.com

RECOMMENDED ACTIONS

Action	Status	Date	Done By	Description
Change Fluid	---	---	?	Oil and filter change at the time of sampling has been noted.
Flush System	---	---	?	Recommend drain oil if not already done and flush with cleaner before refilling with oil.
Change Filter	---	---	?	Oil and filter change at the time of sampling has been noted.

HISTORICAL DIAGNOSIS




OIL ANALYSIS REPORT

Sample Rating Trend

DEGRADATION

Area
NOT GIVEN [1398752]
 Machine Id
INGERSOLL RAND EE4073U16056 - BRADY LINEN
 Component
Compressor

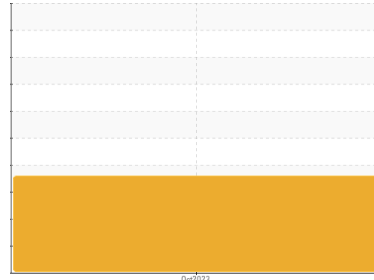

DIAGNOSIS

Recommendation

Recommend drain oil if not already done and flush with cleaner before refilling with oil. Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil.

Fluid Condition

The AN level is above the recommended limit. TAN level indicates possible presence of varnish. Confirm oil type.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		UCH05999145	---	---
Sample Date	Client Info		26 Oct 2023	---	---
Machine Age	hrs	Client Info	53397	---	---
Oil Age	hrs	Client Info	0	---	---
Oil Changed	Client Info		Changed	---	---
Sample Status			SEVERE	---	---

WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >50	2	---	---
Chromium	ppm	ASTM D5185m >10	<1	---	---
Nickel	ppm	ASTM D5185m	<1	---	---
Titanium	ppm	ASTM D5185m	0	---	---
Silver	ppm	ASTM D5185m	0	---	---
Aluminum	ppm	ASTM D5185m >25	1	---	---
Lead	ppm	ASTM D5185m >25	<1	---	---
Copper	ppm	ASTM D5185m >50	2	---	---
Tin	ppm	ASTM D5185m >15	0	---	---
Vanadium	ppm	ASTM D5185m	0	---	---
Cadmium	ppm	ASTM D5185m	<1	---	---

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	1	---	---
Barium	ppm	ASTM D5185m	332	---	---
Molybdenum	ppm	ASTM D5185m	0	---	---
Manganese	ppm	ASTM D5185m	0	---	---
Magnesium	ppm	ASTM D5185m	3	---	---
Calcium	ppm	ASTM D5185m	8	---	---
Phosphorus	ppm	ASTM D5185m	39	---	---
Zinc	ppm	ASTM D5185m	16	---	---
Sulfur	ppm	ASTM D5185m	369	---	---

CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >25	<1	---	---
Sodium	ppm	ASTM D5185m	49	---	---
Potassium	ppm	ASTM D5185m >20	10	---	---

FLUID DEGRADATION



	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	3.10	---	---

VISUAL

	method	limit/base	current	history1	history2
White Metal	scalar	*Visual NONE	NONE	---	---
Yellow Metal	scalar	*Visual NONE	NONE	---	---
Precipitate	scalar	*Visual NONE	NONE	---	---
Silt	scalar	*Visual NONE	NONE	---	---
Debris	scalar	*Visual NONE	NONE	---	---
Sand/Dirt	scalar	*Visual NONE	NONE	---	---
Appearance	scalar	*Visual NORML	NORML	---	---
Odor	scalar	*Visual NORML	NORML	---	---
Emulsified Water	scalar	*Visual >0.1	NEG	---	---
Free Water	scalar	*Visual	NEG	---	---



OIL ANALYSIS REPORT



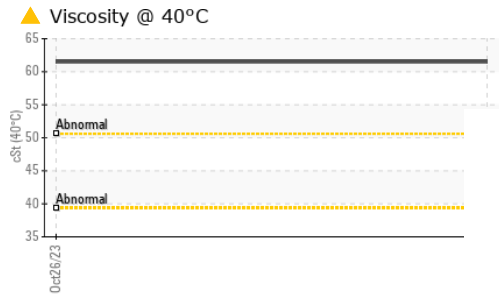
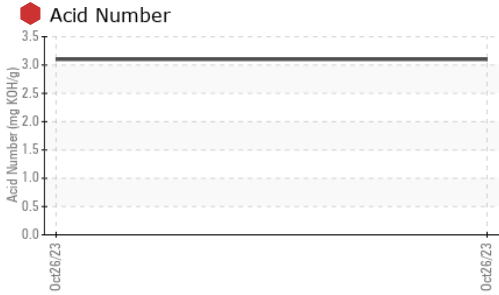


FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	▲ 61.5	---	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

Color				no image	no image
Bottom				no image	no image

GRAPHS

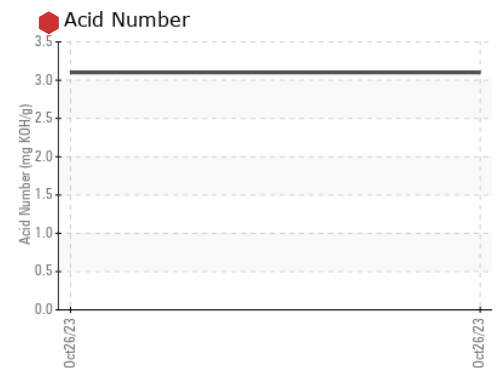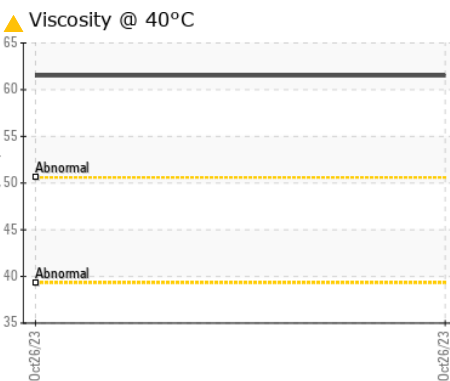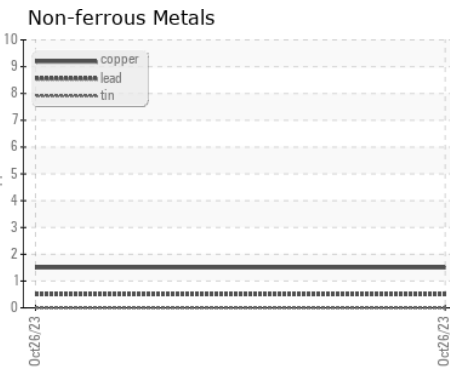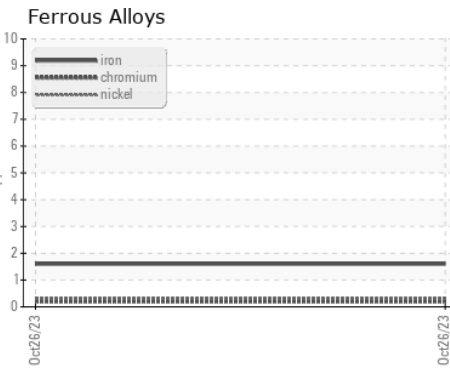

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : UCH05999145 **Received** : 06 Nov 2023
Lab Number : 05999145 **Diagnosed** : 07 Nov 2023
Unique Number : 10727505 **Diagnostician** : Angela Borella
Test Package : IND 2

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

ULTRACHEM INC
 900 CENTERPOINT BLVD
 NEW CASTLE, DE
 US 19720
 Contact: BROOK GILMER
 bgilmer@ultracheminc.com
 T: x:
 F: (302)325-0335