




# OIL ANALYSIS REPORT

Sample Rating Trend

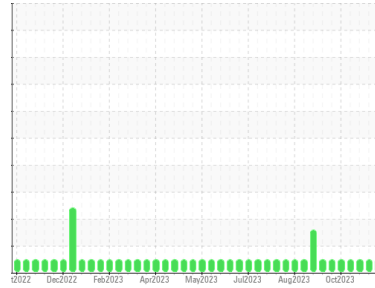

**NORMAL**



Machine Id  
**LGS00180**

Component  
**Middle Biogas Engine**

Fluid  
**CITGO PACEMAKER GAS ENGINE LFG LA 40 (--- GAL)**

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the oil.

### Fluid Condition

The BN result indicates that there is suitable alkalinity remaining in the oil. The AN level is acceptable for this fluid. The condition of the oil is acceptable for the time in service.

## SAMPLE INFORMATION

method	limit/base	current	history1	history2	
Sample Number	Client Info	<b>WC0803448</b>	WC0803446	WC0803452	
Sample Date	Client Info	<b>30 Oct 2023</b>	23 Oct 2023	16 Oct 2023	
Machine Age	hrs	Client Info	<b>59471</b>	59307	59138
Oil Age	hrs	Client Info	<b>619</b>	455	286
Oil Changed	Client Info	<b>N/A</b>	N/A	N/A	
Sample Status		<b>NORMAL</b>	NORMAL	NORMAL	

## CONTAMINATION

method	limit/base	current	history1	history2
Fuel	WC Method >4.0	<b>&lt;1.0</b>	<1.0	<1.0
Glycol	WC Method	<b>NEG</b>	NEG	NEG

## WEAR METALS

method	limit/base	current	history1	history2	
Iron	ppm	ASTM D5185m >45	<b>3</b>	2	2
Chromium	ppm	ASTM D5185m >2	<b>&lt;1</b>	<1	<1
Nickel	ppm	ASTM D5185m >2	<b>&lt;1</b>	<1	0
Titanium	ppm	ASTM D5185m	<b>0</b>	<1	0
Silver	ppm	ASTM D5185m >5	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m >10	<b>2</b>	1	2
Lead	ppm	ASTM D5185m >5	<b>&lt;1</b>	0	<1
Copper	ppm	ASTM D5185m >14	<b>2</b>	1	2
Tin	ppm	ASTM D5185m >13	<b>2</b>	3	3
Vanadium	ppm	ASTM D5185m	<b>0</b>	0	0
Cadmium	ppm	ASTM D5185m	<b>&lt;1</b>	<1	0

## ADDITIVES

method	limit/base	current	history1	history2	
Boron	ppm	ASTM D5185m	<b>2</b>	2	2
Barium	ppm	ASTM D5185m	<b>2</b>	0	0
Molybdenum	ppm	ASTM D5185m	<b>3</b>	4	3
Manganese	ppm	ASTM D5185m	<b>0</b>	0	<1
Magnesium	ppm	ASTM D5185m	<b>24</b>	25	26
Calcium	ppm	ASTM D5185m	<b>1314</b>	1382	1429
Phosphorus	ppm	ASTM D5185m	<b>270</b>	324	298
Zinc	ppm	ASTM D5185m	<b>335</b>	363	378
Sulfur	ppm	ASTM D5185m	<b>2913</b>	3212	3163

## CONTAMINANTS

method	limit/base	current	history1	history2	
Silicon	ppm	ASTM D5185m >200	<b>149</b>	154	143
Sodium	ppm	ASTM D5185m	<b>4</b>	4	9
Potassium	ppm	ASTM D5185m >20	<b>2</b>	2	0

## INFRA-RED




method	limit/base	current	history1	history2	
Soot %	%	*ASTM D7844	<b>0</b>	0	0
Nitration	Abs/cm	*ASTM D7624 >20	<b>4.1</b>	4.0	3.9
Sulfation	Abs/.1mm	*ASTM D7415 >30	<b>18.7</b>	18.4	18.0

## FLUID DEGRADATION

method	limit/base	current	history1	history2	
Oxidation	Abs/.1mm	*ASTM D7414 >25	<b>9.2</b>	9.0	8.6
Acid Number (AN)	mg KOH/g	ASTM D8045 1.16	<b>0.84</b>	0.80	0.93
Base Number (BN)	mg KOH/g	ASTM D2896 5	<b>3.14</b>	3.15	3.10











# OIL ANALYSIS REPORT

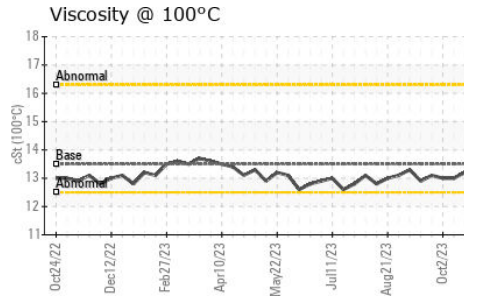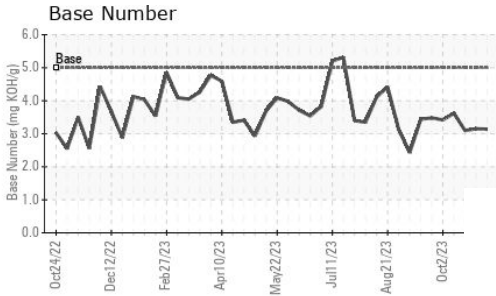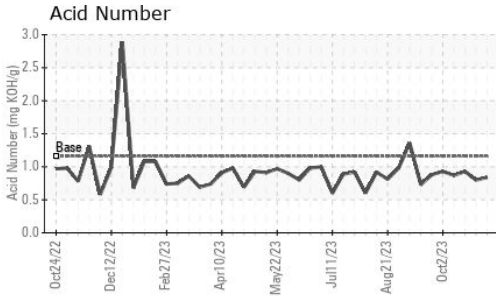

VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.1	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2	
Visc @ 100°C	cSt	ASTM D445	13.5	<b>13.4</b>	13.3	13.2

## GRAPHS

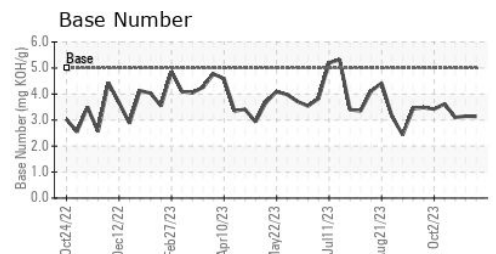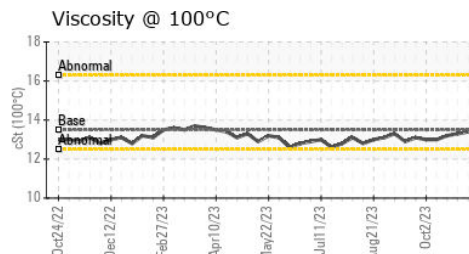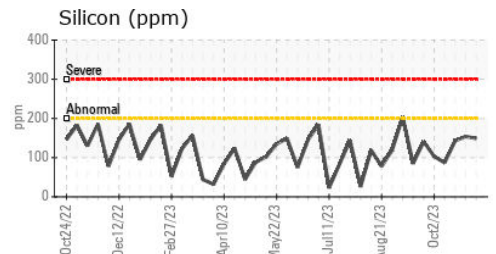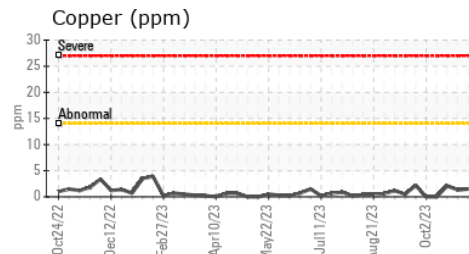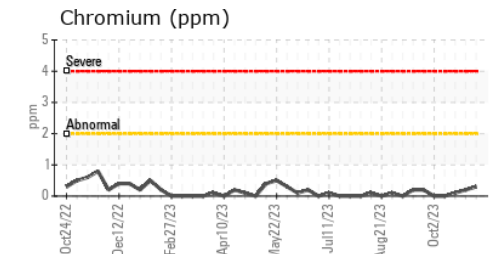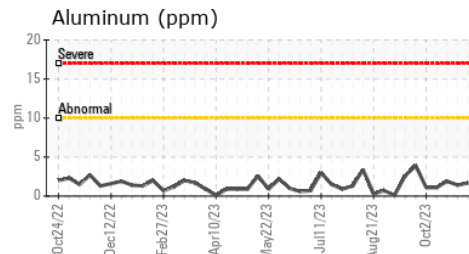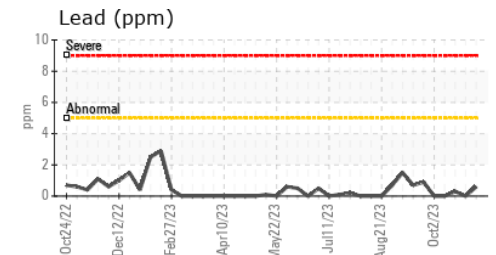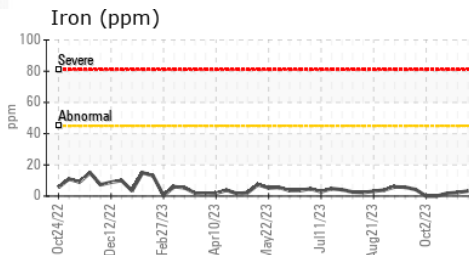

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
 Sample No. : WC0803448  
 Lab Number : 05999201  
 Unique Number : 10727561  
 Test Package : MOB 2

Received : 06 Nov 2023  
 Diagnosed : 07 Nov 2023  
 Diagnostician : Sean Felton

**BLACK OAK**  
 5054 HWY HH  
 HARTVILLE, MO  
 US 65667

Contact: CHIP MATHEWS  
 chip.matthews@cubedistrictenergy.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:  
F: