



OIL ANALYSIS REPORT

Sample Rating Trend



NORMAL



Machine Id
WACKER 3363

Component
Diesel Engine

Fluid
NOT GIVEN (--- QTS)

DIAGNOSIS

Recommendation

The oil change at the time of sampling has been noted. Resample at the next service interval to monitor. No other corrective action is recommended at this time. Please specify the brand, type, and viscosity of the oil on your next sample.

Wear

Metal levels are typical for a new component breaking in.

Contamination

Light fuel dilution occurring. No other contaminants were detected in the oil.

Fluid Condition

The BN result indicates that there is suitable alkalinity remaining in the oil. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		RW0004538	---	---
Sample Date	Client Info		17 Oct 2023	---	---
Machine Age	hrs	Client Info	941	---	---
Oil Age	hrs	Client Info	0	---	---
Oil Changed	Client Info		Changed	---	---
Sample Status			NORMAL	---	---

CONTAMINATION

	method	limit/base	current	history1	history2
Glycol	WC Method		NEG	---	---

WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >100	3	---	---
Chromium	ppm	ASTM D5185m >20	<1	---	---
Nickel	ppm	ASTM D5185m >4	<1	---	---
Titanium	ppm	ASTM D5185m	0	---	---
Silver	ppm	ASTM D5185m >3	0	---	---
Aluminum	ppm	ASTM D5185m >20	2	---	---
Lead	ppm	ASTM D5185m >40	<1	---	---
Copper	ppm	ASTM D5185m >330	2	---	---
Tin	ppm	ASTM D5185m >15	0	---	---
Vanadium	ppm	ASTM D5185m	0	---	---
Cadmium	ppm	ASTM D5185m	<1	---	---

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	52	---	---
Barium	ppm	ASTM D5185m	2	---	---
Molybdenum	ppm	ASTM D5185m	42	---	---
Manganese	ppm	ASTM D5185m	0	---	---
Magnesium	ppm	ASTM D5185m	648	---	---
Calcium	ppm	ASTM D5185m	1128	---	---
Phosphorus	ppm	ASTM D5185m	838	---	---
Zinc	ppm	ASTM D5185m	1047	---	---
Sulfur	ppm	ASTM D5185m	2952	---	---

CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >25	15	---	---
Sodium	ppm	ASTM D5185m	4	---	---
Potassium	ppm	ASTM D5185m >20	2	---	---
Fuel	%	ASTM D3524 >5	1.8	---	---

INFRA-RED



	method	limit/base	current	history1	history2
Soot %	%	*ASTM D7844 >3	0.1	---	---
Nitration	Abs/cm	*ASTM D7624 >20	6.5	---	---
Sulfation	Abs/.1mm	*ASTM D7415 >30	19.9	---	---

FLUID DEGRADATION

	method	limit/base	current	history1	history2
Oxidation	Abs/.1mm	*ASTM D7414 >25	18.6	---	---
Base Number (BN)	mg KOH/g	ASTM D2896	11.51	---	---











OIL ANALYSIS REPORT

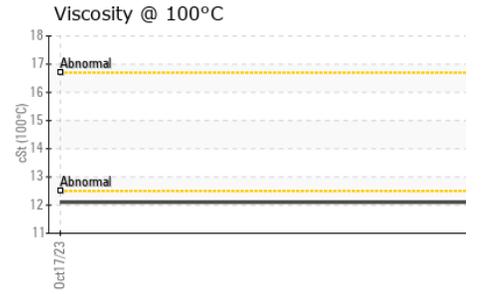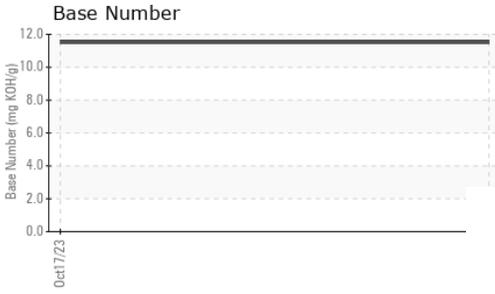

VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	---
Yellow Metal	scalar	*Visual	NONE	NONE	---
Precipitate	scalar	*Visual	NONE	NONE	---
Silt	scalar	*Visual	NONE	NONE	---
Debris	scalar	*Visual	NONE	NONE	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---
Appearance	scalar	*Visual	NORML	NORML	---
Odor	scalar	*Visual	NORML	NORML	---
Emulsified Water	scalar	*Visual	>0.2	NEG	---
Free Water	scalar	*Visual		NEG	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 100°C	cSt	ASTM D445	12.1	---	---

GRAPHS

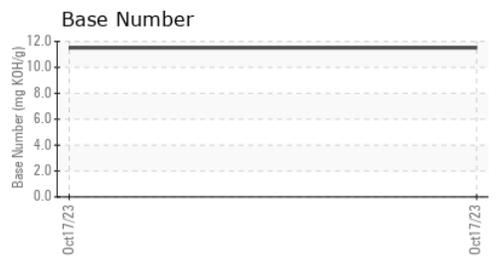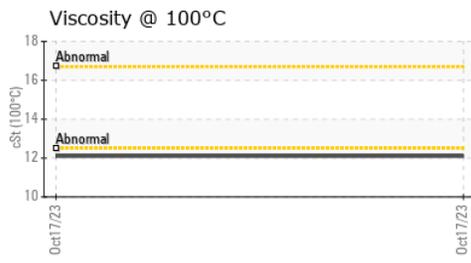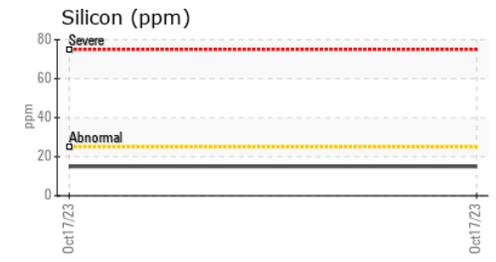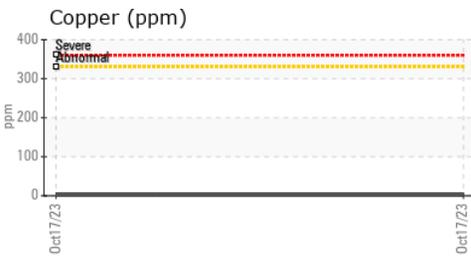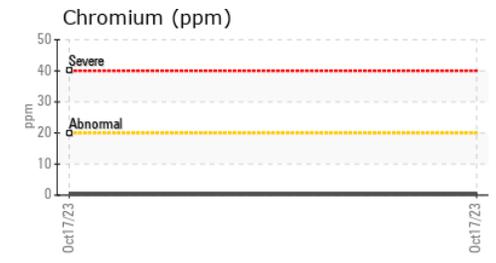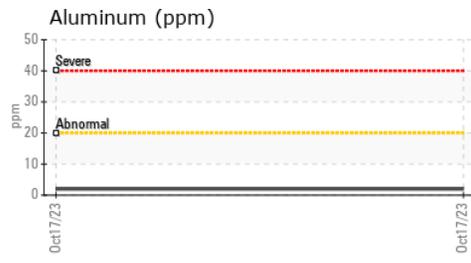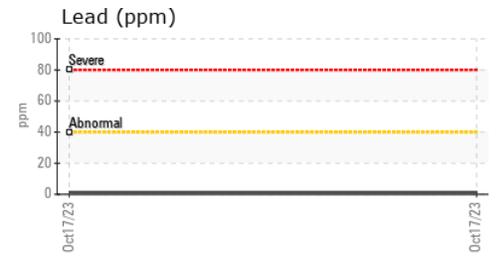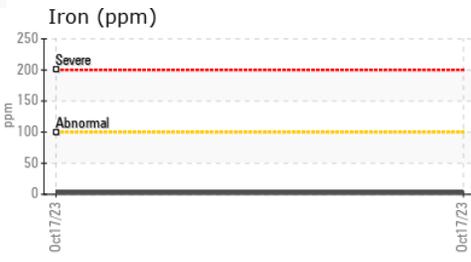

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : RW0004538 **Received** : 06 Nov 2023
Lab Number : 05999208 **Diagnosed** : 08 Nov 2023
Unique Number : 10727568 **Diagnostician** : Wes Davis
Test Package : MOB 2 (Additional Tests: FuelDilution, PercentFuel)

NEWKIRK ELECTRIC
 1875 ROBERTS ST.
 MUSKEGON, MI
 US 49442
 Contact: ERIC KING
 ewking@newkirk-electric.com
 T: (231)206-6131
 F: (231)724-4090

Certificate L2367
 To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)