




# OIL ANALYSIS REPORT

Sample Rating Trend

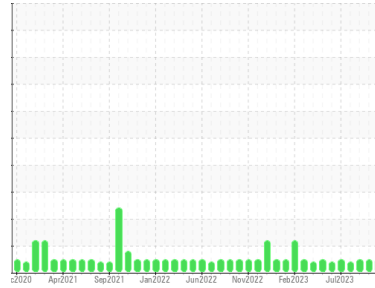

**NORMAL**



Area  
**Martinsville**  
 Machine Id  
**[Martinsville] Oil - Port Genset**  
 Component  
**Port Genset**  
 Fluid  
**MOBIL 15W40 (7 GAL)**

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor. ( Customer Sample Comment: Filter and oil was changed . Hours on both are 239 as of 10-29-23 )

### Wear

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the oil.

### Fluid Condition

The BN result indicates that there is suitable alkalinity remaining in the oil. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			<b>WC0805436</b>	WC0769052	WC0769084
Sample Date	Client Info			<b>29 Oct 2023</b>	03 Oct 2023	05 Sep 2023
Machine Age	hrs	Client Info		<b>5426</b>	4779	4575
Oil Age	hrs	Client Info		<b>239</b>	102	0
Oil Changed	Client Info			<b>Filtered</b>	Not Changd	Changed
Sample Status				<b>NORMAL</b>	NORMAL	NORMAL

CONTAMINATION		method	limit/base	current	history1	history2
Fuel	WC Method	>4.0		<b>&lt;1.0</b>	<1.0	<1.0
Glycol	WC Method			<b>NEG</b>	NEG	NEG

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<b>4</b>	4	2
Chromium	ppm	ASTM D5185m	>4	<b>&lt;1</b>	0	0
Nickel	ppm	ASTM D5185m	>2	<b>&lt;1</b>	0	0
Titanium	ppm	ASTM D5185m		<b>&lt;1</b>	0	0
Silver	ppm	ASTM D5185m	>5	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m	>12	<b>&lt;1</b>	0	<1
Lead	ppm	ASTM D5185m	>17	<b>&lt;1</b>	<1	<1
Copper	ppm	ASTM D5185m	>70	<b>1</b>	1	0
Tin	ppm	ASTM D5185m	>15	<b>0</b>	<1	0
Vanadium	ppm	ASTM D5185m		<b>0</b>	0	0
Cadmium	ppm	ASTM D5185m		<b>&lt;1</b>	0	0

ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		<b>26</b>	34	33
Barium	ppm	ASTM D5185m		<b>2</b>	<1	0
Molybdenum	ppm	ASTM D5185m		<b>61</b>	70	60
Manganese	ppm	ASTM D5185m		<b>0</b>	<1	<1
Magnesium	ppm	ASTM D5185m		<b>1341</b>	1400	1482
Calcium	ppm	ASTM D5185m		<b>1105</b>	1199	1214
Phosphorus	ppm	ASTM D5185m		<b>991</b>	1069	1022
Zinc	ppm	ASTM D5185m		<b>1173</b>	1268	1304
Sulfur	ppm	ASTM D5185m		<b>3255</b>	3684	4191




CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<b>3</b>	3	6
Sodium	ppm	ASTM D5185m	>118	<b>&lt;1</b>	0	<1
Potassium	ppm	ASTM D5185m	>20	<b>2</b>	2	4

INFRA-RED		method	limit/base	current	history1	history2
Soot %	%	*ASTM D7844		<b>0.1</b>	0.1	0.1
Nitration	Abs/cm	*ASTM D7624	>20	<b>6.9</b>	6.4	5.2
Sulfation	Abs/.1mm	*ASTM D7415	>30	<b>19.4</b>	18.9	18.2

FLUID DEGRADATION		method	limit/base	current	history1	history2
Oxidation	Abs/.1mm	*ASTM D7414	>25	<b>14.9</b>	14.5	13.4
Base Number (BN)	mg KOH/g	ASTM D2896		<b>12.48</b>	13.29	12.01







# OIL ANALYSIS REPORT

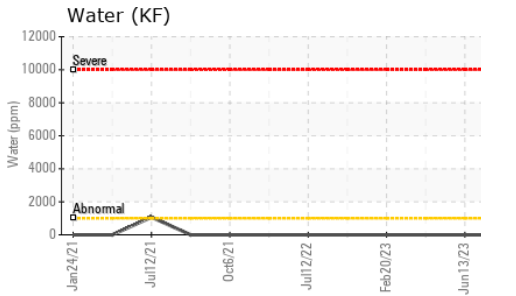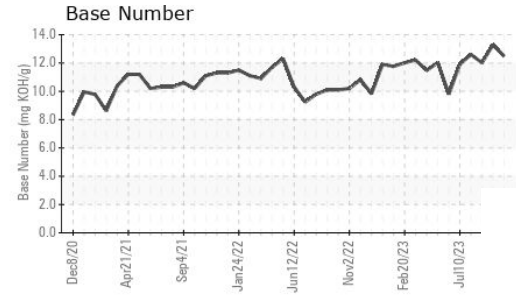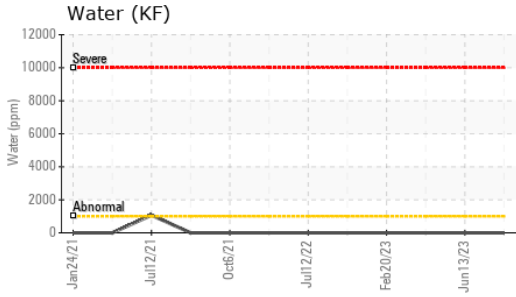

VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.1	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 100°C	cSt	ASTM D445	<b>12.4</b>	12.5	15.1

### GRAPHS

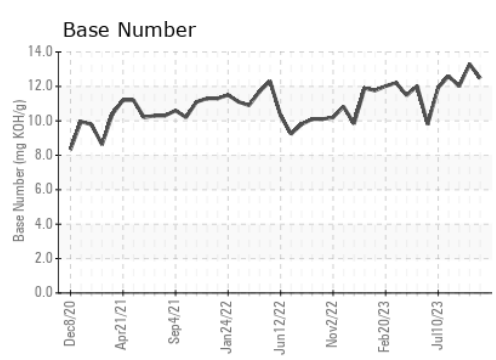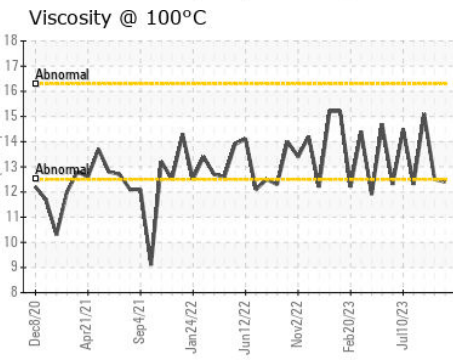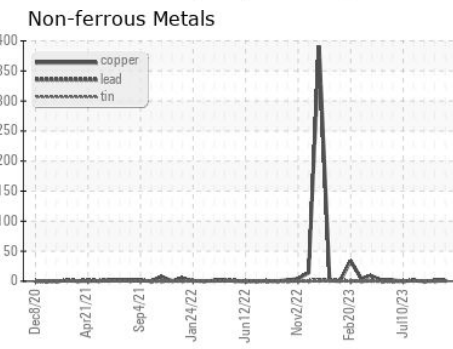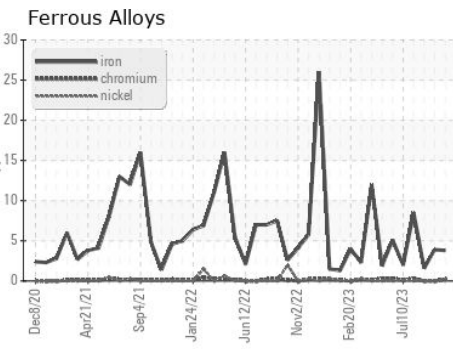

Certificate L2367

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : WC0805436 **Received** : 06 Nov 2023  
**Lab Number** : 05999214 **Diagnosed** : 07 Nov 2023  
**Unique Number** : 10727574 **Diagnostician** : Sean Felton  
**Test Package** : IND 2 ( Additional Tests: KF )

**MARATHON PETROLEUM CO.**  
 101 12TH ST  
 CATLETTSBURG, KY  
 US 41169

Contact: CORY GUMBERT  
 cagumbert@marathonpetroleum.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T: (606)585-3950

F: x: