

OIL ANALYSIS REPORT

[180649-N2STV4W] **LUBE UNIT 2**

Component

Thrust Bearing

SHELL TURBO T ISO 68 (980 GAL)

Sample Rating Trend



Recommendation

Resample at the next service interval to monitor.

All component wear rates are normal.


Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

CAMPLE INCORM	IATION			0012023	la ta bassa sal	la la tarre O
SAMPLE INFORM	IATION	method	limit/base	current	history1	history2
Sample Number		Client Info		PH05999805		
Sample Date		Client Info		31 Oct 2023		
Machine Age	hrs	Client Info		0		
Oil Age	hrs	Client Info		0		
Oil Changed		Client Info		N/A		
Sample Status				NORMAL		
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>85	<1		
Chromium	ppm	ASTM D5185m	>20	0		
Nickel	ppm	ASTM D5185m	>20	0		
Titanium	ppm	ASTM D5185m		0		
Silver	ppm	ASTM D5185m		0		
Aluminum	ppm	ASTM D5185m	>40	0		
Lead	ppm	ASTM D5185m	>60	<1		
Copper	ppm	ASTM D5185m	>7	0		
Tin	ppm	ASTM D5185m	>40	<1		
Vanadium	ppm	ASTM D5185m		0		
Cadmium	ppm	ASTM D5185m		0		
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0		
Barium	ppm	ASTM D5185m		0		
Molybdenum	ppm	ASTM D5185m		0		
Manganese	ppm	ASTM D5185m		0		
Magnesium	ppm	ASTM D5185m		<1		
Calcium	ppm	ASTM D5185m		4		
Phosphorus	ppm	ASTM D5185m		15		
Zinc	ppm	ASTM D5185m		11		
Sulfur	ppm	ASTM D5185m		250		
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>20	2		
Sodium	ppm	ASTM D5185m		7		
Potassium	ppm	ASTM D5185m	>20	0		
FLUID CLEANLIN	ESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647	>2500	1072		
Particles >6µm		ASTM D7647	>320	109		
Particles >14µm		ASTM D7647	>80	9		
Particles >21µm		ASTM D7647	>20	1		
Particles >38µm		ASTM D7647	>4	0		
Particles >71µm		ASTM D7647	>3	0		
Oil Cleanliness		ISO 4406 (c)	>18/15/13	17/14/10		



FLUID DEGRADATION


Acid Number (AN)

mg KOH/g ASTM D8045 .05

0.093



OIL ANALYSIS REPORT

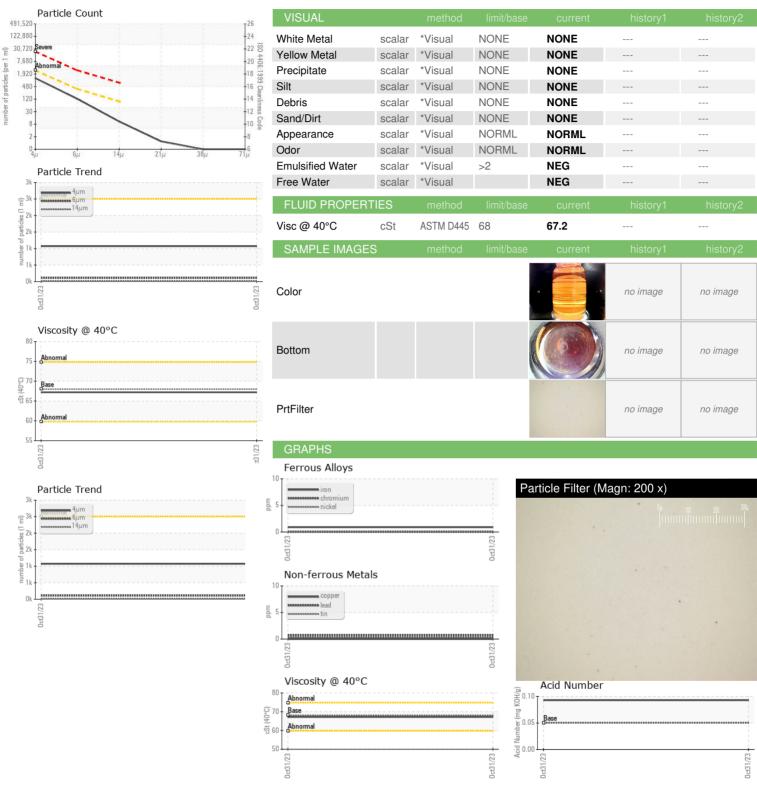



Certificate L2367

Laboratory Sample No. Lab Number **Unique Number**

: 05999805 : 10728165

: PH05999805

Received : 06 Nov 2023 Diagnosed : 08 Nov 2023 Diagnostician : Jonathan Hester

: WearCheck USA - 501 Madison Ave., Cary, NC 27513

Test Package: PLANT (Additional Tests: FilterPatch, PrtFilter) To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

USACE WHITNEY POWER PLANT

285 CR 3602 CLIFTON, TX US 76634 Contact: CHAD BRUNO

chad.j.bruno@usace.army.mil

T: (254)622-3268

F: