



# PROBLEM SUMMARY

## Sample Rating Trend

ISO




Area  
**RIPPEY [20005325]**

Machine Id  
**82203 SITE 12**


Component  
**Wind Turbine Gearbox**

Fluid  
**CASTROL OPTIGEAR SYNTHETIC X 320 (340 LTR)**

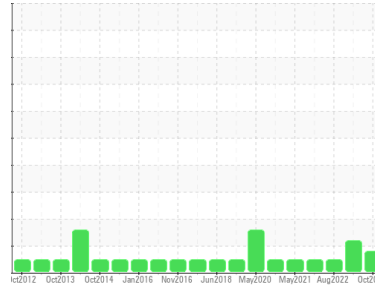

## COMPONENT CONDITION SUMMARY

### ▲ Particle Trend

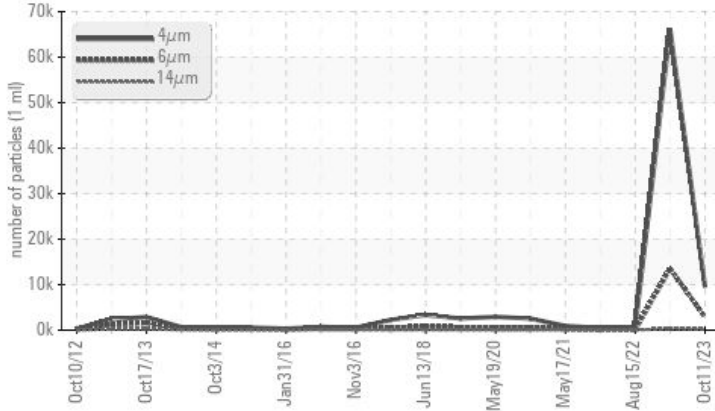

## RECOMMENDATION

No corrective action is recommended at this time.  
Resample at the next service interval to monitor.

## PROBLEMATIC TEST RESULTS

Sample Status		ATTENTION	ABNORMAL	NORMAL
Particles >6µm	ASTM D7647 >2500	▲ 2851	▲ 13538	48
Oil Cleanliness	ISO 4406 (c) >-/18/15	▲ 20/19/15	▲ 23/21/16	16/13/9

Customer Id: NORDEX  
Sample No.: NX05999833  
Lab Number: 05999833  
Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:  
Jonathan Hester +1 919-379-4092 x4092  
[jhester@wearcheckusa.com](mailto:jhester@wearcheckusa.com)

To change component or sample information:  
Customer Service +1 1-800-237-1369  
[customerservice@wearcheck.com](mailto:customerservice@wearcheck.com)

## RECOMMENDED ACTIONS

*There are no recommended actions for this sample.*

## HISTORICAL DIAGNOSIS

### 15 May 2023 Diag: Don Baldrige

ISO



No corrective action is recommended at this time. Resample at the next service interval to monitor. All component wear rates are normal. There is a high amount of silt (particulates < 14 microns in size) present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



### 15 Aug 2022 Diag: Angela Borella

NORMAL



Resample at the next service interval to monitor. All component wear rates are normal. There is no indication of any contamination in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



### 22 Nov 2021 Diag: Angela Borella

NORMAL



Resample at the next service interval to monitor. All component wear rates are normal. There is no indication of any contamination in the component. The amount and size of particulates present in the system is acceptable. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.


view report





# OIL ANALYSIS REPORT

Sample Rating Trend

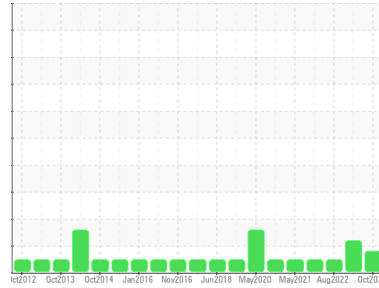

Area  
**RIPPEY [200005325]**  
 Machine Id  
**82203 SITE 12**

Component  
**Wind Turbine Gearbox**  
 Fluid  
**CASTROL OPTIGEAR SYNTHETIC X 320 (340 LTR)**

## DIAGNOSIS

**Recommendation**  
 No corrective action is recommended at this time. Resample at the next service interval to monitor.

**Wear**  
 All component wear rates are normal.

**Contamination**  
 There is a moderate amount of silt (particulates < 14 microns in size) present in the oil.

**Fluid Condition**  
 The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	<b>NX05999833</b>	NX05913482	NX05672233
Sample Date	Client Info	<b>11 Oct 2023</b>	15 May 2023	15 Aug 2022
Machine Age	hrs	Client Info	0	0
Oil Age	hrs	Client Info	0	0
Oil Changed	Client Info	<b>N/A</b>	N/A	N/A
Sample Status		<b>ATTENTION</b>	ABNORMAL	NORMAL

## WEAR METALS

method	limit/base	current	history1	history2		
PQ	ASTM D8184	>80	<b>15</b>	13	3	
Iron	ppm	ASTM D5185m	>150	<b>1</b>	3	3
Chromium	ppm	ASTM D5185m	>5	<b>0</b>	0	0
Nickel	ppm	ASTM D5185m	>10	<b>0</b>	0	0
Titanium	ppm	ASTM D5185m	>10	<b>0</b>	0	0
Silver	ppm	ASTM D5185m		<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m	>10	<b>4</b>	<1	0
Lead	ppm	ASTM D5185m	>20	<b>0</b>	<1	0
Copper	ppm	ASTM D5185m	>50	<b>&lt;1</b>	1	1
Tin	ppm	ASTM D5185m	>10	<b>0</b>	0	0
Antimony	ppm	ASTM D5185m	>5	<b>---</b>	---	---
Vanadium	ppm	ASTM D5185m		<b>0</b>	<1	0
Cadmium	ppm	ASTM D5185m		<b>0</b>	0	0

## ADDITIVES

method	limit/base	current	history1	history2		
Boron	ppm	ASTM D5185m		<b>38</b>	0	0
Barium	ppm	ASTM D5185m		<b>0</b>	0	5
Molybdenum	ppm	ASTM D5185m	1150	<b>730</b>	784	769
Manganese	ppm	ASTM D5185m		<b>0</b>	<1	<1
Magnesium	ppm	ASTM D5185m		<b>8</b>	4	5
Calcium	ppm	ASTM D5185m	2000	<b>1443</b>	1671	1479
Phosphorus	ppm	ASTM D5185m	400	<b>336</b>	374	322
Zinc	ppm	ASTM D5185m	0	<b>0</b>	0	0
Sulfur	ppm	ASTM D5185m	1850	<b>1747</b>	2230	1979

## CONTAMINANTS

method	limit/base	current	history1	history2		
Silicon	ppm	ASTM D5185m	>50	<b>15</b>	7	8
Sodium	ppm	ASTM D5185m	>20	<b>7</b>	8	5
Potassium	ppm	ASTM D5185m	>20	<b>0</b>	0	2
Water	%	ASTM D6304	>0.05	<b>0.018</b>	0.007	0.027
ppm Water	ppm	ASTM D6304	>500	<b>181.2</b>	76.8	273.6


## FLUID CLEANLINESS

method	limit/base	current	history1	history2	
Particles >4µm	ASTM D7647		<b>9548</b>	66149	522
Particles >6µm	ASTM D7647	>2500	<b>2851</b>	13538	48
Particles >14µm	ASTM D7647	>320	<b>197</b>	328	4
Particles >21µm	ASTM D7647	>80	<b>46</b>	46	1
Particles >38µm	ASTM D7647	>20	<b>2</b>	1	0
Particles >71µm	ASTM D7647	>4	<b>1</b>	0	0
Oil Cleanliness	ISO 4406 (c)	--/18/15	<b>20/19/15</b>	23/21/16	16/13/9




# OIL ANALYSIS REPORT


## Particle Trend

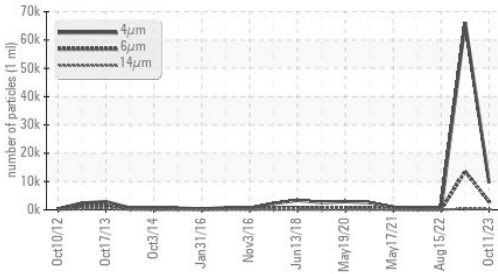


## Water (KF)

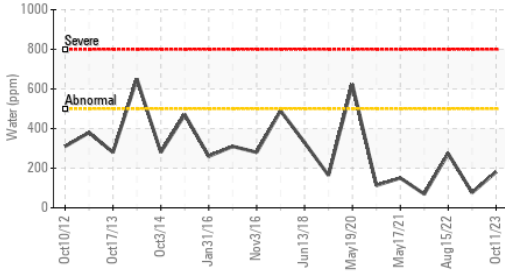


## PQ

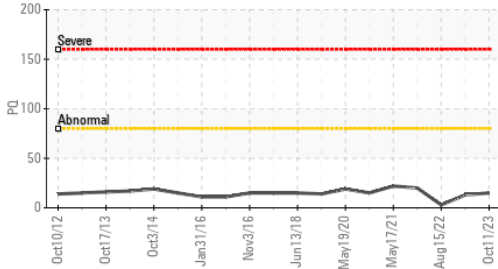

## Water (KF)

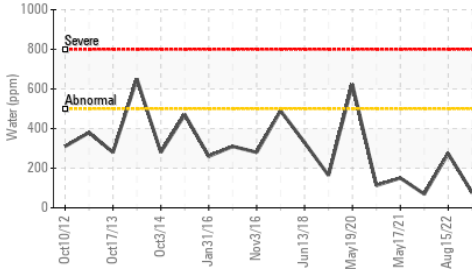

## Viscosity @ 40°C

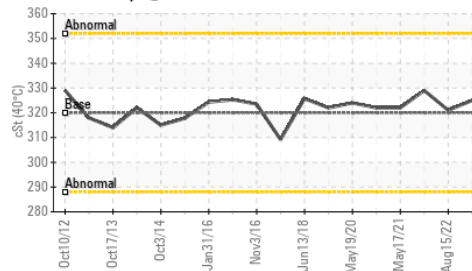

## FLUID DEGRADATION

method	limit/base	current	history1	history2
Acid Number (AN) mg KOH/g	ASTM D8045 1.6	<b>0.57</b>	0.326	0.60


## VISUAL

method	limit/base	current	history1	history2
White Metal	scalar *Visual	NONE	NONE	NONE
Yellow Metal	scalar *Visual	NONE	NONE	NONE
Precipitate	scalar *Visual	NONE	NONE	NONE
Silt	scalar *Visual	NONE	NONE	NONE
Debris	scalar *Visual	NONE	NONE	NONE
Sand/Dirt	scalar *Visual	NONE	NONE	NONE
Appearance	scalar *Visual	NORML	NORML	NORML
Odor	scalar *Visual	NORML	NORML	NORML
Emulsified Water	scalar *Visual	NEG	NEG	NEG
Free Water	scalar *Visual	NEG	NEG	NEG

## FLUID PROPERTIES


method	limit/base	current	history1	history2
Visc @ 40°C cSt	ASTM D445 320	<b>320</b>	325	321

## SAMPLE IMAGES

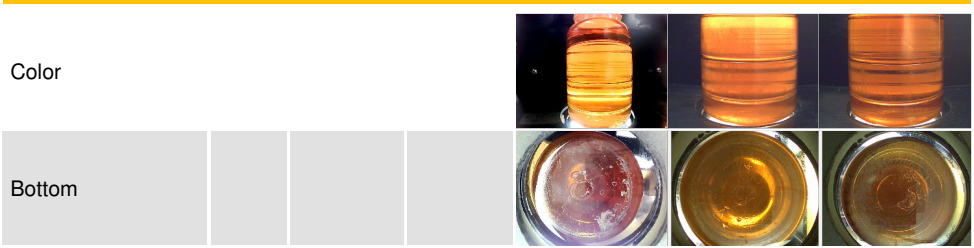


## GRAPHS


### Ferrous Alloys

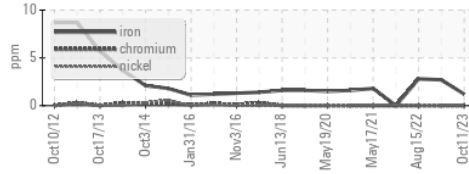


### Non-ferrous Metals

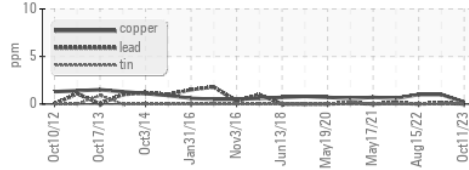


### Viscosity @ 40°C

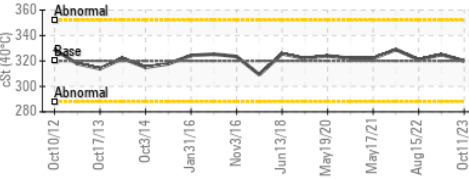

### Particle Count

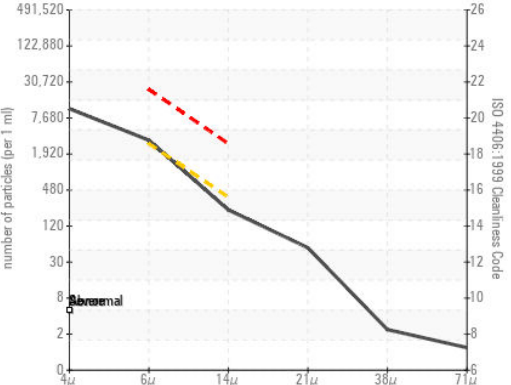

### Acid Number

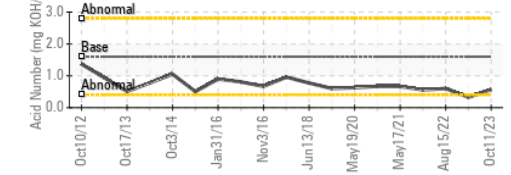

Certificate L2367

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : NX05999833 **Received** : 06 Nov 2023  
**Lab Number** : 05999833 **Diagnosed** : 08 Nov 2023  
**Unique Number** : 10728193 **Diagnostician** : Jonathan Hester  
**Test Package** : IND 2 ( Additional Tests: KF, PQ, PrtCount )

**NORDEX USA - Chicago**  
 300 SOUTH WACKER DRIVE, SUITE 1500  
 CHICAGO, IL  
 US 60606  
 Contact: DEVIN LINEHAN  
 DLinehan@nordex-online.com  
 T: (312)386-4124  
 F: (312)386-7102

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)