

OIL ANALYSIS REPORT

Sample Rating Trend

NORMAL

KAESER SK 20T 1373 - SK 20T

Compressor

KAESER SIGMA (OEM) S-460 (--- GAL)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

The amount and size of particulates present in the system are acceptable. There is no indication of any contamination in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORM	IATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KC124417		
Sample Date		Client Info		05 Nov 2023		
Machine Age	hrs	Client Info		0		
Oil Age	hrs	Client Info		0		
Oil Changed		Client Info		N/A		
Sample Status				NORMAL		
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0		
Chromium	ppm	ASTM D5185m	>10	0		
Nickel	ppm	ASTM D5185m	>3	0		
Titanium	ppm	ASTM D5185m	>3	0		
Silver	ppm	ASTM D5185m	>2	0		
Aluminum	ppm	ASTM D5185m	>10	0		
Lead	ppm	ASTM D5185m	>10	0		
Copper	ppm	ASTM D5185m	>50	5		
Tin	ppm	ASTM D5185m	>10	0		
Vanadium	ppm	ASTM D5185m	-	0		
Cadmium	ppm	ASTM D5185m		0		
ADDITIVES	lele	method	limit/base	current	history1	history2
						· · · · · · · · · · · · · · · · · · ·
Boron	ppm	ASTM D5185m	00	0		
Barium	ppm	ASTM D5185m	90	20		
Molybdenum	ppm	ASTM D5185m		0		
Manganese	ppm	ASTM D5185m	00	0		
Magnesium	ppm	ASTM D5185m	90	56		
Calcium	ppm	ASTM D5185m	2	<1		
Phosphorus	ppm	ASTM D5185m		<1		
Zinc	ppm	ASTM D5185m		0		
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	0		
Sodium	ppm	ASTM D5185m		19		
Potassium	ppm	ASTM D5185m	>20	3		
Water	%	ASTM D6304	>0.05	0.018		
ppm Water	ppm	ASTM D6304	>500	186.2		
FLUID CLEANLIN	ESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		1218		
Particles >6µm		ASTM D7647	>1300	327		
Particles >14µm		ASTM D7647	>80	29		
Particles >21µm		ASTM D7647	>20	9		
Particles >38µm		ASTM D7647	>4	0		
Particles >71µm		ASTM D7647	>3	0		
Oil Cleanliness		ISO 4406 (c)	>/17/13	17/16/12		
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.4	0.30		



OIL ANALYSIS REPORT

scalar

scalar

scalar

scalar

scalar

scalar

scalar

*Visual

*Visual

*Visua

*Visual

*Visual

*Visual

*Visual

scalar *Visual

NONE

NONE

NONE

NONE

NONE

NONE NORML

NORML

NONE

NONE

NONE

NONE

NONE

NONE

NORML

NORML

White Metal

Yellow Metal

Precipitate


Silt

Debris


Odor


Sand/Dirt

Appearance





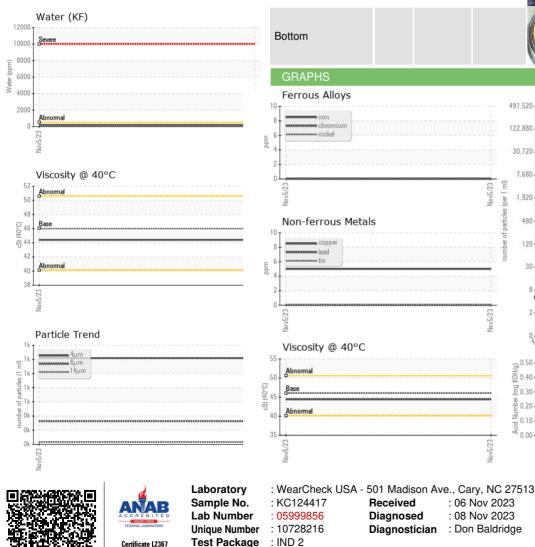

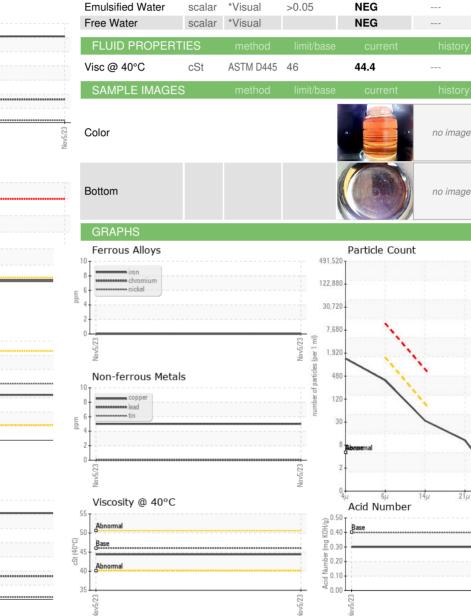



: Don Baldridge : 10728216 Diagnostician : IND 2 To discuss this sample report, contact Customer Service at 1-800-237-1369. * - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Received

Diagnosed

: 06 Nov 2023

:08 Nov 2023

Kaeser Compressor Corporate Office 511 SIGMA DRIVE FREDERICKSBURG, VA US 22408 **Contact: Warranty Department** warranty.us@kaeser.com T: (540)898-5500 F: (540)898-5520

Certificate L2367

no image

no image

4406

:1999 Cle

14