

No relevant graphs to display

RECOMMENDATION

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor. We were unable to perform a particle count due to a high concentration of particles present in this sample.

| PROBLEMATIC TEST RESULTS | | | | | | | |
|--------------------------|--------|---------|------|----------|--------|--|--|
| Sample Status | | | | ABNORMAL | NORMAL | | |
| Debris | scalar | *Visual | NONE | | NONE | | |

Customer Id: AMEKNOTN Sample No.: KCPA009784 Lab Number: 05999872 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data: Don Baldridge +1 <u>don.b505@comcast.net</u>

To change component or sample information: Customer Service +1 1-800-237-1369 customerservice@wearcheck.com

| RECOMMENDE | D ACTIONS | | | |
|------------|-----------|------|---------|---------------------------|
| Action | Status | Date | Done By | Descriptio |
| Alert | | | ? | We were u particles pr |

ion

unable to perform a particle count due to a high concentration of present in this sample.

HISTORICAL DIAGNOSIS



19 Jul 2022 Diag: Angela Borella

Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.All component wear rates are normal. The amount and size of particulates present in the system are acceptable. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.





OIL ANALYSIS REPORT

Sample Rating Trend



Machine Id 7892882 (S/N 1220) Component

Compressor Fluid KAESER SIGMA (OEM) S-460 (--- QTS)

DIAGNOSIS

Recommendation

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor. We were unable to perform a particle count due to a high concentration of particles present in this sample.

Wear

All component wear rates are normal.

Contamination

Moderate concentration of visible dirt/debris present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

| | | | JUI2022 | 0612023 | | |
|------------------|---------------|--------------------------|------------|-------------|-------------|----------|
| SAMPLE INFORM | IATION | method | limit/base | current | history1 | history2 |
| Sample Number | | Client Info | | KCPA009784 | KCP51581 | |
| Sample Date | | Client Info | | 31 Oct 2023 | 19 Jul 2022 | |
| Machine Age | hrs | Client Info | | 20321 | 9645 | |
| Oil Age | hrs | Client Info | | 0 | 6645 | |
| Oil Changed | | Client Info | | N/A | Changed | |
| Sample Status | | | | ABNORMAL | NORMAL | |
| WEAR METALS | | method | limit/base | | | history |
| | | | | current | history1 | history2 |
| Iron | ppm | ASTM D5185m | >50 | 0 | 0 | |
| Chromium | ppm | ASTM D5185m | >10 | 0 | 0 | |
| Nickel | ppm | ASTM D5185m | >3 | 0 | <1 | |
| Titanium | ppm | ASTM D5185m | >3 | 0 | 0 | |
| Silver | ppm | ASTM D5185m | >2 | 0 | <1 | |
| Aluminum | ppm | ASTM D5185m | >10 | 0 | 0 | |
| Lead | ppm | ASTM D5185m | >10 | 0 | 0 | |
| Copper | ppm | ASTM D5185m | >50 | 9 | 9 | |
| Tin | ppm | ASTM D5185m | >10 | <1 | 1 | |
| Vanadium | ppm | ASTM D5185m | | 0 | 0 | |
| Cadmium | ppm | ASTM D5185m | | 0 | 0 | |
| ADDITIVES | | method | limit/base | current | history1 | history2 |
| Boron | ppm | ASTM D5185m | | 0 | 0 | |
| Barium | ppm | ASTM D5185m | 90 | 0 | 0 | |
| Molybdenum | ppm | ASTM D5185m | | 0 | 0 | |
| Manganese | ppm | ASTM D5185m | | 0 | 0 | |
| Magnesium | ppm | ASTM D5185m | 90 | 0 | 0 | |
| Calcium | ppm | ASTM D5185m | 2 | 0 | 0 | |
| Phosphorus | ppm | ASTM D5185m | | <1 | 6 | |
| Zinc | ppm | ASTM D5185m | | 0 | 0 | |
| Sulfur | ppm | ASTM D5185m | | 10551 | 13722 | |
| CONTAMINANTS | | method | limit/base | current | history1 | history2 |
| Silicon | ppm | ASTM D5185m | | 0 | <1 | |
| Sodium | ppm | ASTM D5185m | 220 | <1 | 0 | |
| Potassium | | ASTM D5185m | >20 | 0 | 0 | |
| Water | ppm % | ASTM D5185III | | 0.007 | 0.006 | |
| ppm Water | | ASTM D6304 ASTM D6304 | | 77.9 | 61.7 | |
| | ppm | | | | - | |
| FLUID CLEANLIN | ESS | method | limit/base | current | history1 | history2 |
| Particles >4µm | | ASTM D7647 | 1005 | | 953 | |
| Particles >6µm | | ASTM D7647 | | | 170 | |
| Particles >14µm | | ASTM D7647 | >80 | | 36 | |
| Particles >21µm | | ASTM D7647 | >20 | | 12 | |
| Particles >38µm | | ASTM D7647 | >4 | | 1 | |
| Particles >71µm | | ASTM D7647 | >3 | | 0 | |
| Oil Cleanliness | | ISO 4406 (c) | >/17/13 | | 17/15/12 | |
| FLUID DEGRADA | TION | method | limit/base | current | history1 | history2 |
| Acid Number (AN) | mg KOH/g | ASTM D8045 | 0.4 | 0.44 | 0.40 | |
| | 99 | | | - 1 | - * | |



OIL ANALYSIS REPORT

method


limit/base


current


history1


history2

VISUAL







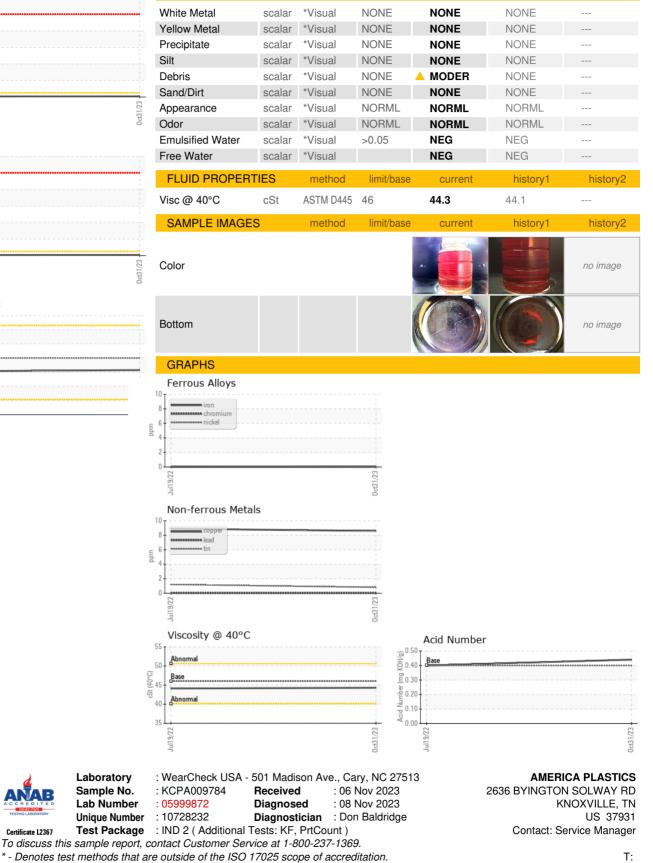

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Page 4 of 4

Certificate L2367

Laboratory

Sample No.