

PROBLEM SUMMARY

Sample Rating Trend

ISO

A


9048132 (S/N NOT GIVEN)

Component

Compressor

KAESER SIGMA (OEM) S-460 (--- QTS)

COMPONENT CONDITION SUMMARY

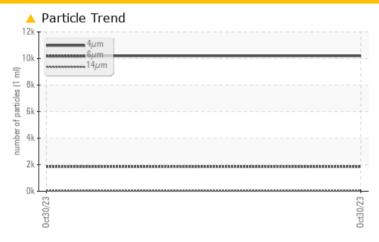

RECOMMENDATION

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

| PROBLEMATIC TEST RESULTS | | | | | | | | | |
|--------------------------|--------------|---------|-----------------|--|--|--|--|--|--|
| Sample Status | | | ATTENTION | | | | | | |
| Particles >6µm | ASTM D7647 | >1300 | 1852 | | | | | | |
| Oil Cleanliness | ISO 4406 (c) | >/17/13 | 21/18/12 | | | | | | |

Customer Id: INDUTI Sample No.: KCPA009144 Lab Number: 05999897 Test Package: IND 2

To manage this report scan the QR code

To discuss the diagnosis or test data:

Don Baldridge +1 don.b505@comcast.net

To change component or sample information: Customer Service +1 1-800-237-1369 customerservice@wearcheck.com

RECOMMENDED ACTIONS

There are no recommended actions for this sample.

HISTORICAL DIAGNOSIS



OIL ANALYSIS REPORT

Sample Rating Trend

ISO



9048132 (S/N NOT GIVEN)

Compressor

KAESER SIGMA (OEM) S-460 (--- QTS)

DIAGNOSIS

Recommendation

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a moderate amount of silt (particulates < 14 microns in size) present in the oil.


Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

| | | | | Oct2023 | | |
|------------------|----------|--------------|------------|-------------------|----------|----------|
| SAMPLE INFORM | MATION | method | limit/base | current | history1 | history2 |
| Sample Number | | Client Info | | KCPA009144 | | |
| Sample Date | | Client Info | | 30 Oct 2023 | | |
| Machine Age | hrs | Client Info | | 4057 | | |
| Oil Age | hrs | Client Info | | 0 | | |
| Oil Changed | | Client Info | | N/A | | |
| Sample Status | | | | ATTENTION | | |
| WEAR METALS | | method | limit/base | current | history1 | history2 |
| Iron | ppm | ASTM D5185m | >50 | <1 | | |
| Chromium | ppm | ASTM D5185m | >10 | 0 | | |
| Nickel | ppm | ASTM D5185m | >3 | 0 | | |
| Titanium | ppm | ASTM D5185m | >3 | 0 | | |
| Silver | ppm | ASTM D5185m | >2 | 0 | | |
| Aluminum | ppm | ASTM D5185m | >10 | 8 | | |
| Lead | ppm | ASTM D5185m | >10 | 0 | | |
| Copper | ppm | ASTM D5185m | >50 | 0 | | |
| Tin | ppm | ASTM D5185m | >10 | 0 | | |
| Vanadium | ppm | ASTM D5185m | | 0 | | |
| Cadmium | ppm | ASTM D5185m | | 0 | | |
| ADDITIVES | | method | limit/base | current | history1 | history2 |
| Boron | ppm | ASTM D5185m | | 0 | | |
| Barium | ppm | ASTM D5185m | 90 | 20 | | |
| Molybdenum | ppm | ASTM D5185m | | 0 | | |
| Manganese | ppm | ASTM D5185m | | 0 | | |
| Magnesium | ppm | ASTM D5185m | 90 | 9 | | |
| Calcium | ppm | ASTM D5185m | 2 | 0 | | |
| Phosphorus | ppm | ASTM D5185m | | 27 | | |
| Zinc | ppm | ASTM D5185m | | 50 | | |
| Sulfur | ppm | ASTM D5185m | | 10884 | | |
| CONTAMINANTS | | method | limit/base | current | history1 | history2 |
| Silicon | ppm | ASTM D5185m | >25 | 0 | | |
| Sodium | ppm | ASTM D5185m | | 7 | | |
| Potassium | ppm | ASTM D5185m | >20 | 4 | | |
| Water | % | ASTM D6304 | >0.05 | 0.008 | | |
| ppm Water | ppm | ASTM D6304 | >500 | 81.1 | | |
| FLUID CLEANLIN | ESS | method | limit/base | current | history1 | history2 |
| Particles >4µm | | ASTM D7647 | | 10191 | | |
| Particles >6µm | | ASTM D7647 | >1300 | <u> </u> | | |
| Particles >14µm | | ASTM D7647 | >80 | 29 | | |
| Particles >21µm | | ASTM D7647 | >20 | 3 | | |
| Particles >38µm | | ASTM D7647 | >4 | 0 | | |
| Particles >71µm | | ASTM D7647 | >3 | 0 | | |
| Oil Cleanliness | | ISO 4406 (c) | >/17/13 | <u>^</u> 21/18/12 | | |
| FLUID DEGRADA | TION | method | limit/base | current | history1 | history2 |
| Acid Number (AN) | mg KOH/g | ASTM D8045 | 0.4 | 0.34 | | |



OIL ANALYSIS REPORT

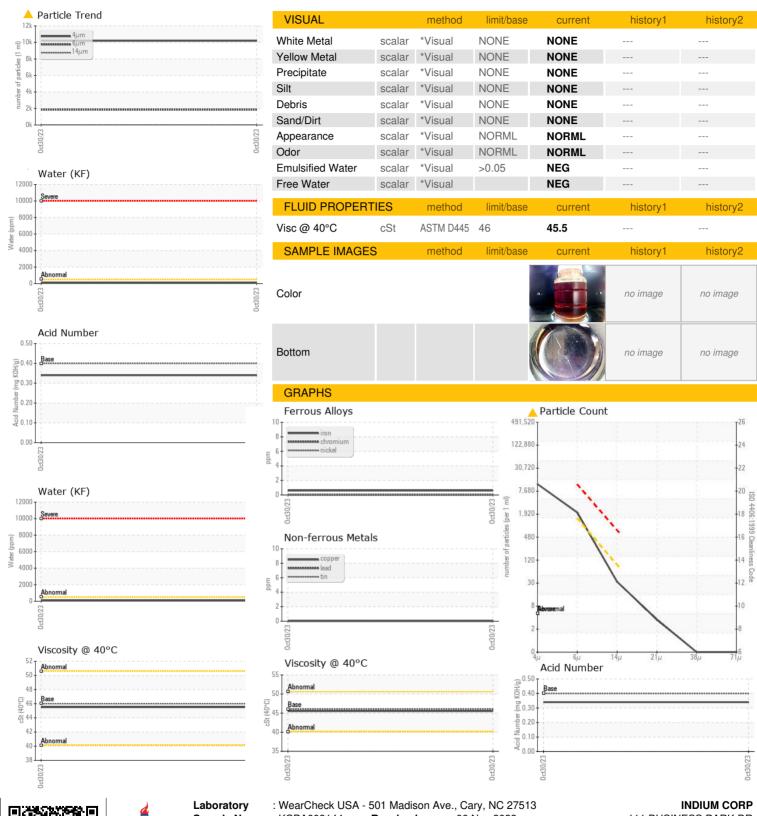



Certificate L2367

Sample No. Lab Number **Unique Number**

: KCPA009144

: 05999897 : 10728257

Received Diagnosed

: 06 Nov 2023 : 08 Nov 2023 Diagnostician : Don Baldridge

Test Package : IND 2 (Additional Tests: KF, PrtCount)

To discuss this sample report, contact Customer Service at 1-800-237-1369. * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

111 BUSINESS PARK DR UTICA, NY

US 13502

Contact: Service Manager

T: F: