


PROBLEM SUMMARY

Sample Rating Trend

ISO




Area
Marcus Hook/Cryogenic/Compressor
 Machine Id
CRYOGENIC COMPRESSOR 30-C-101A
 Component
Rotary Compressor
 Fluid
NOT GIVEN (220 GAL)

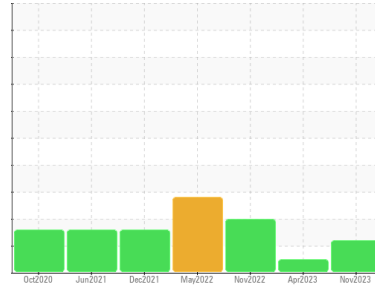

COMPONENT CONDITION SUMMARY

▲ Particle Trend

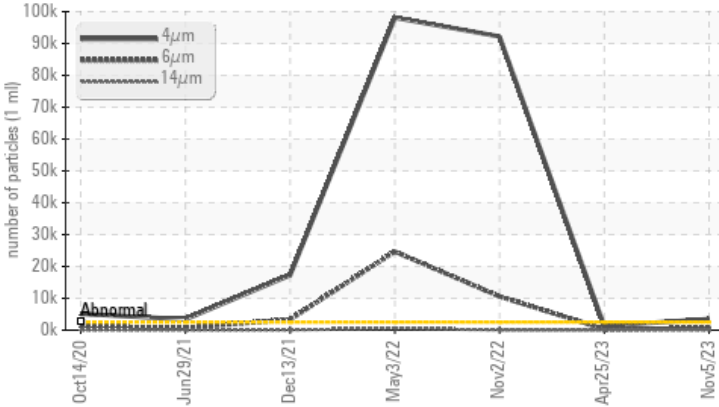

RECOMMENDATION

No corrective action is recommended at this time.
 Resample at the next service interval to monitor.

PROBLEMATIC TEST RESULTS

Sample Status			ATTENTION	NORMAL	ABNORMAL
Particles >4µm	ASTM D7647	>2500	▲ 3496	1318	▲ 92195
Particles >6µm	ASTM D7647	>320	▲ 580	313	▲ 10585
Oil Cleanliness	ISO 4406 (c)	>18/15/13	▲ 19/16/11	18/15/11	▲ 24/21/13

Customer Id: ETCMHOOK
 Sample No.: TO60001815
 Lab Number: 05999940
 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:
 Don Baldrige +1
don.b505@comcast.net

To change component or sample information:
 Customer Service +1 1-800-237-1369
customerservice@wearcheck.com

RECOMMENDED ACTIONS

There are no recommended actions for this sample.

HISTORICAL DIAGNOSIS

25 Apr 2023 Diag: Don Baldrige

NORMAL



Resample at the next service interval to monitor. All component wear rates are normal. The amount and size of particulates present in the system are acceptable. There is no indication of any contamination in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



02 Nov 2022 Diag: Jonathan Hester

VISCOSITY



No corrective action is recommended at this time. Resample at the next service interval to monitor. All component wear rates are normal. There is a high amount of silt (particulates < 14 microns in size) present in the oil. The oil viscosity is higher than normal. Confirm oil type. The AN level is acceptable for this fluid.

view report



03 May 2022 Diag: Don Baldrige

VISCOSITY




We recommend you service the filters on this component if applicable. Resample at the next service interval to monitor. All component wear rates are normal. There is a high amount of particulates present in the oil. The oil viscosity is higher than normal. Confirm oil type. The AN level is acceptable for this fluid.

view report



OIL ANALYSIS REPORT

Sample Rating Trend

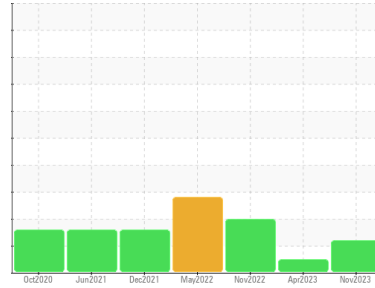

ISO



Area
Marcus Hook/Cryogenic/Compressor
 Machine Id
CRYOGENIC COMPRESSOR 30-C-101A
 Component
Rotary Compressor
 Fluid
NOT GIVEN (220 GAL)

DIAGNOSIS

Recommendation

No corrective action is recommended at this time. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a moderate amount of silt (particulates < 14 microns in size) present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	TO60001815	TO90003058	TO90002748
Sample Date	Client Info	05 Nov 2023	25 Apr 2023	02 Nov 2022
Machine Age	hrs	Client Info	0	0
Oil Age	hrs	Client Info	0	0
Oil Changed	Client Info	N/A	N/A	N/A
Sample Status		ATTENTION	NORMAL	ABNORMAL

WEAR METALS

method	limit/base	current	history1	history2	
Iron	ppm	ASTM D5185m >70	<1	2	3
Chromium	ppm	ASTM D5185m >10	0	0	0
Nickel	ppm	ASTM D5185m	0	0	0
Titanium	ppm	ASTM D5185m	0	0	0
Silver	ppm	ASTM D5185m	0	0	0
Aluminum	ppm	ASTM D5185m >3	0	0	<1
Lead	ppm	ASTM D5185m >4	0	0	0
Copper	ppm	ASTM D5185m >20	0	0	0
Tin	ppm	ASTM D5185m >3	0	0	0
Vanadium	ppm	ASTM D5185m	0	0	0
Cadmium	ppm	ASTM D5185m	0	0	0

ADDITIVES

method	limit/base	current	history1	history2	
Boron	ppm	ASTM D5185m	0	0	<1
Barium	ppm	ASTM D5185m	0	0	0
Molybdenum	ppm	ASTM D5185m	0	0	<1
Manganese	ppm	ASTM D5185m	0	0	0
Magnesium	ppm	ASTM D5185m	0	0	0
Calcium	ppm	ASTM D5185m	0	0	0
Phosphorus	ppm	ASTM D5185m	<1	<1	20
Zinc	ppm	ASTM D5185m	0	0	0
Sulfur	ppm	ASTM D5185m	6	0	0

CONTAMINANTS

method	limit/base	current	history1	history2	
Silicon	ppm	ASTM D5185m >45	<1	1	2
Sodium	ppm	ASTM D5185m	<1	0	<1
Potassium	ppm	ASTM D5185m >20	0	1	0
Water	%	ASTM D6304 >0.6	0.002	0.002	0.140
ppm Water	ppm	ASTM D6304	21.1	16.6	1400






FLUID CLEANLINESS

method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647 >2500	▲ 3496	1318	▲ 92195
Particles >6µm	ASTM D7647 >320	▲ 580	313	▲ 10585
Particles >14µm	ASTM D7647 >80	16	14	45
Particles >21µm	ASTM D7647 >20	5	3	4
Particles >38µm	ASTM D7647 >4	0	1	1
Particles >71µm	ASTM D7647 >3	0	0	0
Oil Cleanliness	ISO 4406 (c) >18/15/13	▲ 19/16/11	18/15/11	▲ 24/21/13

FLUID DEGRADATION

method	limit/base	current	history1	history2	
Acid Number (AN)	mg KOH/g	ASTM D8045	0.014	0.014	0.159

OIL ANALYSIS REPORT

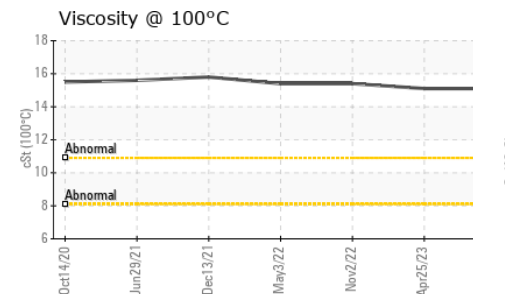
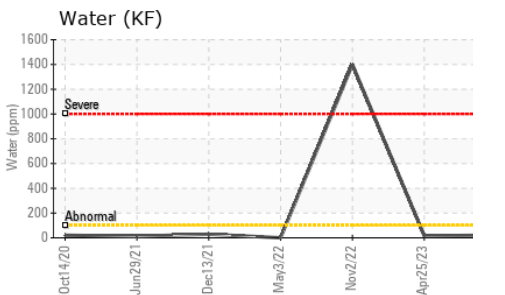
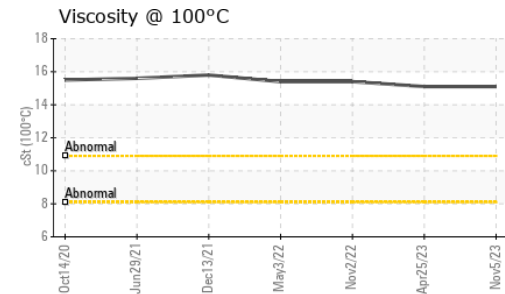
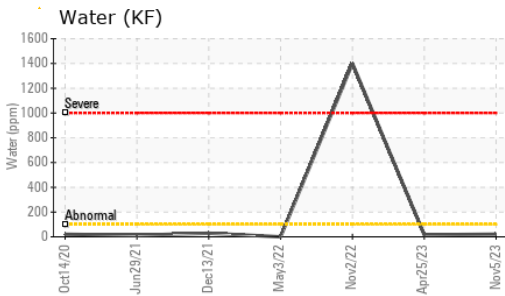
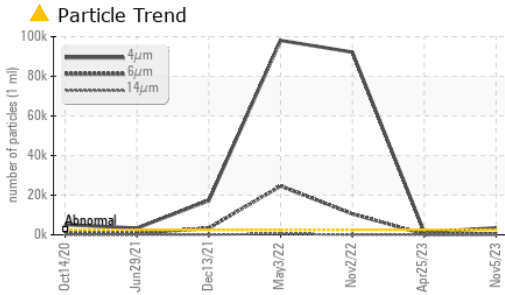


VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.6	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	95.5	95.9	▲ 95.7
Visc @ 100°C	cSt	ASTM D445	15.1	15.1	▲ 15.4
Viscosity Index (VI)	Scale	ASTM D2270	166	165	170

SAMPLE IMAGES	method	limit/base	current	history1	history2
Color					
Bottom					

GRAPHS

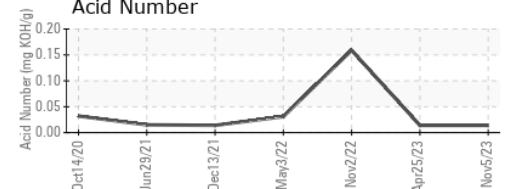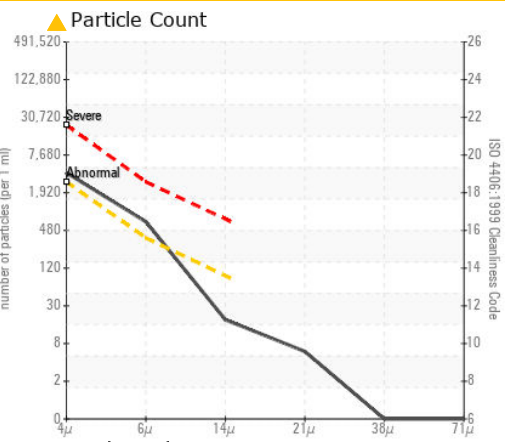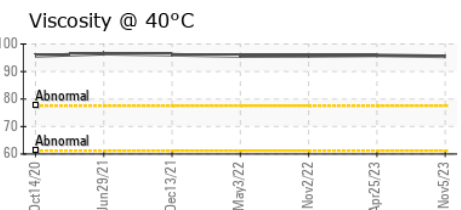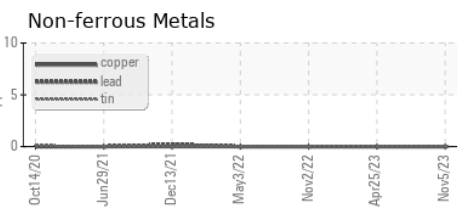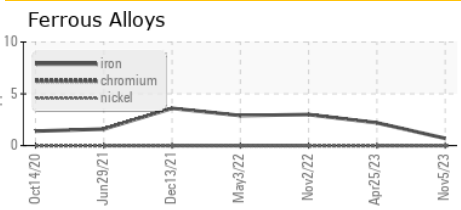

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : TO60001815 **Received** : 06 Nov 2023
Lab Number : 05999940 **Diagnosed** : 08 Nov 2023
Unique Number : 10728300 **Diagnostician** : Don Baldrige
Test Package : IND 2 (Additional Tests: KF, KV100, PrtCount, VI)

ENERGY TRANSFER - MARCUS HOOK
 2ND & GREEN STREETS
 MARCUS HOOK, PA
 US 19061
 Contact: CHRISTOPHER HOFFA
 christopher.hoffa@energytransfer.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)