PROBLEM SUMMARY

Sample Rating Trend

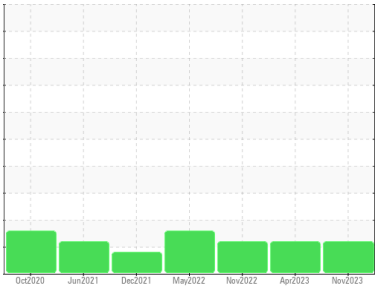

ISO

Area
Marcus Hook/Cryogenic/Compressor
Machine Id
CRYOGENIC COMPRESSOR 10-C-102B
Component
Rotary Compressor
Fluid
NOT GIVEN (825 GAL)

COMPONENT CONDITION SUMMARY

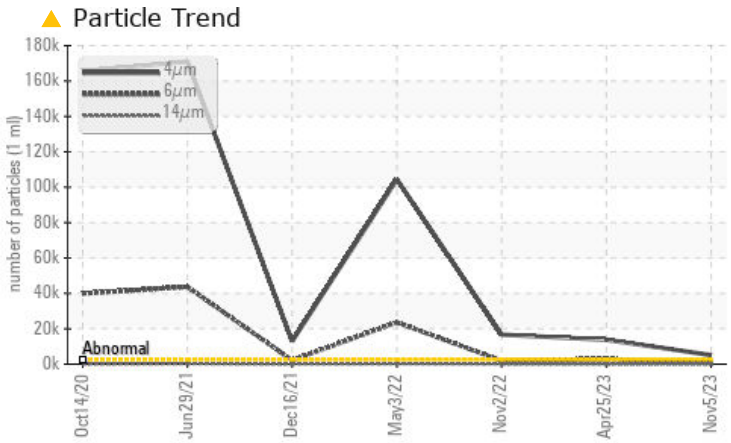

RECOMMENDATION

We recommend you service the filters on this component if applicable. Resample at the next service interval to monitor.

PROBLEMATIC TEST RESULTS

Sample Status				**ABNORMAL**	ABNORMAL	ABNORMAL
Particles >4µm		ASTM D7647	>2500	▲ **5127**	▲ 13791	▲ 16678
Particles >6µm		ASTM D7647	>320	▲ **743**	▲ 2843	▲ 1921
Oil Cleanliness		ISO 4406 (c)	>18/15/13	▲ **20/17/13**	▲ 21/19/12	▲ 21/18/12

Customer Id: ETCMHOOK
Sample No.: TO60001832
Lab Number: 05999948
Test Package: IND 2

To manage this report scan the QR code

To discuss the diagnosis or test data:
Angela Borella +1 800-237-1369
angela.borella@wearcheckusa.com

To change component or sample information:
Customer Service +1 1-800-237-1369
customerservice@wearcheck.com

RECOMMENDED ACTIONS

Action	Status	Date	Done By	Description
Change Filter	---	---	?	We recommend you service the filters on this component if applicable.

HISTORICAL DIAGNOSIS

25 Apr 2023 Diag: Don Baldridge

ISO

We recommend you service the filters on this component if applicable. Resample at the next service interval to monitor.All component wear rates are normal. There is a high amount of silt (particulates < 14 microns in size) present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report

02 Nov 2022 Diag: Jonathan Hester

ISO

We recommend you service the filters on this component if applicable. Resample at the next service interval to monitor.All component wear rates are normal. There is a high amount of silt (particulates < 14 microns in size) present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report

03 May 2022 Diag: Don Baldridge

ISO

We recommend you service the filters on this component. Resample at the next service interval to monitor.All component wear rates are normal. There is a high amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report

OIL ANALYSIS REPORT

Sample Rating Trend

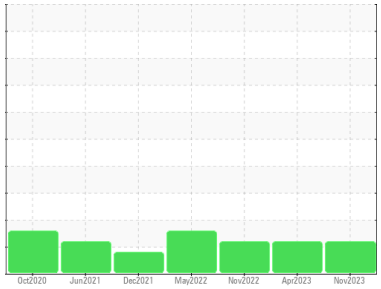

ISO

Area
Marcus Hook/Cryogenic/Compressor
Machine Id
CRYOGENIC COMPRESSOR 10-C-102B
Component
Rotary Compressor
Fluid
NOT GIVEN (825 GAL)

DIAGNOSIS

Recommendation
We recommend you service the filters on this component if applicable. Resample at the next service interval to monitor.

Wear
All component wear rates are normal.

Contamination
There is a high amount of silt (particulates < 14 microns in size) present in the oil.

Fluid Condition
The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number		Client Info		**TO60001832**	TO90003032	TO90002761
Sample Date		Client Info		**05 Nov 2023**	25 Apr 2023	02 Nov 2022
Machine Age	hrs	Client Info		**0**	0	0
Oil Age	hrs	Client Info		**0**	0	0
Oil Changed		Client Info		**N/A**	N/A	N/A
Sample Status				**ABNORMAL**	ABNORMAL	ABNORMAL

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>70	**11**	14	12
Chromium	ppm	ASTM D5185m	>10	**0**	0	0
Nickel	ppm	ASTM D5185m		**0**	0	0
Titanium	ppm	ASTM D5185m		**0**	0	0
Silver	ppm	ASTM D5185m		**0**	0	0
Aluminum	ppm	ASTM D5185m	>3	**0**	0	0
Lead	ppm	ASTM D5185m	>4	**0**	0	0
Copper	ppm	ASTM D5185m	>20	**0**	0	0
Tin	ppm	ASTM D5185m	>3	**<1**	0	<1
Vanadium	ppm	ASTM D5185m		**0**	0	0
Cadmium	ppm	ASTM D5185m		**0**	0	0

ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		**0**	0	1
Barium	ppm	ASTM D5185m		**0**	0	0
Molybdenum	ppm	ASTM D5185m		**0**	0	0
Manganese	ppm	ASTM D5185m		**<1**	<1	<1
Magnesium	ppm	ASTM D5185m		**<1**	<1	0
Calcium	ppm	ASTM D5185m		**13**	13	9
Phosphorus	ppm	ASTM D5185m		**13**	13	31
Zinc	ppm	ASTM D5185m		**2**	12	0
Sulfur	ppm	ASTM D5185m		**0**	6	0

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>45	**9**	9	8
Sodium	ppm	ASTM D5185m		**<1**	1	1
Potassium	ppm	ASTM D5185m	>20	**0**	<1	<1
Water	%	ASTM D6304	>0.6	**0.030**	0.223	0.056
ppm Water	ppm	ASTM D6304		**307.7**	2233.4	560

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647	>2500	▲ **5127**	▲ 13791	▲ 16678
Particles >6µm		ASTM D7647	>320	▲ **743**	▲ 2843	▲ 1921
Particles >14µm		ASTM D7647	>80	**42**	24	28
Particles >21µm		ASTM D7647	>20	**9**	4	5
Particles >38µm		ASTM D7647	>4	**0**	1	0
Particles >71µm		ASTM D7647	>3	**0**	0	0
Oil Cleanliness		ISO 4406 (c)	>18/15/13	▲ **20/17/13**	▲ 21/19/12	▲ 21/18/12

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045		**0.037**	0.044	0.112

OIL ANALYSIS REPORT

Particle Trend

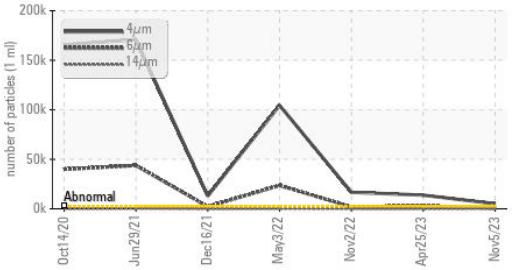

Water (KF)

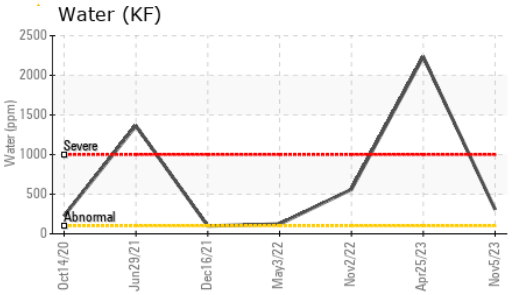

Viscosity @ 100°C

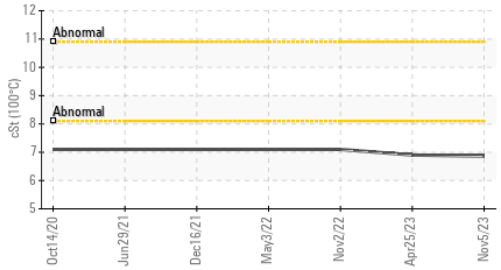

VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	**NONE**	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	**NONE**	NONE	NONE
Precipitate	scalar	*Visual	NONE	**NONE**	NONE	NONE
Silt	scalar	*Visual	NONE	**NONE**	NONE	NONE
Debris	scalar	*Visual	NONE	**NONE**	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	**NONE**	NONE	NONE
Appearance	scalar	*Visual	NORML	**NORML**	NORML	NORML
Odor	scalar	*Visual	NORML	**NORML**	NORML	NORML
Emulsified Water	scalar	*Visual	>0.6	**NEG**	NEG	NEG
Free Water	scalar	*Visual		**NEG**	NEG	NEG

FLUID PROPERTIES		method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445		**32.7**	33.3	33.65
Visc @ 100°C	cSt	ASTM D445		**6.86**	6.9	7.1
Viscosity Index (VI)	Scale	ASTM D2270		**176**	173	180

SAMPLE IMAGES	method	limit/base	current	history1	history2
Color					
Bottom					

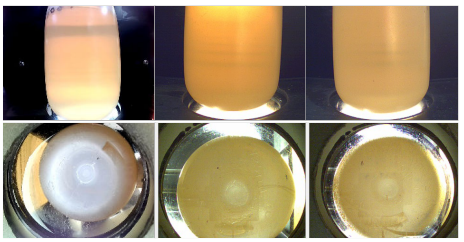

Water (KF)

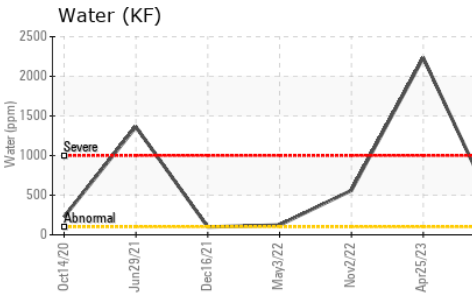

Viscosity @ 40°C

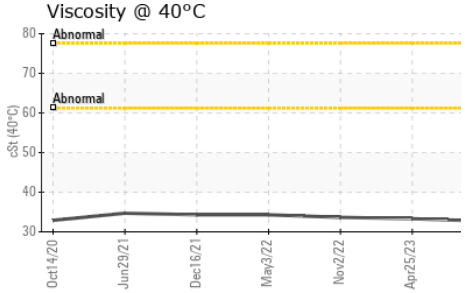

GRAPHS

Ferrous Alloys

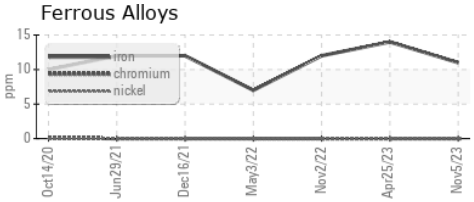

Non-ferrous Metals

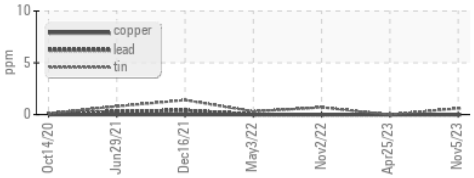

Viscosity @ 40°C

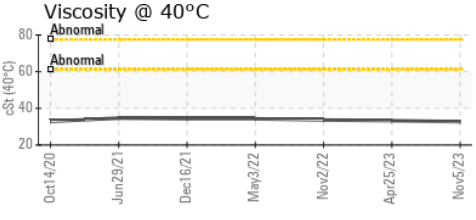

Particle Count

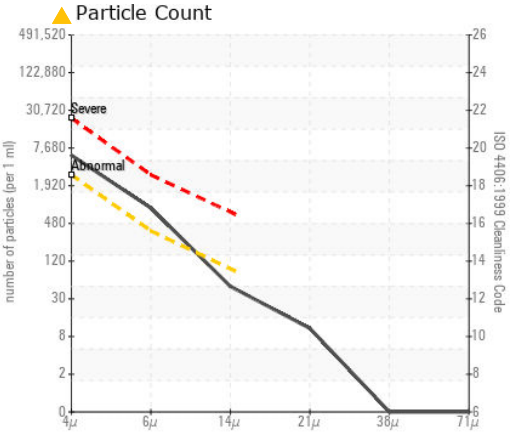

Acid Number

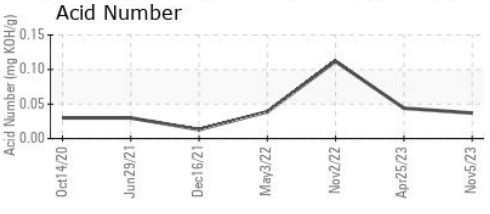

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : TO60001832 **Received** : 06 Nov 2023
Lab Number : 05999948 **Diagnosed** : 13 Nov 2023
Unique Number : 10728308 **Diagnostician** : Angela Borella
Test Package : IND 2 (Additional Tests: KF, KV100, PrtCount, VI)

To discuss this sample report, contact Customer Service at 1-800-237-1369.
** - Denotes test methods that are outside of the ISO 17025 scope of accreditation.*
Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

ENERGY TRANSFER - MARCUS HOOK
2ND & GREEN STREETS
MARCUS HOOK, PA
US 19061
Contact: CHRISTOPHER HOFFA
christopher.hoffa@energytransfer.com
T:
F:

Report Id: ETCMHOOK [WUSCAR] 05999948 (Generated: 11/13/2023 14:00:27) Rev: 1

Submitted By: ERIC THORNTON