




# OIL ANALYSIS REPORT

## Sample Rating Trend

**NORMAL**

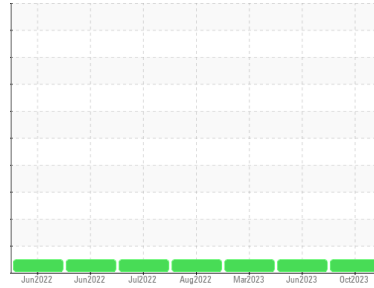

Machine Id  
**ASRI-TRL-TP-GNED-0001 ASRI-TRL-TP-GNED-0001**  
 Component  
**Diesel Engine**  
 Fluid  
**CHEVRON DELO 400 MULTIGRADE 15W40 (--- GAL)**

### DIAGNOSIS

#### Recommendation

Resample at the next service interval to monitor.

#### Wear

All component wear rates are normal.

#### Contamination

There is no indication of any contamination in the oil.

#### Fluid Condition

The BN result indicates that there is suitable alkalinity remaining in the oil. The condition of the oil is suitable for further service.

### SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>HLC0002277</b>	HLC0002566	HLC0002183
Sample Date	Client Info		<b>28 Oct 2023</b>	10 Jun 2023	14 Mar 2023
Machine Age	hrs	Client Info	<b>25314</b>	25002	24600
Oil Age	hrs	Client Info	<b>312</b>	402	370
Oil Changed	Client Info		<b>Changed</b>	Changed	Changed
Sample Status			<b>NORMAL</b>	NORMAL	NORMAL

### CONTAMINATION

	method	limit/base	current	history1	history2
Fuel	WC Method	>2.1	<b>&lt;1.0</b>	<1.0	<1.0
Glycol	WC Method		<b>NEG</b>	NEG	NEG

### WEAR METALS

	method	limit/base	current	history1	history2	
Iron	ppm	ASTM D5185m	>51	<b>6</b>	9	9
Chromium	ppm	ASTM D5185m	>11	<b>0</b>	<1	<1
Nickel	ppm	ASTM D5185m	>5	<b>0</b>	0	0
Titanium	ppm	ASTM D5185m		<b>&lt;1</b>	<1	<1
Silver	ppm	ASTM D5185m	>3	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m	>31	<b>&lt;1</b>	1	2
Lead	ppm	ASTM D5185m	>26	<b>0</b>	<1	0
Copper	ppm	ASTM D5185m	>26	<b>0</b>	0	<1
Tin	ppm	ASTM D5185m	>4	<b>0</b>	<1	0
Vanadium	ppm	ASTM D5185m		<b>0</b>	0	0
Cadmium	ppm	ASTM D5185m		<b>0</b>	0	0

### ADDITIVES

	method	limit/base	current	history1	history2	
Boron	ppm	ASTM D5185m	151	<b>93</b>	84	87
Barium	ppm	ASTM D5185m	0.4	<b>0</b>	0	0
Molybdenum	ppm	ASTM D5185m	250	<b>&lt;1</b>	1	1
Manganese	ppm	ASTM D5185m		<b>0</b>	<1	<1
Magnesium	ppm	ASTM D5185m	0	<b>775</b>	814	773
Calcium	ppm	ASTM D5185m	2046	<b>1394</b>	1418	1434
Phosphorus	ppm	ASTM D5185m	1043	<b>685</b>	718	737
Zinc	ppm	ASTM D5185m	943	<b>877</b>	880	858
Sulfur	ppm	ASTM D5185m	5012	<b>3107</b>	3743	3744

### CONTAMINANTS

	method	limit/base	current	history1	history2	
Silicon	ppm	ASTM D5185m	>22	<b>5</b>	4	4
Sodium	ppm	ASTM D5185m	>31	<b>3</b>	2	3
Potassium	ppm	ASTM D5185m	>20	<b>3</b>	3	2

### INFRA-RED



	method	limit/base	current	history1	history2	
Soot %	%	*ASTM D7844	>3	<b>0.3</b>	0.7	0.7
Nitration	Abs/cm	*ASTM D7624	>20	<b>8.4</b>	9.5	9.0
Sulfation	Abs/.1mm	*ASTM D7415	>30	<b>18.8</b>	20.4	19.8

### FLUID DEGRADATION

	method	limit/base	current	history1	history2	
Oxidation	Abs/.1mm	*ASTM D7414	>25	<b>13.6</b>	14.7	14.0
Base Number (BN)	mg KOH/g	ASTM D2896	12.5	<b>9.75</b>	9.85	10.69







# OIL ANALYSIS REPORT

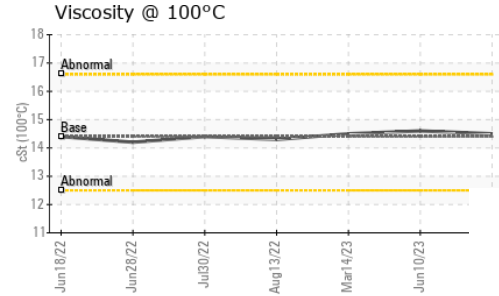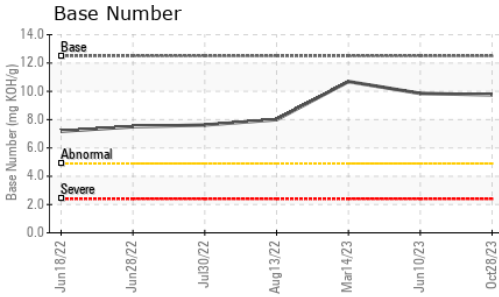

VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.21	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 100°C	cSt	ASTM D445	14.4	14.5	14.6

## GRAPHS

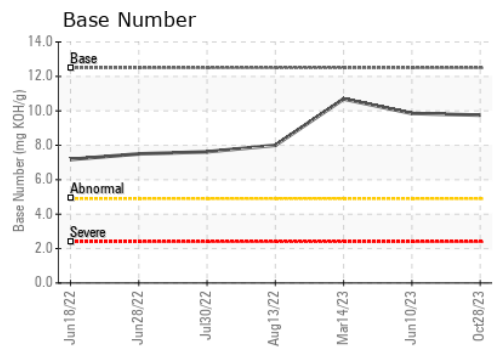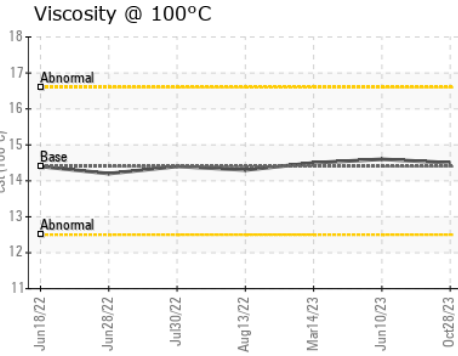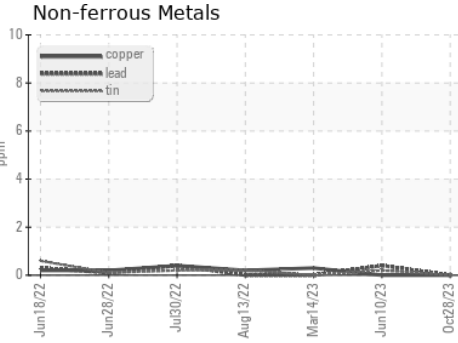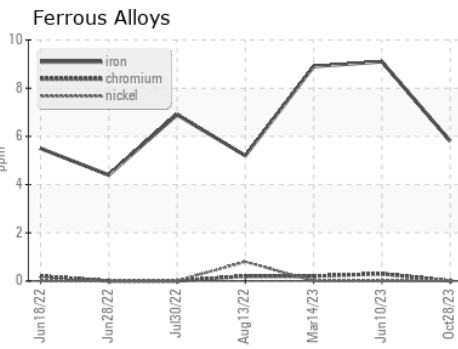

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : HLC0002277 **Received** : 06 Nov 2023  
**Lab Number** : 06000031 **Diagnosed** : 07 Nov 2023  
**Unique Number** : 10728391 **Diagnostician** : Wes Davis  
**Test Package** : IND 2

**HILCORP EXPLORATION ALASKA - MILNE POINT**  
 1000 MILNE POINT RD  
 PRUDOE BAY, AK  
 US 99734  
 Contact: Evan Reilly  
 evan.reilly@hilcorp.com  
 T: (907)670-3231  
 F: x:

Certificate L2367  
 To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)