




OIL ANALYSIS REPORT

Sample Rating Trend

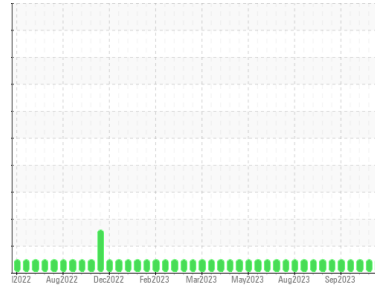

NORMAL



Area
WP29
Machine Id
MVR108-5 Effect
Component
Hydraulic System
Fluid
MOBIL DTE 25 (93 GAL)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

The system cleanliness is acceptable for your target ISO 4406 cleanliness code. The system and fluid cleanliness is acceptable.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	WC0834868	WC0834872	WC0834874
Sample Date	Client Info	01 Nov 2023	23 Oct 2023	10 Oct 2023
Machine Age	hrs Client Info	0	0	0
Oil Age	hrs Client Info	0	0	0
Oil Changed	Client Info	N/A	N/A	N/A
Sample Status		NORMAL	NORMAL	NORMAL

WEAR METALS

method	limit/base	current	history1	history2
Iron ppm ASTM D5185m	>20	0	0	0
Chromium ppm ASTM D5185m	>20	0	<1	0
Nickel ppm ASTM D5185m	>20	<1	<1	0
Titanium ppm ASTM D5185m		0	<1	0
Silver ppm ASTM D5185m		0	0	0
Aluminum ppm ASTM D5185m	>20	0	1	0
Lead ppm ASTM D5185m	>20	<1	0	0
Copper ppm ASTM D5185m	>20	<1	<1	0
Tin ppm ASTM D5185m	>20	0	<1	0
Vanadium ppm ASTM D5185m		0	0	0
Cadmium ppm ASTM D5185m		0	<1	<1

ADDITIVES

method	limit/base	current	history1	history2
Boron ppm ASTM D5185m		0	0	0
Barium ppm ASTM D5185m		0	0	3
Molybdenum ppm ASTM D5185m		0	<1	0
Manganese ppm ASTM D5185m		0	0	0
Magnesium ppm ASTM D5185m		1	<1	0
Calcium ppm ASTM D5185m		96	89	43
Phosphorus ppm ASTM D5185m		460	453	340
Zinc ppm ASTM D5185m		676	627	510
Sulfur ppm ASTM D5185m		2674	2720	963

CONTAMINANTS

method	limit/base	current	history1	history2
Silicon ppm ASTM D5185m	>15	1	1	0
Sodium ppm ASTM D5185m		2	0	<1
Potassium ppm ASTM D5185m	>20	<1	2	2

FLUID CLEANLINESS





method	limit/base	current	history1	history2
Particles >4µm ASTM D7647	>5000	781	754	537
Particles >6µm ASTM D7647	>1300	209	141	100
Particles >14µm ASTM D7647	>160	13	10	10
Particles >21µm ASTM D7647	>40	3	3	3
Particles >38µm ASTM D7647	>10	0	0	0
Particles >71µm ASTM D7647	>3	0	0	0
Oil Cleanliness ISO 4406 (c)	>19/17/14	17/15/11	17/14/10	16/14/10

FLUID DEGRADATION

method	limit/base	current	history1	history2
Acid Number (AN) mg KOH/g ASTM D8045		0.80	0.94	0.57




OIL ANALYSIS REPORT

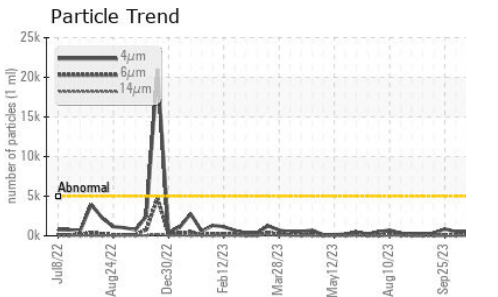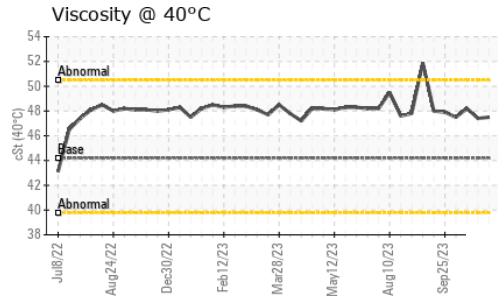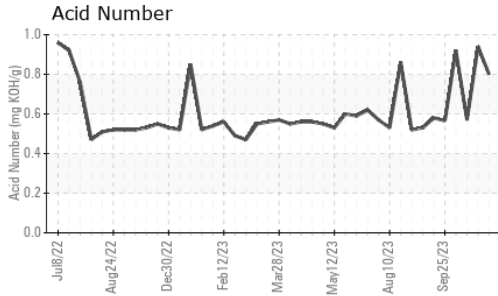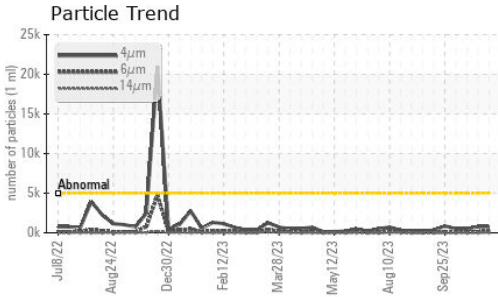






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	44.2	47.5	47.4

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

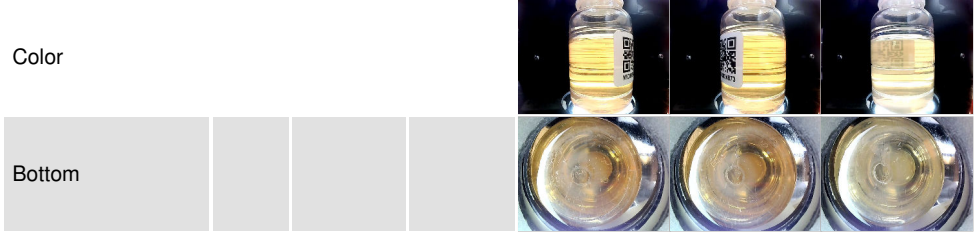

GRAPHS

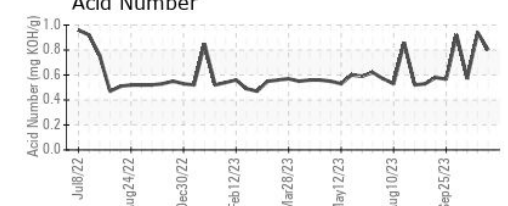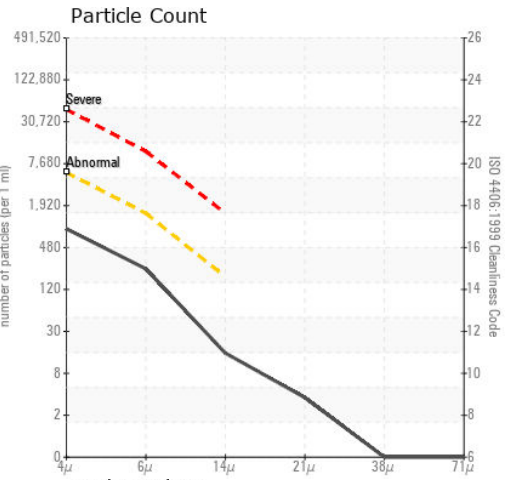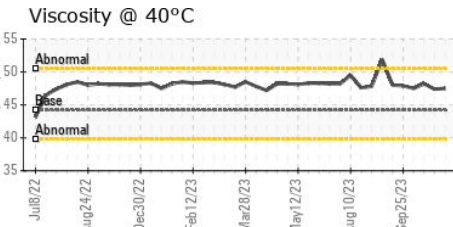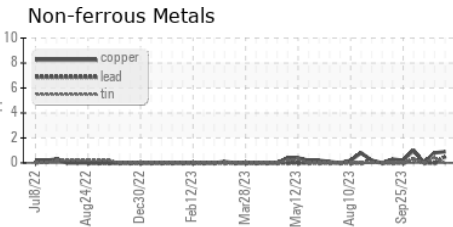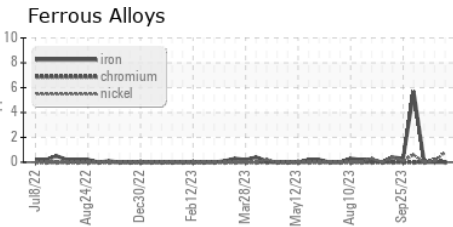

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
 Sample No. : WC0834868
 Lab Number : 06000467
 Unique Number : 10728827
 Test Package : IND 2

Received : 07 Nov 2023
 Diagnosed : 08 Nov 2023
 Diagnostician : Wes Davis

LEPRINO FOODS-ROSWELL
 5600 OMAHA RD
 ROSWELL, NM
 US 88203

Contact: VINCENT MCINTIRE
 vmcintire@leprinofoods.com
 T: (575)347-3261
 F: (505)347-5728

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)