


# OIL ANALYSIS REPORT

Sample Rating Trend



**NORMAL**

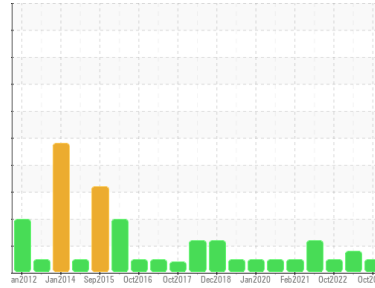

Machine Id  
**KAESER ASD30T 2762777 (S/N 1101)**

Component  
**Compressor**

Fluid  
**KAESER SIGMA (OEM) S-460 (--- GAL)**

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>KC124405</b>	KC101507	KC85875
Sample Date	Client Info		<b>23 Oct 2023</b>	27 Mar 2023	03 Oct 2022
Machine Age	hrs	Client Info	<b>29375</b>	29262	29167
Oil Age	hrs	Client Info	<b>0</b>	2000	1500
Oil Changed	Client Info		<b>N/A</b>	Changed	Not Changed
Sample Status			<b>NORMAL</b>	ATTENTION	NORMAL

## WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >50	<b>0</b>	0	0
Chromium	ppm	ASTM D5185m >10	<b>0</b>	0	0
Nickel	ppm	ASTM D5185m >3	<b>&lt;1</b>	0	0
Titanium	ppm	ASTM D5185m >3	<b>0</b>	0	0
Silver	ppm	ASTM D5185m >2	<b>0</b>	0	<1
Aluminum	ppm	ASTM D5185m >10	<b>&lt;1</b>	<1	<1
Lead	ppm	ASTM D5185m >10	<b>&lt;1</b>	0	0
Copper	ppm	ASTM D5185m >50	<b>3</b>	7	8
Tin	ppm	ASTM D5185m >10	<b>0</b>	0	<1
Vanadium	ppm	ASTM D5185m	<b>0</b>	0	0
Cadmium	ppm	ASTM D5185m	<b>0</b>	0	0

## ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	<b>0</b>	0	0
Barium	ppm	ASTM D5185m 90	<b>26</b>	0	0
Molybdenum	ppm	ASTM D5185m	<b>0</b>	0	0
Manganese	ppm	ASTM D5185m	<b>&lt;1</b>	<1	0
Magnesium	ppm	ASTM D5185m 90	<b>79</b>	25	23
Calcium	ppm	ASTM D5185m 2	<b>1</b>	0	0
Phosphorus	ppm	ASTM D5185m	<b>2</b>	<1	2
Zinc	ppm	ASTM D5185m	<b>0</b>	62	55

## CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >25	<b>0</b>	0	0
Sodium	ppm	ASTM D5185m	<b>11</b>	8	5
Potassium	ppm	ASTM D5185m >20	<b>4</b>	1	3
Water	%	ASTM D6304 >0.05	<b>0.024</b>	0.012	0.007
ppm Water	ppm	ASTM D6304 >500	<b>244.2</b>	120.3	76.9






## FLUID CLEANLINESS

	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647		<b>2068</b>	9555	3927
Particles >6µm	ASTM D7647 >1300		<b>597</b>	▲ 1389	861
Particles >14µm	ASTM D7647 >80		<b>44</b>	34	50
Particles >21µm	ASTM D7647 >20		<b>10</b>	6	12
Particles >38µm	ASTM D7647 >4		<b>0</b>	0	1
Particles >71µm	ASTM D7647 >3		<b>0</b>	0	0
Oil Cleanliness	ISO 4406 (c)	>--/17/13	<b>18/16/13</b>	▲ 20/18/12	19/17/13

## FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045 0.4	<b>0.38</b>	0.34	0.38


# OIL ANALYSIS REPORT

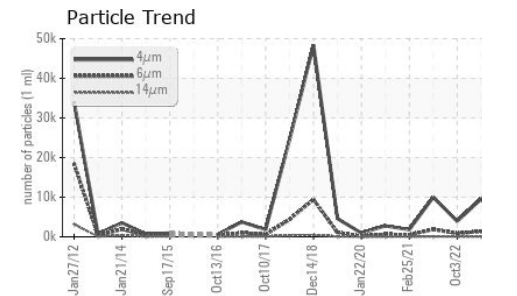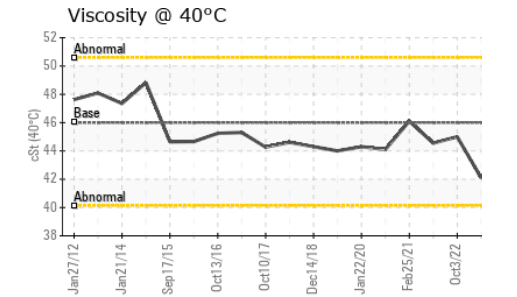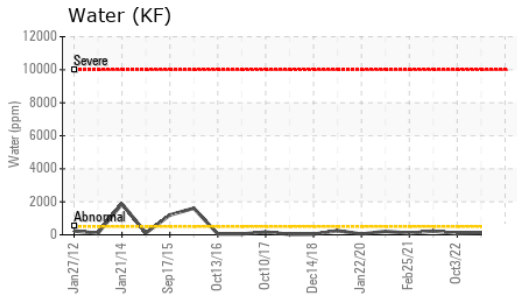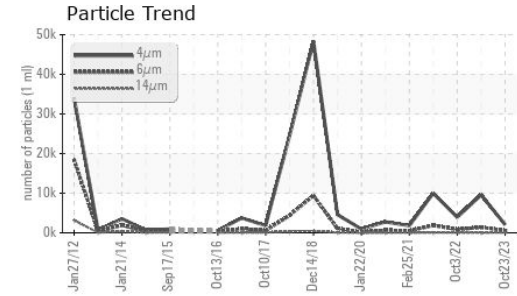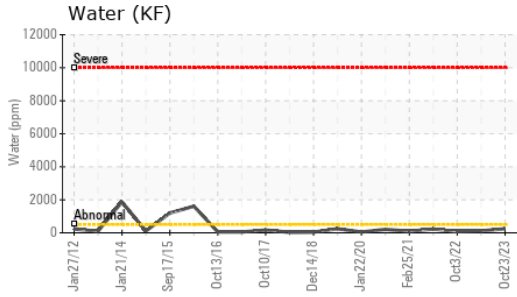






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	46	44.1	42.1

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

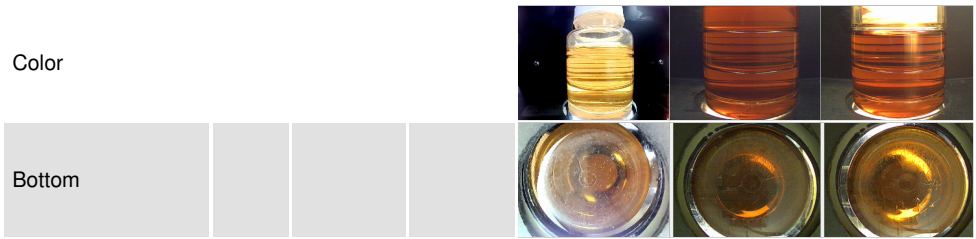

## GRAPHS

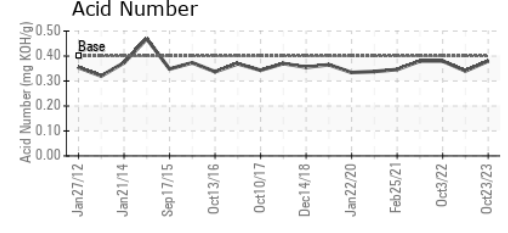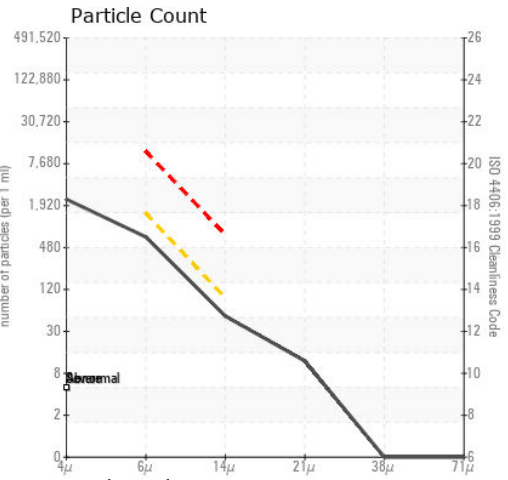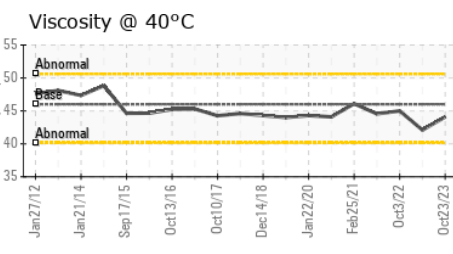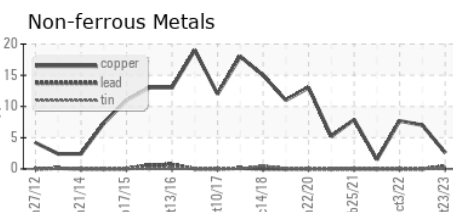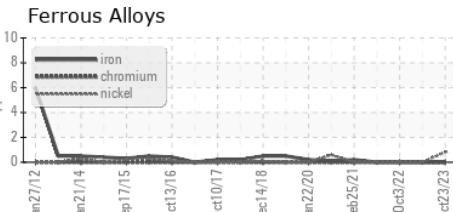

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : KC124405  
**Lab Number** : 06000519  
**Unique Number** : 10728879  
**Test Package** : IND 2

**MSA - MINE SAFETY APPLIANCE**  
 1100 CRANBERRY WOODS DR  
 CRANBERRY, PA  
 US 16066  
 Contact: SERVICE MANAGER

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:  
F: