


## **PROBLEM SUMMARY**

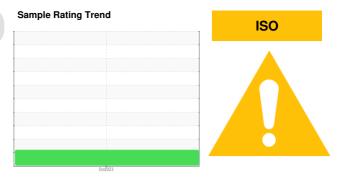


# KAESER 8702864 (S/N 2133)

Compressor Fluid

### KAESER SIGMA (OEM) M-460 (--- GAL)

#### COMPONENT CONDITION SUMMARY

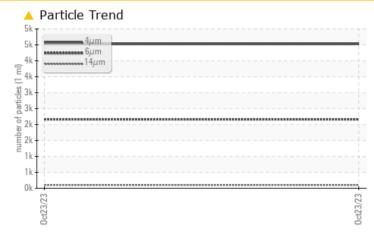

#### RECOMMENDATION

No corrective action is recommended at this time. Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

PROBLEMATIC TEST RESULTS								
Sample Status			ATTENTION					
Particles >6µm	ASTM D7647	>1300	🔺 2163					
Particles >14µm	ASTM D7647	>80	<b>A</b> 103					
Oil Cleanliness	ISO 4406 (c)	>/17/13	<u> </u>					

Customer Id: FASWAS Sample No.: KC107509 Lab Number: 06000539 Test Package: IND 2



To manage this report scan the QR code

*To discuss the diagnosis or test data:* Jonathan Hester +1 919-379-4092 x4092 jhester@wearcheckusa.com

*To change component or sample information:* Customer Service +1 1-800-237-1369 <u>customerservice@wearcheck.com</u>

RECOMMENDED ACTIONS							
Action	Status	Date	Done By	Description			
Change Fluid			?	Oil and filter change at the time of sampling has been noted.			
Change Filter			?	Oil and filter change at the time of sampling has been noted.			

HISTORICAL DIAGNOSIS



## **OIL ANALYSIS REPORT**





# KAESER 8702864 (S/N 2133)

Compressor Fluid KAESER SIGMA (OEM) M-460 (--- GAL)

#### DIAGNOSIS

#### Recommendation

No corrective action is recommended at this time. Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

#### Wear

All component wear rates are normal.

#### Contamination

There is a moderate amount of particulates present in the oil.


#### Fluid Condition


The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORM	<b>IATION</b>	method	limit/base	current	history1	history2
Sample Number		Client Info		KC107509		
Sample Date		Client Info		23 Oct 2023		
Machine Age	hrs	Client Info		927		
Oil Age	hrs	Client Info		927		
Oil Changed		Client Info		Changed		
Sample Status				ATTENTION		
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0		
Chromium	ppm	ASTM D5185m	>10	0		
Nickel	ppm	ASTM D5185m	>3	<1		
Titanium	ppm	ASTM D5185m	>3	0		
Silver	ppm	ASTM D5185m	>2	0		
Aluminum	ppm	ASTM D5185m	>10	0		
Lead	ppm	ASTM D5185m	>10	1		
Copper	ppm	ASTM D5185m	>50	2		
Tin	ppm	ASTM D5185m	>10	0		
Vanadium	ppm	ASTM D5185m	210	0		
Cadmium	ppm	ASTM D5185m		0		
ADDITIVES	T- T-	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0		
Barium		ASTM D5185m	90	0		
Molybdenum	ppm	ASTM D5185m	90 0	0		
,	ppm		0	0 <1		
Manganese Magnesium	ppm	ASTM D5185m ASTM D5185m	100	<1 52		
0	ppm			52 <1		
Calcium	ppm	ASTM D5185m	0			
Phosphorus Zinc	ppm	ASTM D5185m	0	2		
	ppm			-		
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	0		
Sodium	ppm	ASTM D5185m		8		
Potassium	ppm	ASTM D5185m	>20	6		
Water	%		>0.05	0.023		
ppm Water	ppm	ASTM D6304	>500	233.3		
FLUID CLEANLIN	ESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		4527		
Particles >6µm		ASTM D7647	>1300	<u> </u>		
Particles >14µm		ASTM D7647	>80	<b>A</b> 103		
Particles >21µm		ASTM D7647	>20	19		
Particles >38µm		ASTM D7647	>4	2		
Particles >71µm		ASTM D7647	>3	0		
Oil Cleanliness		ISO 4406 (c)	>/17/13	<b>1</b> 9/18/14		
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	1.0	0.36		





### Built for a lifetime







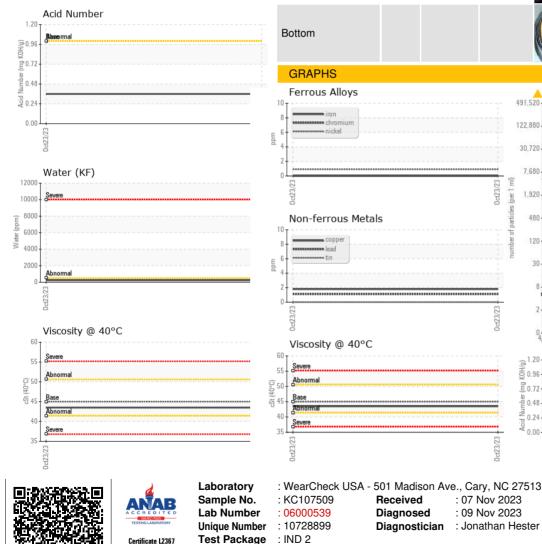

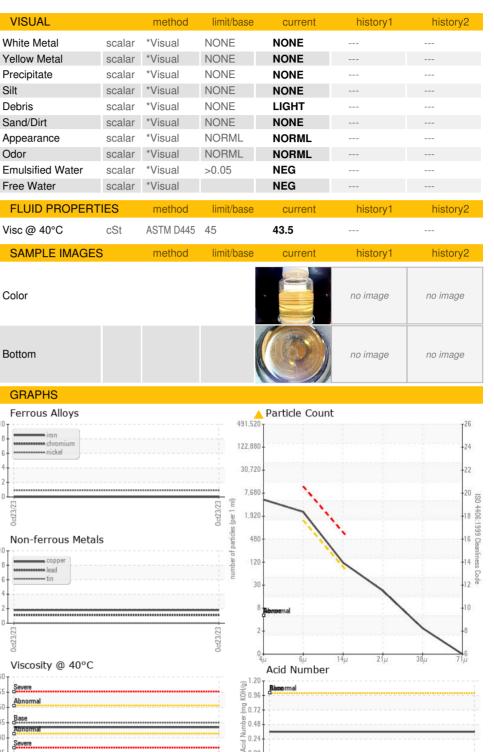

: Jonathan Hester Diagnostician Contact: Service Manager To discuss this sample report, contact Customer Service at 1-800-237-1369.

: 07 Nov 2023

: 09 Nov 2023

0.00

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Received

Diagnosed

Contact/Location: Service Manager - FASWAS

FAST SPLASH

US 15301

WASHINGTON, PA

235 E WASHINGTON AVE