

PROBLEM SUMMARY

KAESER 8842915


Component

Compressor

KAESER SIGMA (OEM) S-460 (--- QTS)

Sample Rating Trend ISO October

COMPONENT CONDITION SUMMARY

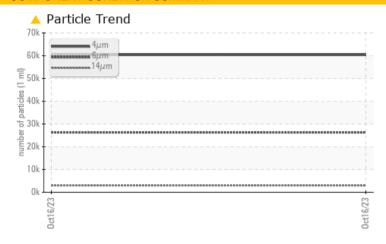

RECOMMENDATION

Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

PROBLEMATIC TEST RESULTS									
Sample Status		ABNORMAL							
Particles >6µm	ASTM D7647 >1300	26306							
Particles >14μm	ASTM D7647 >80	2992							
Particles >21µm	ASTM D7647 >20	<u> </u>							
Particles >38μm	ASTM D7647 >4	4 34							
Particles >71µm	ASTM D7647 >3	<u>^</u> 2							
Oil Cleanliness	ISO 4406 (c) >/17/1	3 A 23/22/19							

Customer Id: PEHPHI Sample No.: KC111639 Lab Number: 06000545 Test Package: IND 2

To manage this report scan the QR code

To discuss the diagnosis or test data: Jonathan Hester +1 919-379-4092 x4092 jhester@wearcheckusa.com

To change component or sample information: Customer Service +1 1-800-237-1369 customerservice@wearcheck.com

RECOMMENDED ACTIONS					
Action	Status	Date	Done By	Description	
Change Fluid			?	Oil and filter change at the time of sampling has been noted.	
Change Filter			?	Oil and filter change at the time of sampling has been noted.	

HISTORICAL DIAGNOSIS




OIL ANALYSIS REPORT

KAESER 8842915

Component

Compressor

KAESER SIGMA (OEM) S-460 (--- QTS)





DIAGNOSIS

Recommendation

Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a high amount of particulates present in the oil.


Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

				Oct2023		
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KC111639		
Sample Date		Client Info		16 Oct 2023		
Machine Age	hrs	Client Info		2068		
Oil Age	hrs	Client Info		2068		
Oil Changed		Client Info		Changed		
Sample Status				ABNORMAL		
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0		
Chromium	ppm	ASTM D5185m	>10	0		
Nickel	ppm	ASTM D5185m	>3	<1		
Titanium	ppm	ASTM D5185m	>3	0		
Silver	ppm	ASTM D5185m	>2	0		
Aluminum	ppm	ASTM D5185m	>10	0		
Lead	ppm	ASTM D5185m	>10	<1		
Copper	ppm	ASTM D5185m	>50	10		
Tin	ppm	ASTM D5185m	>10	0		
Vanadium	ppm	ASTM D5185m		0		
Cadmium	ppm	ASTM D5185m		0		
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0		
Barium	ppm	ASTM D5185m	90	0		
Molybdenum	ppm	ASTM D5185m		0		
Manganese	ppm	ASTM D5185m		<1		
Magnesium	ppm	ASTM D5185m	90	<1		
Calcium	ppm	ASTM D5185m	2	0		
Phosphorus	ppm	ASTM D5185m		2		
Zinc	ppm	ASTM D5185m		0		
CONTAMINANTS	3	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<1		
Sodium	ppm	ASTM D5185m		2		
Potassium	ppm	ASTM D5185m	>20	<1		
Water	%	ASTM D6304	>0.05	0.009		
ppm Water	ppm	ASTM D6304	>500	92.8		
FLUID CLEANLIN	NESS	method	limit/base	current	history1	history2
Particles >4μm		ASTM D7647		60342		
Particles >6µm		ASTM D7647	>1300	<u>^</u> 26306		
Particles >14μm		ASTM D7647	>80	<u>^</u> 2992		
Particles >21μm		ASTM D7647	>20	<u> </u>		
Particles >38µm		ASTM D7647	>4	4 34		
Particles >71µm		ASTM D7647	>3	<u>^</u> 2		
Oil Cleanliness		ISO 4406 (c)	>/17/13	<u>23/22/19</u>		
FLUID DEGRADA	ATION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.4	0.30		



OIL ANALYSIS REPORT

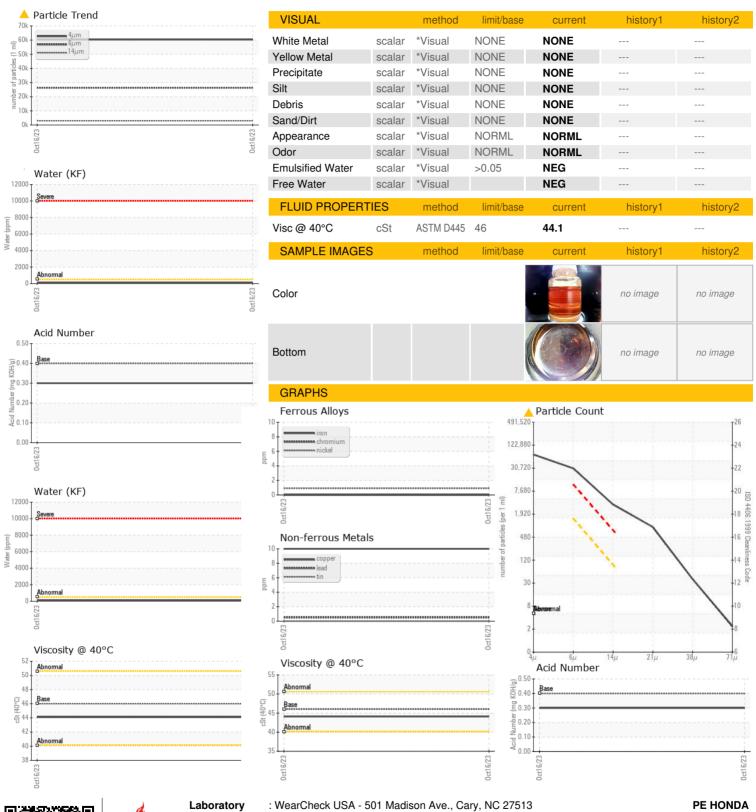





Certificate L2367

Sample No. Lab Number **Unique Number** Test Package

: KC111639 : 06000545

: 10728905 : IND 2

: 07 Nov 2023 Received Diagnosed : 09 Nov 2023 : Jonathan Hester Diagnostician

400 CITY RD S 19 PHILLIPSBURG, NJ

Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

US 08865

T: F: