


PROBLEM SUMMARY

KAESER BSD50 6948677 (S/N 2136)

Compressor

KAESER SIGMA (OEM) S-460 (--- QTS)

COMPONENT CONDITION SUMMARY

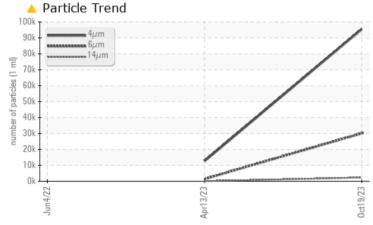

RECOMMENDATION

The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

PROBLEMATIC TEST RESULTS									
Sample Status			ABNORMAL	ATTENTION	ABNORMAL				
Particles >6µm	ASTM D7647	>1300	A 30123	1 438					
Particles >14µm	ASTM D7647	>80	<u> </u>	67					
Particles >21µm	ASTM D7647	>20	<u> </u>	16					
Particles >38µm	ASTM D7647	>4	<u> </u>	0					
Oil Cleanliness	ISO 4406 (c)	>/17/13	<u> </u>	1 21/18/13					


Customer Id: ALESEB Sample No.: KC06000551 Lab Number: 06000551 Test Package: IND 2



To manage this report scan the QR code


To discuss the diagnosis or test data: Jonathan Hester +1 919-379-4092 x4092 <u>jhester@wearcheckusa.com</u>

To change component or sample information: Customer Service +1 1-800-237-1369 <u>customerservice@wearcheck.com</u>

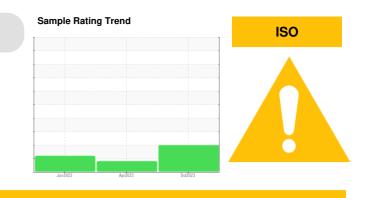

There are no recommended actions for this sample.

HISTORICAL DIAGNOSIS



Oil and filter change at the time of sampling has been noted. No corrective action is recommended at this time. Resample at the next service interval to monitor.All component wear rates are normal. There is a moderate amount of silt (particulates < 14 microns in size) present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

04 Jun 2022 Diag: Don Baldridge



We recommend you service the filters on this component. Resample at the next service interval to monitor. We were unable to perform a particle count due to a high concentration of particles present in this sample. The chromium level is abnormal. All other component wear rates are normal. Moderate concentration of visible dirt/debris present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.







OIL ANALYSIS REPORT

Machine Id KAESER BSD50 6948677 (S/N 2136) Component

Compressor Fluid

KAESER SIGMA (OEM) S-460 (--- QTS)

DIAGNOSIS

Recommendation

The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear


All component wear rates are normal.

Contamination

There is a high amount of particulates present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

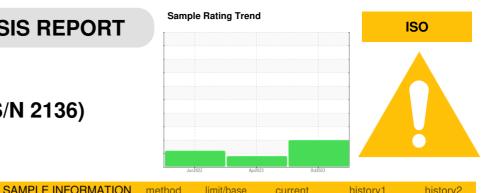

SAMPLE INFORM	ΛΑΤΙΟΝ	method	limit/base	current	history1	history2
Sample Number		Client Info		KC06000551	KC101784	KC91202
Sample Date		Client Info		19 Oct 2023	13 Apr 2023	04 Jun 2022
Machine Age	hrs	Client Info		28312	25583	18586
Oil Age	hrs	Client Info		0	7000	1100
Oil Changed		Client Info		N/A	Changed	Not Changd
Sample Status				ABNORMAL	ATTENTION	ABNORMAL
· ·		and the set	1			
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0	0	26
Chromium	ppm	ASTM D5185m	>10	0	0	▲ 11
Nickel	ppm	ASTM D5185m	>3	1	0	0
Titanium	ppm	ASTM D5185m	>3	0	0	<1
Silver	ppm	ASTM D5185m	>2	0	0	0
Aluminum	ppm	ASTM D5185m	>10	<1	<1	6
Lead	ppm	ASTM D5185m	>10	<1	0	<1
Copper	ppm	ASTM D5185m	>50	8	2	<1
Tin	ppm	ASTM D5185m	>10	0	0	0
Vanadium	ppm	ASTM D5185m		0	0	0
Cadmium	ppm	ASTM D5185m		0	0	0
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	0
Barium	ppm	ASTM D5185m	90	0	0	0
Molybdenum	ppm	ASTM D5185m		0	0	0
Manganese	ppm	ASTM D5185m		<1	0	2
Magnesium	ppm	ASTM D5185m	90	12	0	6
Calcium	ppm	ASTM D5185m	2	<1	0	10
Phosphorus	ppm	ASTM D5185m		20	169	493
Zinc	ppm	ASTM D5185m		0	0	0
CONTAMINANTS	5	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	0	0	13
Sodium	ppm	ASTM D5185m		5	0	0
Potassium	ppm	ASTM D5185m	>20	1	0	1
Water	%	ASTM D6304	>0.05	0.016	0.007	0.013
ppm Water	ppm	ASTM D6304	>500	161.0	74.9	138.5
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		95370	12625	
Particles >6µm		ASTM D7647	>1300	A 30123	1 438	
Particles >14µm		ASTM D7647	>80	A 2343	67	
Particles >21µm		ASTM D7647		▲ 745	16	
Particles >38µm		ASTM D7647	>4	<u>▲</u> 24	0	
Particles >71µm		ASTM D7647	>3	1	0	
Oil Cleanliness		ISO 4406 (c)	>/17/13	· <u> 24/22/18</u>	21/18/13	
FLUID DEGRADA		method	limit/base	current	history1	history2
Acid Number (AN)		ASTM D8045	0.4		0.33	0.09
Aciu Number (AN)	mg KOH/g	AO I IVI D0045	0.4	0.37	0.33	0.09



Built for a lifetime

OIL ANALYSIS REPORT

scalar

scalar

scalar

scalar

scalar

scalar

scalar

scalar

cSt

method

*Visual

*Visual

*Visua

*Visual

*Visual

*Visua

*Visual

*Visual

method

ASTM D445

method

scalar *Visual

scalar *Visual

limit/base

NONE

NONE

NONE

NONE

NONE

NONE

NORML

NORML

limit/base

>0.05

46

current

NONE

NONE

NONE

NONE

NONE

NONE

NORML


NORML


curren


NEG

NEG

45.1






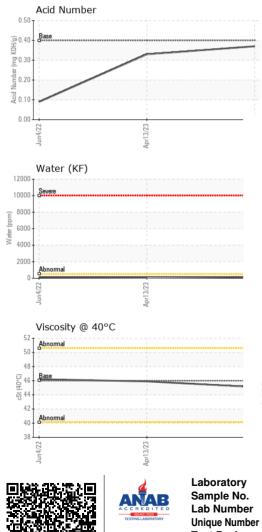

Test Package : IND 2 Certificate L2367

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)



history1

NONE

NONE

NONE

NONE

NONE

NONE

NORML

NORML

NEG

NEG

45.9

history

history2

NONE

NONE

NONE

NONE

A MODER

NONE

NORML

NORML

history2

NEG

NEG

46.2

Bottom

Color

VISUAL

White Metal

Yellow Metal

Precipitate

Silt

Debris

Odor

Sand/Dirt

Appearance

Free Water

Visc @ 40°C

Emulsified Water

FLUID PROPERTIES

SAMPLE IMAGES

