




# OIL ANALYSIS REPORT

Sample Rating Trend

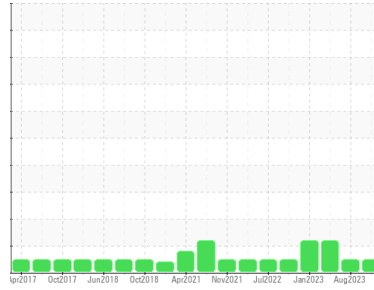

**NORMAL**



Machine Id  
**AI PUMP RM 7108 (S/N U062503334)**

Component  
**Pump**  
Fluid  
**USPI VAC 100 (--- GAL)**

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>USPM31191</b>	USPM29109	USPM28754
Sample Date	Client Info		<b>06 Nov 2023</b>	06 Aug 2023	26 Apr 2023
Machine Age	hrs	Client Info	<b>0</b>	0	0
Oil Age	hrs	Client Info	<b>0</b>	0	0
Oil Changed	Client Info		<b>N/A</b>	N/A	N/A
Sample Status			<b>NORMAL</b>	NORMAL	ABNORMAL

## WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >90	<b>6</b>	32	21
Chromium	ppm	ASTM D5185m >5	<b>0</b>	0	0
Nickel	ppm	ASTM D5185m >5	<b>&lt;1</b>	0	<1
Titanium	ppm	ASTM D5185m >3	<b>0</b>	<1	0
Silver	ppm	ASTM D5185m >3	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m >7	<b>&lt;1</b>	0	0
Lead	ppm	ASTM D5185m >12	<b>&lt;1</b>	0	0
Copper	ppm	ASTM D5185m >30	<b>1</b>	<1	<1
Tin	ppm	ASTM D5185m >9	<b>0</b>	0	0
Vanadium	ppm	ASTM D5185m	<b>0</b>	<1	0
Cadmium	ppm	ASTM D5185m	<b>0</b>	0	0

## ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m 0	<b>0</b>	0	0
Barium	ppm	ASTM D5185m 0	<b>0</b>	0	0
Molybdenum	ppm	ASTM D5185m 0	<b>0</b>	0	0
Manganese	ppm	ASTM D5185m	<b>&lt;1</b>	0	0
Magnesium	ppm	ASTM D5185m 0	<b>0</b>	0	0
Calcium	ppm	ASTM D5185m 0	<b>&lt;1</b>	0	<1
Phosphorus	ppm	ASTM D5185m 1800	<b>768</b>	1017	1013
Zinc	ppm	ASTM D5185m 0	<b>0</b>	0	2
Sulfur	ppm	ASTM D5185m 0	<b>18</b>	0	18

## CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >60	<b>3</b>	4	2
Sodium	ppm	ASTM D5185m	<b>1</b>	3	0
Potassium	ppm	ASTM D5185m >20	<b>&lt;1</b>	0	<1
Water	%	ASTM D6304 >.1	<b>0.054</b>	0.054	0.051
ppm Water	ppm	ASTM D6304 >1000	<b>543.3</b>	543.0	510.0

## FLUID CLEANLINESS






	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	>5000	<b>1004</b>	1132	▲ 14934
Particles >6µm	ASTM D7647	>1300	<b>327</b>	267	▲ 3771
Particles >14µm	ASTM D7647	>160	<b>33</b>	10	154
Particles >21µm	ASTM D7647	>40	<b>7</b>	1	10
Particles >38µm	ASTM D7647	>10	<b>1</b>	0	0
Particles >71µm	ASTM D7647	>3	<b>0</b>	0	0
Oil Cleanliness	ISO 4406 (c)	>19/17/14	<b>17/16/12</b>	17/15/10	▲ 21/19/14

## FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045 0.05	<b>1.91</b>	1.51	1.26



# OIL ANALYSIS REPORT

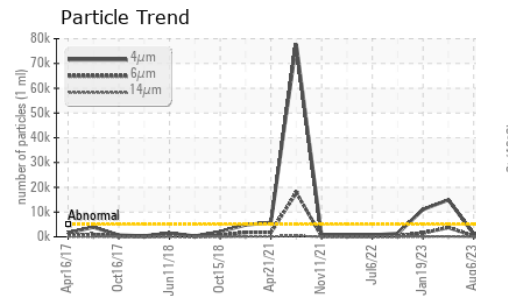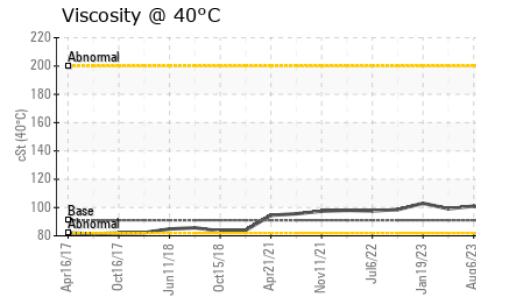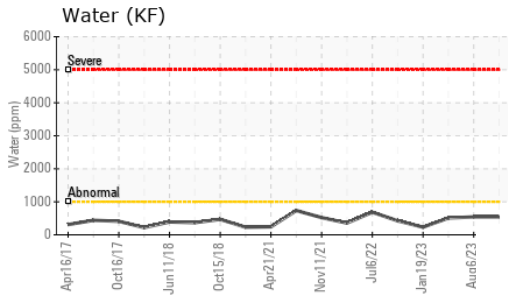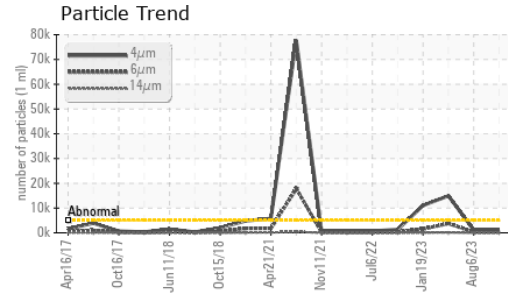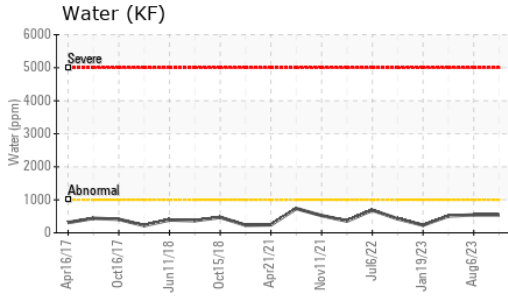


VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>.1	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 91	97.9	101	99.1




SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

Color

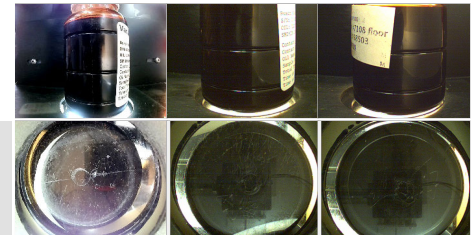

Bottom

## GRAPHS

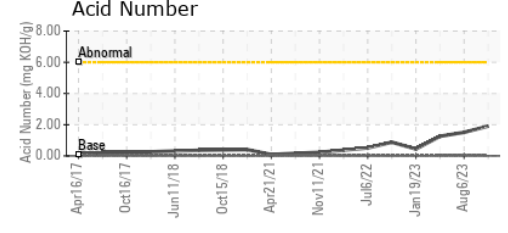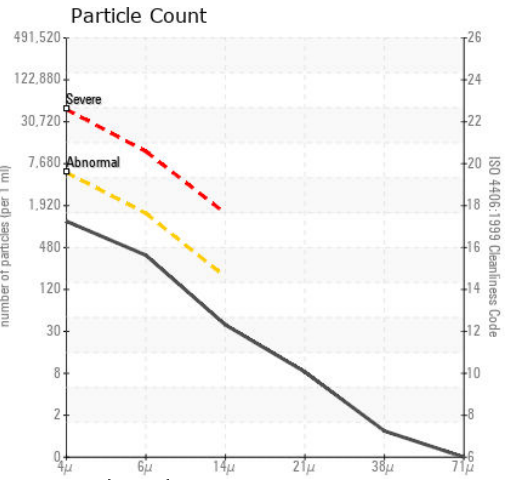

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : USPM31191 **Received** : 07 Nov 2023  
**Lab Number** : 06000563 **Diagnosed** : 08 Nov 2023  
**Unique Number** : 10728923 **Diagnostician** : Doug Bogart  
**Test Package** : IND 2

**SMITHFIELD FOODS - KINSTON**  
 KINSTON, NC  
 US  
 Contact: SERVICE MANAGER

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:  
F: