




PROBLEM SUMMARY

Sample Rating Trend

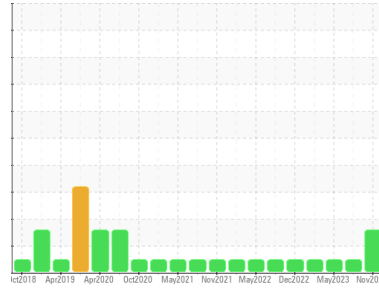


WATER



Area
TE PAG-32
 Machine Id
COMP AIR D101928 - FIRST DATA
 Component
Compressor

COMPONENT CONDITION SUMMARY

▲ Water (KF)

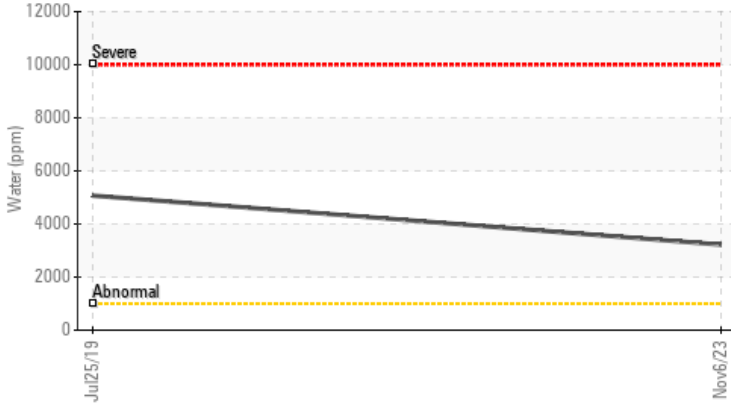

RECOMMENDATION

We advise that you follow the water drain-off procedure for this component. Resample at the next service interval to monitor.

PROBLEMATIC TEST RESULTS

Sample Status				ATTENTION	NORMAL	NORMAL
Water	%	ASTM D6304	>0.1	▲ 0.322	---	---
ppm Water	ppm	ASTM D6304	>1000	▲ 3220	---	---
Emulsified Water	scalar	*Visual	>0.1	▲ 0.2%	NEG	NEG

Customer Id: UCTATRIC
 Sample No.: UCH06000584
 Lab Number: 06000584
 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:
 Don Baldrige +1
don.b505@comcast.net

To change component or sample information:
 Customer Service +1 1-800-237-1369
customerservice@wearcheck.com

RECOMMENDED ACTIONS

Action	Status	Date	Done By	Description
Water Drain-off	---	---	?	We advise that you follow the water drain-off procedure for this component.

HISTORICAL DIAGNOSIS

25 Aug 2023 Diag: Don Baldrige

NORMAL



Resample at the next service interval to monitor. All component wear rates are normal. There is no indication of any contamination in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



11 May 2023 Diag: Don Baldrige

NORMAL



Resample at the next service interval to monitor. All component wear rates are normal. There is no indication of any contamination in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



16 Feb 2023 Diag: Angela Borella

NORMAL



Resample at the next service interval to monitor. All component wear rates are normal. There is no indication of any contamination in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.


view report





OIL ANALYSIS REPORT

Sample Rating Trend

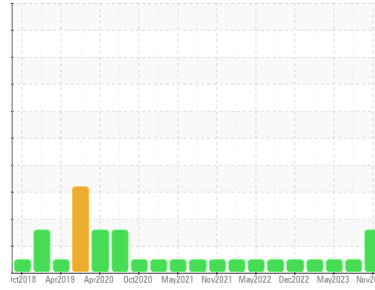

WATER



Area
TE PAG-32
 Machine Id
COMP AIR D101928 - FIRST DATA
 Component
Compressor

DIAGNOSIS

Recommendation

We advise that you follow the water drain-off procedure for this component. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a light concentration of water present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is acceptable for the time in service.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		UCH06000584	UCH05939770	UCH05847206
Sample Date	Client Info		06 Nov 2023	25 Aug 2023	11 May 2023
Machine Age	hrs	Client Info	50276	49102	47812
Oil Age	hrs	Client Info	1172	6068	4781
Oil Changed	Client Info		Not Changed	Changed	Not Changed
Sample Status			ATTENTION	NORMAL	NORMAL

WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >50	0	0	<1
Chromium	ppm	ASTM D5185m >10	0	0	<1
Nickel	ppm	ASTM D5185m	0	0	0
Titanium	ppm	ASTM D5185m	0	0	0
Silver	ppm	ASTM D5185m	0	0	0
Aluminum	ppm	ASTM D5185m >25	0	2	2
Lead	ppm	ASTM D5185m >25	0	0	<1
Copper	ppm	ASTM D5185m >50	0	0	0
Tin	ppm	ASTM D5185m >15	<1	<1	1
Vanadium	ppm	ASTM D5185m	0	0	0
Cadmium	ppm	ASTM D5185m	0	0	<1

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0	0
Barium	ppm	ASTM D5185m	655	274	308
Molybdenum	ppm	ASTM D5185m	0	0	0
Manganese	ppm	ASTM D5185m	0	0	<1
Magnesium	ppm	ASTM D5185m	0	1	2
Calcium	ppm	ASTM D5185m	8	0	5
Phosphorus	ppm	ASTM D5185m	3	3	3
Zinc	ppm	ASTM D5185m	4	0	0
Sulfur	ppm	ASTM D5185m	1125	643	709

CONTAMINANTS




	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >25	4	2	3
Sodium	ppm	ASTM D5185m	28	33	43
Potassium	ppm	ASTM D5185m >20	5	5	6
Water	%	ASTM D6304 >0.1	▲ 0.322	---	---
ppm Water	ppm	ASTM D6304 >1000	▲ 3220	---	---

FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.17	0.46	0.513




OIL ANALYSIS REPORT

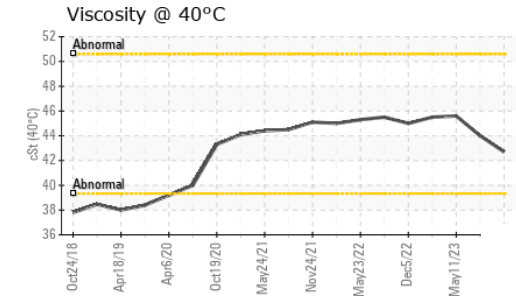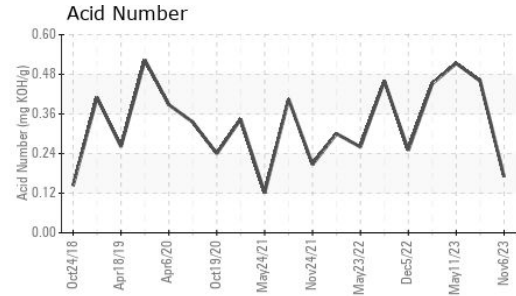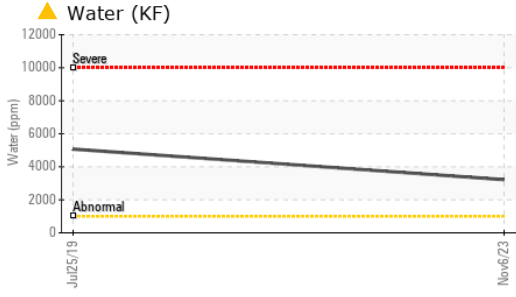





VISUAL	method	limit/base	current	history1	history2	
White Metal	scalar	*Visual	NONE	NONE	NONE	
Yellow Metal	scalar	*Visual	NONE	NONE	NONE	
Precipitate	scalar	*Visual	NONE	NONE	NONE	
Silt	scalar	*Visual	NONE	NONE	NONE	
Debris	scalar	*Visual	NONE	NONE	NONE	
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE	
Appearance	scalar	*Visual	NORML	NORML	NORML	
Odor	scalar	*Visual	NORML	NORML	NORML	
Emulsified Water	scalar	*Visual	>0.1	▲ 0.2%	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	42.7	44.0	45.6

SAMPLE IMAGES

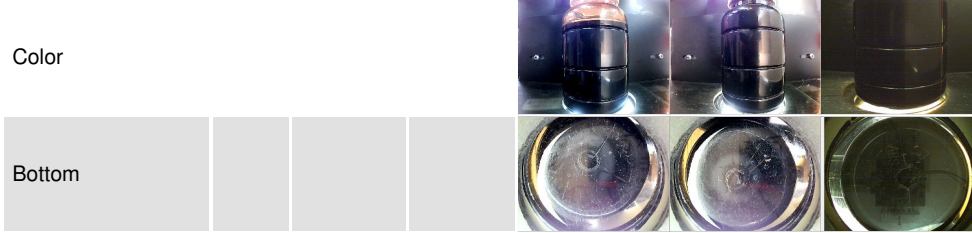

GRAPHS

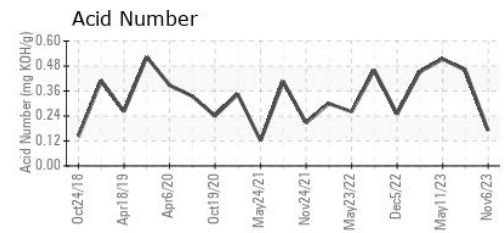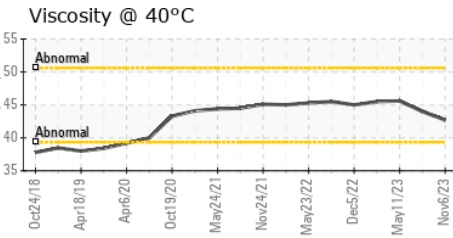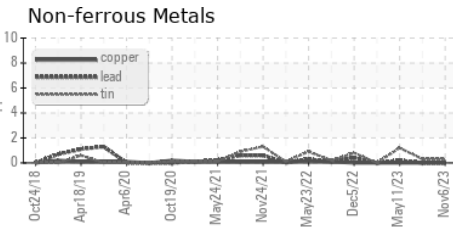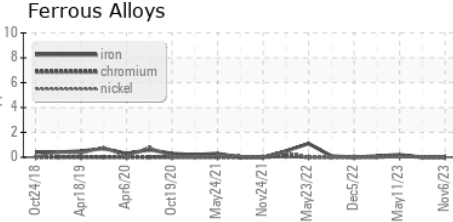

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : UCH06000584 **Received** : 07 Nov 2023
Lab Number : 06000584 **Diagnosed** : 09 Nov 2023
Unique Number : 10728944 **Diagnostician** : Don Baldrige
Test Package : IND 2 (Additional Tests: KF)

TATE ENGINEERING
 8131 VIRGINIA PINE CT
 RICHMOND, VA
 US 23237
 Contact: JOE MYRICK
 JOE.MYRICK@TATE.COM
 T: (804)339-0007
 F: (804)743-0415

Certificate L2367
 To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)