


OIL ANALYSIS REPORT

AIRLUBE PLUS 10 [1394672] Machine Id ATLAS COPCO API480-505 - MORGAN SERVICES

Component

Compressor





DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil


Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

May2021 Jun2023 0x2023						
SAMPLE INFORT	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		UCH06000596	UCH05879622	UCH05271707
Sample Date		Client Info		06 Oct 2023	10 Jun 2023	22 May 2021
Machine Age	hrs	Client Info		30716	29487	20955
Oil Age	hrs	Client Info		1229	4000	10100
Oil Changed		Client Info		Not Changd	Changed	Changed
Sample Status				NORMAL	NORMAL	ATTENTION
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	5	5	<1
Chromium	ppm	ASTM D5185m	>5	0	0	0
Nickel	ppm	ASTM D5185m		0	0	0
Titanium	ppm	ASTM D5185m		0	0	0
Silver	ppm	ASTM D5185m		0	0	0
Aluminum	ppm	ASTM D5185m	>15	1	2	0
Lead	ppm	ASTM D5185m	>65	0	0	0
Copper	ppm	ASTM D5185m		0	<1	<1
Tin			>10	0	0	0
Antimony	ppm	ASTM D5185m	>10			0
-	ppm					-
Vanadium	ppm	ASTM D5185m		0	<1	0
Cadmium	ppm	ASTM D5185m		0	0	0
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0.1	0	0	2
Barium	ppm	ASTM D5185m	0.8	0	0	0
Molybdenum	ppm	ASTM D5185m	0	0	0	0
Manganese	ppm	ASTM D5185m	0.9	0	0	0
Magnesium	ppm	ASTM D5185m	0	0	0	0
Calcium	ppm	ASTM D5185m	0	0	0	0
Phosphorus	ppm	ASTM D5185m	409	396	430	25
Zinc	ppm	ASTM D5185m	0	49	88	0
Sulfur	ppm	ASTM D5185m	1290	389	565	48
CONTAMINANTS	6	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>35	2	0	<1
Sodium	ppm	ASTM D5185m		2	<1	0
Potassium	ppm	ASTM D5185m	>20	<1	<1	0
FLUID DEGRADA	ATION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.537	0.84	1.01	1.433
VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.1	NEG	NEG	NEG
Free Water	scalar	*Visual		NEG	: DENRECK PAR	
	Julian	1.00001			3	



OIL ANALYSIS REPORT

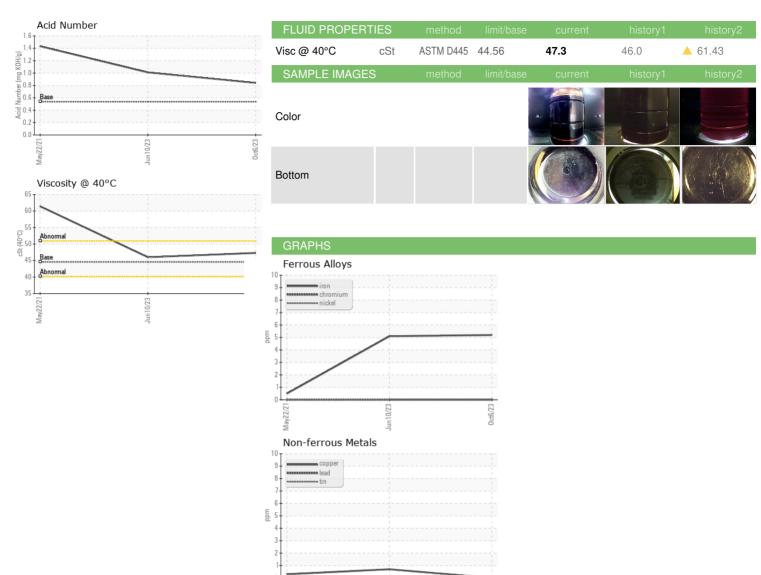





Certificate L2367

Laboratory Sample No. Lab Number Unique Number : 10728956

: UCH06000596 : 06000596 Test Package : IND 2

Viscosity @ 40°C

55 (40°C)

> : WearCheck USA - 501 Madison Ave., Cary, NC 27513 Received : 07 Nov 2023 : 09 Nov 2023 Diagnosed

Diagnostician : Don Baldridge

AIR TECHNOLOGIES INC (CLE) 6500 DAVIS INDUSTRIAL PARKWAY

Acid Number

0.0

 ${\sf CLEVELAND}, \, {\sf OH}$ US 44139

Contact: DERRICK PAES

DPAES@AIRCOMPRESSORS.COM

Contact/Location: DERRICK PAES - UCAIRCLE

T: (440)349-3900 F: (440)349-0608

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)