


# **OIL ANALYSIS REPORT**

# SYNOIL 8K PLUS

GARDNER DENVER EAQQOH EAQQOH - THERMAL TRANSFER (S/N NOT GIVEN)

Compressor





### Recommendation

Resample at the next service interval to monitor.

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the


### **Fluid Condition**

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

				0ct2023		
OAMBLE INCOR	4471011					
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		UCZ06000601		
Sample Date		Client Info		27 Oct 2023		
Machine Age	hrs	Client Info		90183		
Oil Age	hrs	Client Info		7020		
Oil Changed		Client Info		Changed		
Sample Status				NORMAL		
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	6		
Chromium	ppm	ASTM D5185m	>5	0		
Nickel	ppm	ASTM D5185m		0		
Titanium	ppm	ASTM D5185m		0		
Silver	ppm	ASTM D5185m		0		
Aluminum	ppm	ASTM D5185m	>15	0		
Lead	ppm	ASTM D5185m	>65	0		
Copper	ppm	ASTM D5185m	>65	<1		
Tin	ppm	ASTM D5185m	>10	0		
Vanadium	ppm	ASTM D5185m		0		
Cadmium	ppm	ASTM D5185m		0		
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0.3	0		
Barium	ppm	ASTM D5185m	0.3	0		
Molybdenum	ppm	ASTM D5185m	0.0	0		
Manganese	ppm	ASTM D5185m	0.9	0		
Magnesium	ppm	ASTM D5185m	0.2	0		
Calcium	ppm	ASTM D5185m	0.1	0		
Phosphorus	ppm	ASTM D5185m	429	245		
Zinc	ppm	ASTM D5185m	0.3	3		
Sulfur	ppm	ASTM D5185m	1336	774		
CONTAMINANTS		method	limit/base	current	hiotory1	history2
	•				history1	HISTOLAS
Silicon	ppm		>35	0		
Sodium	ppm	ASTM D5185m		1		
Potassium	ppm	ASTM D5185m	>20	0		
FLUID DEGRADA	ATION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.622	1.21		
VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE		
Yellow Metal	scalar	*Visual	NONE	NONE		
Precipitate	scalar	*Visual	NONE	NONE		
Silt	scalar	*Visual	NONE	NONE		
Debris	scalar	*Visual	NONE	NONE		
Sand/Dirt	scalar	*Visual	NONE	NONE		
Appearance	scalar	*Visual	NORML	NORML		
Odor	scalar	*Visual	NORML	NORML		
Emulsified Water	scalar	*Visual	>0.1	NEG		
Free Water	scalar	*Visual		NEG		



## **OIL ANALYSIS REPORT**

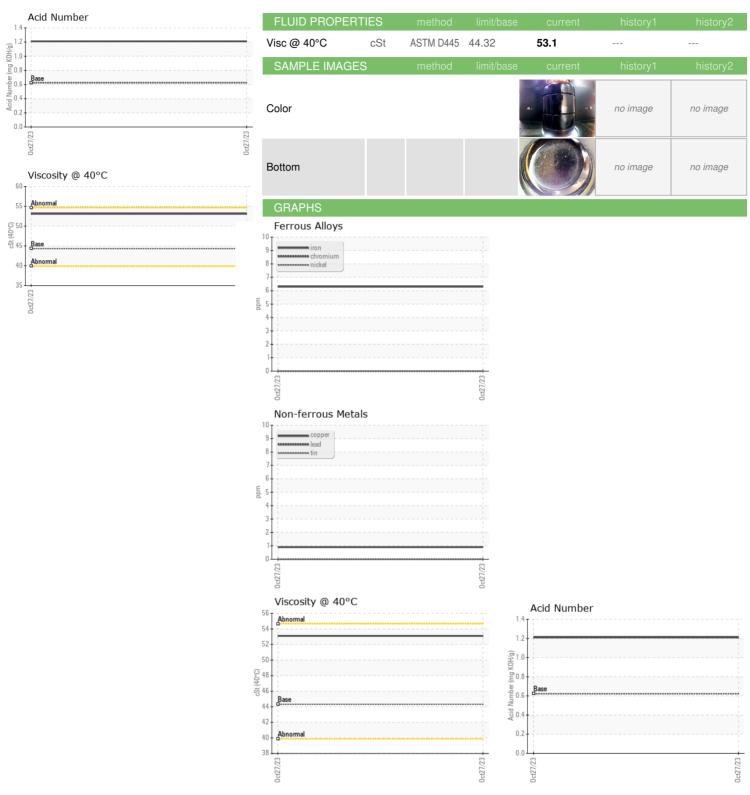





Certificate L2367

Laboratory Sample No. Lab Number Unique Number : 10728961

: UCZ06000601 : 06000601 Test Package : IND 2

: WearCheck USA - 501 Madison Ave., Cary, NC 27513 Received : 07 Nov 2023 Diagnosed

: 09 Nov 2023 Diagnostician : Don Baldridge

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

**ZORN COMP & EQUIPMENT INC - MAIN** 

1335 E WISCONSIN AVE PEWAUKEE, WI US 53072

Contact: CHRIS BOCK Chris.Bock@zornair.com

> T: (800)476-4637 F: (262)695-7017