


NOT GIVEN

OIL ANALYSIS REPORT

NOT GIVEN UCH06000608 (S/N NO INFO ON SIF/BOTTLE)

Compressor





Recommendation

Resample at the next service interval to monitor. Please specify the brand, type, and viscosity of the oil on your next sample.

All component wear rates are normal.

Contamination

There is no indication of any contamination in the


Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

| | | | | Nov2023 | | |
|------------------|----------|-------------|------------|-------------|----------|----------|
| SAMPLE INFORM | AATION | method | | | history1 | hiotory? |
| | WATION | | limit/base | current | history1 | history2 |
| Sample Number | | Client Info | | UCH06000608 | | |
| Sample Date | | Client Info | | 06 Nov 2023 | | |
| Machine Age | hrs | Client Info | | 0 | | |
| Oil Age | hrs | Client Info | | 0 | | |
| Oil Changed | | Client Info | | N/A | | |
| Sample Status | | | | NORMAL | | |
| WEAR METALS | | method | limit/base | current | history1 | history2 |
| Iron | ppm | ASTM D5185m | >50 | 0 | | |
| Chromium | ppm | ASTM D5185m | >10 | 0 | | |
| Nickel | ppm | ASTM D5185m | | 0 | | |
| Titanium | ppm | ASTM D5185m | | 0 | | |
| Silver | ppm | ASTM D5185m | | 0 | | |
| Aluminum | ppm | ASTM D5185m | >25 | 0 | | |
| Lead | ppm | ASTM D5185m | >25 | 0 | | |
| Copper | ppm | ASTM D5185m | >50 | 0 | | |
| Tin | ppm | ASTM D5185m | >15 | 0 | | |
| Vanadium | ppm | ASTM D5185m | | 0 | | |
| Cadmium | ppm | ASTM D5185m | | 0 | | |
| ADDITIVES | | method | limit/base | current | history1 | history2 |
| Boron | ppm | ASTM D5185m | | 0 | | |
| Barium | ppm | ASTM D5185m | | 0 | | |
| Molybdenum | ppm | ASTM D5185m | | 0 | | |
| Manganese | ppm | ASTM D5185m | | 0 | | |
| Magnesium | ppm | ASTM D5185m | | 0 | | |
| Calcium | ppm | ASTM D5185m | | 0 | | |
| Phosphorus | ppm | ASTM D5185m | | 112 | | |
| Zinc | ppm | ASTM D5185m | | 2 | | |
| Sulfur | ppm | ASTM D5185m | | 581 | | |
| CONTAMINANTS | 3 | method | limit/base | current | history1 | history2 |
| Silicon | ppm | ASTM D5185m | >25 | 0 | | |
| Sodium | ppm | ASTM D5185m | | <1 | | |
| Potassium | ppm | ASTM D5185m | >20 | 0 | | |
| FLUID DEGRADA | NOITA | method | limit/base | current | history1 | history2 |
| Acid Number (AN) | mg KOH/g | ASTM D8045 | | 0.20 | | |
| VISUAL | | method | limit/base | current | history1 | history2 |
| White Metal | scalar | *Visual | NONE | NONE | | |
| Yellow Metal | scalar | *Visual | NONE | NONE | | |
| Precipitate | scalar | *Visual | NONE | NONE | | |
| Silt | scalar | *Visual | NONE | NONE | | |
| Debris | scalar | *Visual | NONE | NONE | | |
| Sand/Dirt | scalar | *Visual | NONE | NONE | | |
| Appearance | scalar | *Visual | NORML | NORML | | |
| Odor | scalar | *Visual | NORML | NORML | | |
| Emulsified Water | scalar | *Visual | >0.1 | NEG | | |
| Free Water | scalar | *Visual | | NEG | | |
| | | | | | | |



OIL ANALYSIS REPORT

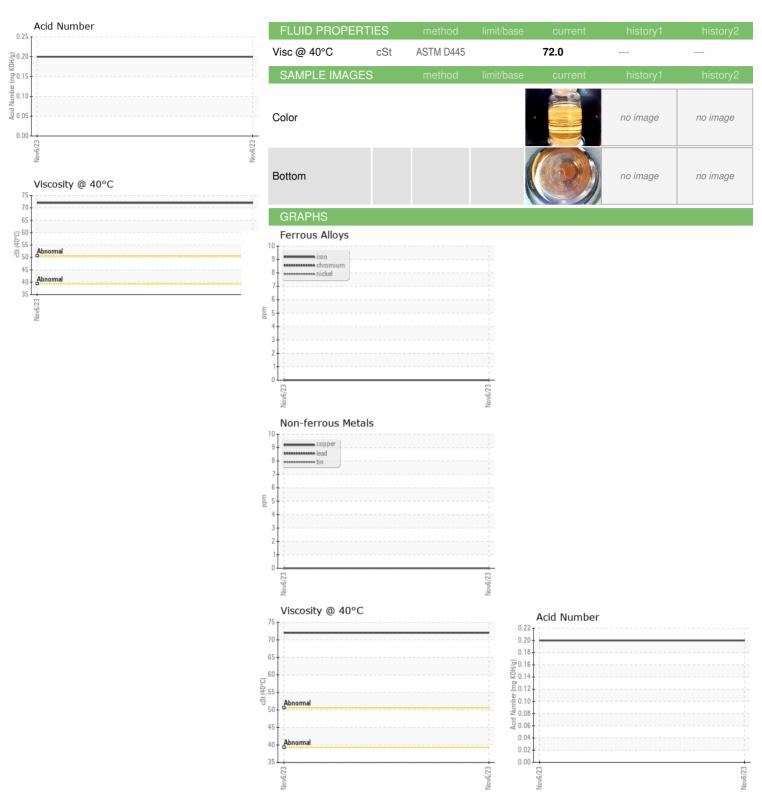





Certificate L2367

Laboratory Sample No. Lab Number

Unique Number : 10728968 Test Package : IND 2

: UCH06000608 : 06000608

: WearCheck USA - 501 Madison Ave., Cary, NC 27513 Received Diagnosed

: 07 Nov 2023 : 09 Nov 2023

Diagnostician : Don Baldridge

To discuss this sample report, contact Customer Service at 1-800-237-1369. * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

CISCO AIR SYSTEMS 2373 LINCOLN AVE

HAYWARD, CA US 94545 Contact: JOHN FINCH

jfinch@ciscoair.com T: (916)414-0331

F: x: